

- Legend**
- New 132kV Line
Preferred Option to be determined
 - Upgrade 66kV Line to 132kV
 - Existing Substation
 - Proposed Substation
 - Pacific Highway
Current Alignment
 - Pacific Highway
Preferred Route
 - AHIMS Records
 - 10m Contours

NOTE: NOT FOR PUBLIC EXHIBITION


Figure 3E
Suffolk Park to Lennox Head:
AHIMS Records

Client:	Country Energy		
Project:	Lismore to Mullumbimby		
Drawing No:	0051706 3E		
Date:	23/7/07	Drawing Size:	A4
Drawn By:	WW	Reviewed By:	MC
Source:	LPI 2007		
Scale:			



Environmental Resources Management Australia Pty Ltd
PO Box 5711, Port Macquarie, NSW 2444
Telephone +61 2 6584 7155



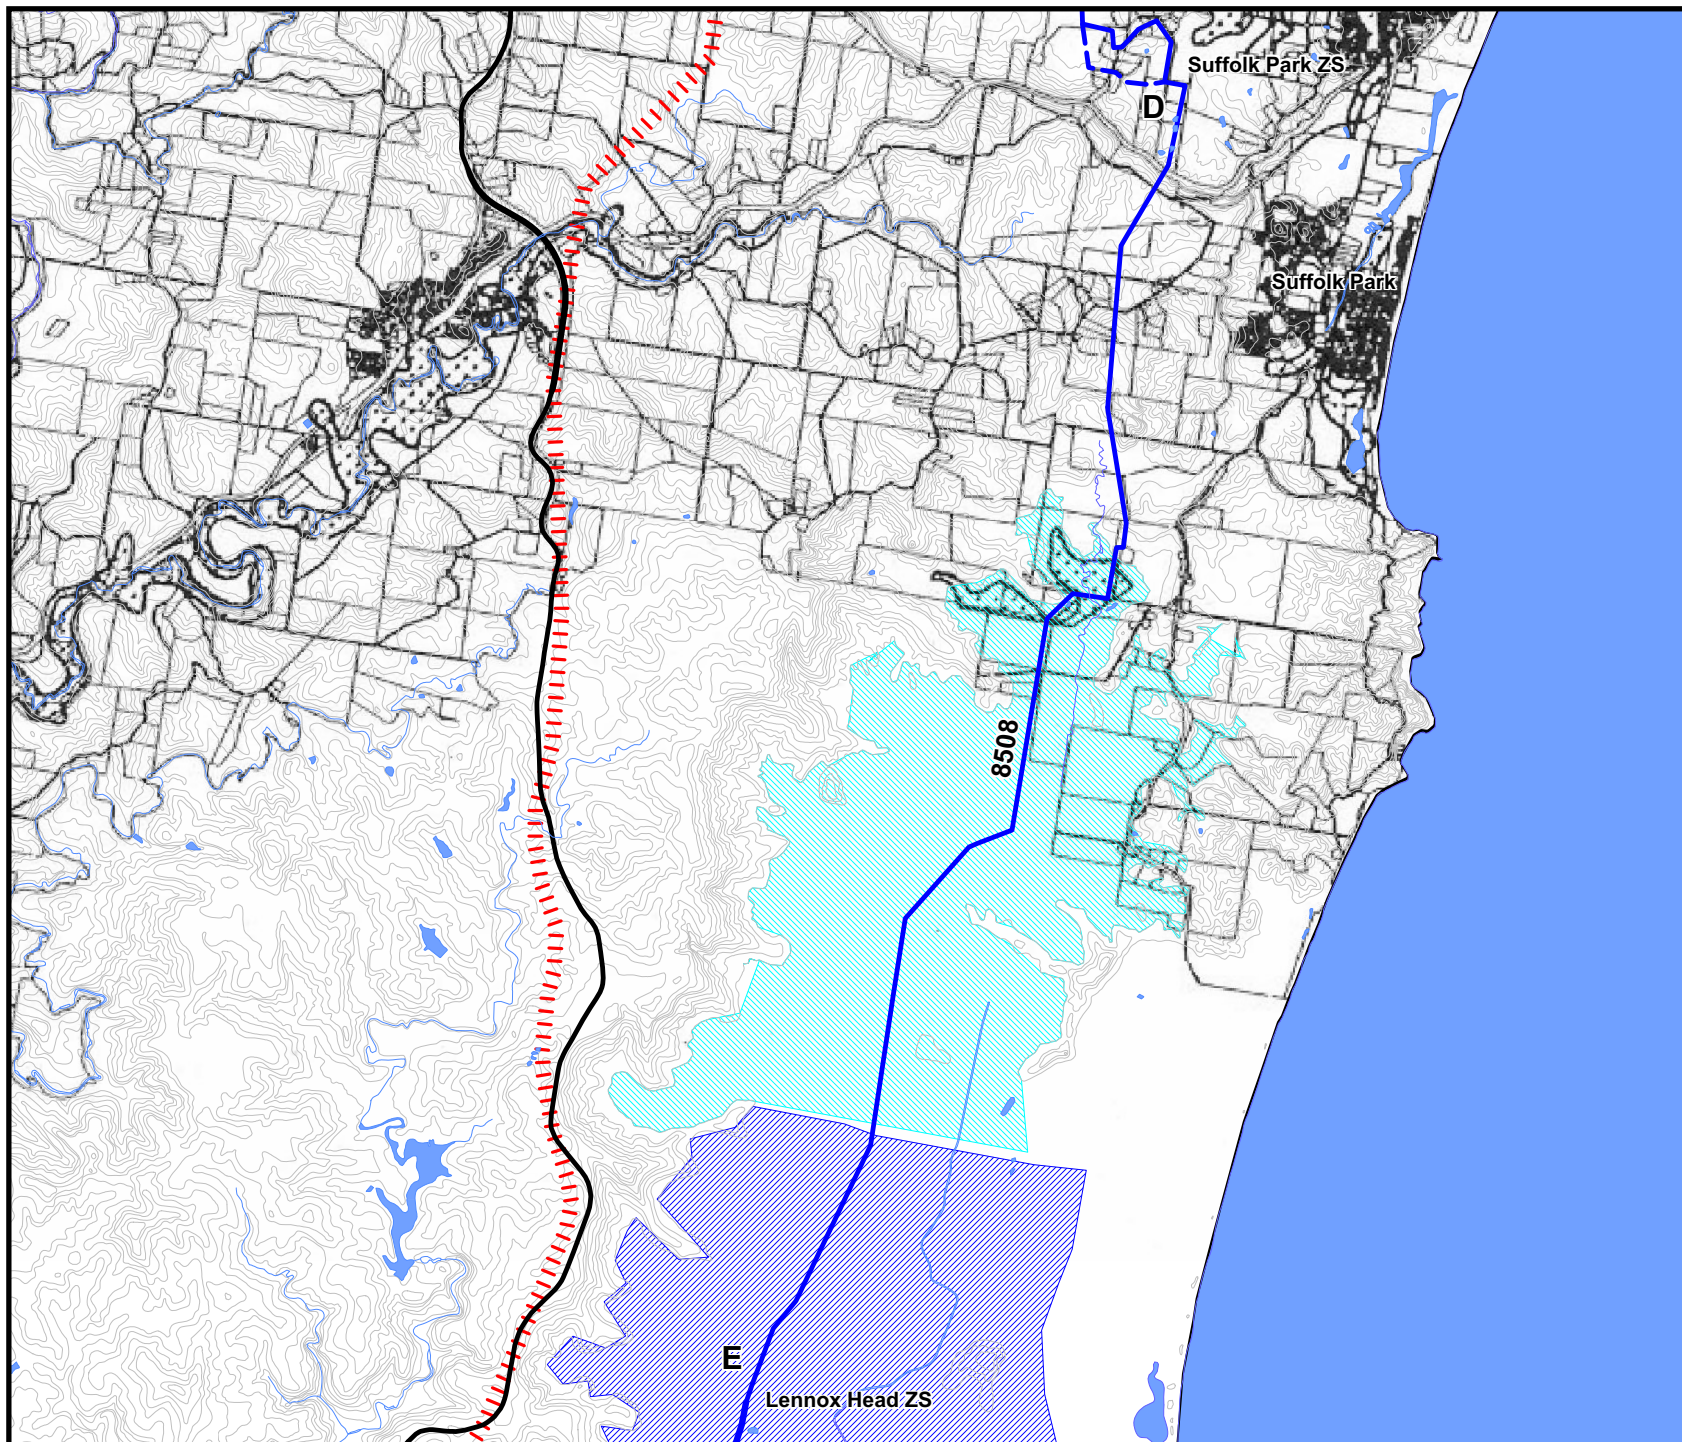


Legend

- New 132kV Line
Preferred Option to be determined
- Upgrade 66kV Line to 132kV
- Existing Substation
- Proposed Substation
- Pacific Highway
Current Alignment
- Pacific Highway
Preferred Route
- Ballina Shire 1:100 yr flooding
- Ballina Shire likely 1:100 yr flooding
- 10m Contours

Figure 3F

Suffolk Park to Lennox Head: Flooding

Client:	Country Energy		
Project:	Lismore to Mullumbimby		
Drawing No:	0051706 3F		
Date:	23/7/07	Drawing Size:	A4
Drawn By:	WW	Reviewed By:	MC
Source:	LPI 2007		
Scale:			



Environmental Resources Management Australia Pty Ltd
PO Box 5711, Port Macquarie, NSW 2444
Telephone +61 2 6584 7155

