

New 132kV Line Preferred Option to be determined

Upgrade 66kV Line to 132kV

New 66kV Line

Existing 66kV Line

Existing Substation

Proposed Substation

Pacific Highway Current Alignment

Pacific Highway Preferred Route

National Park/Nature Reserve


Figure 6A


Lismore & Lismore University: Vegetation


T	N	Kilometres			
	0	0	0.5	1	
	Scale:	see scale bar			
	Source:	LPI 2007			
	Drawn By:	WW	Reviewed By:	MC	
	Date:	31/7/07	Drawing Size:	A4	
	Drawing No:	0051706 6A			
	Project:	Lismore to Mu	llum 132kV		
	Client:	Country Energ	у		


Environmental Resources Management Australia Pty Ltd PO Box 5711, Port Macquarie, NSW 2444 Telephone +61 2 6584 7155



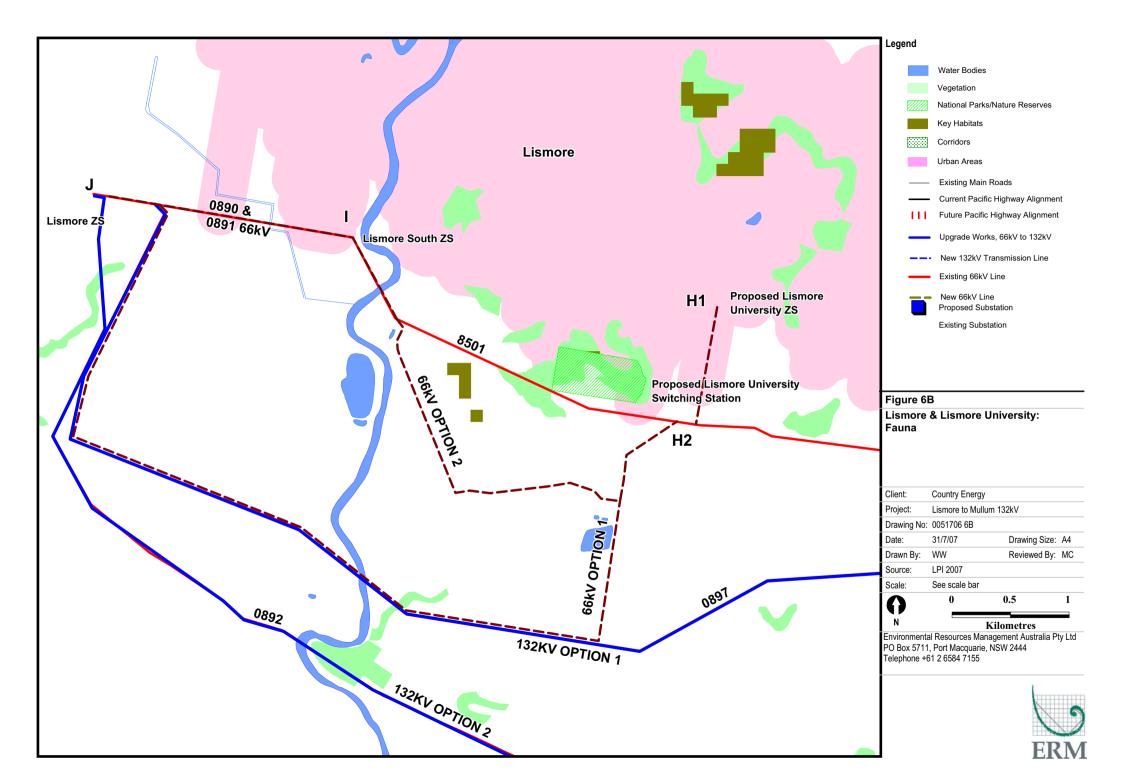

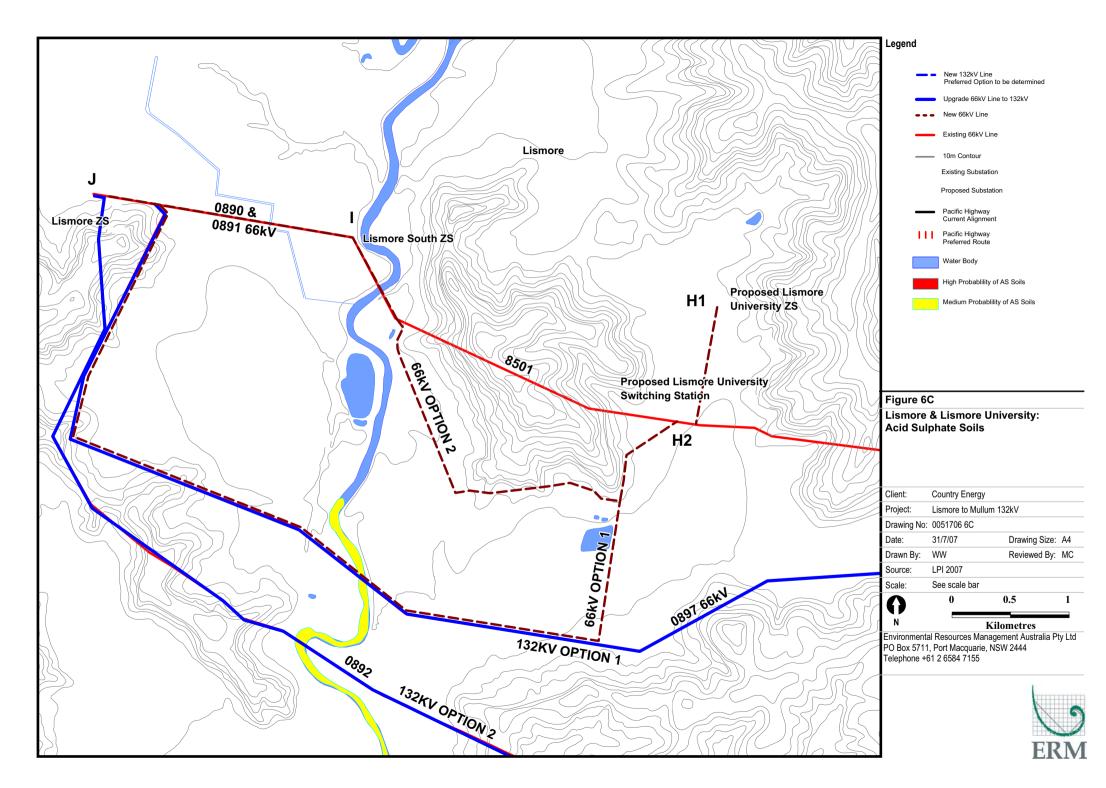

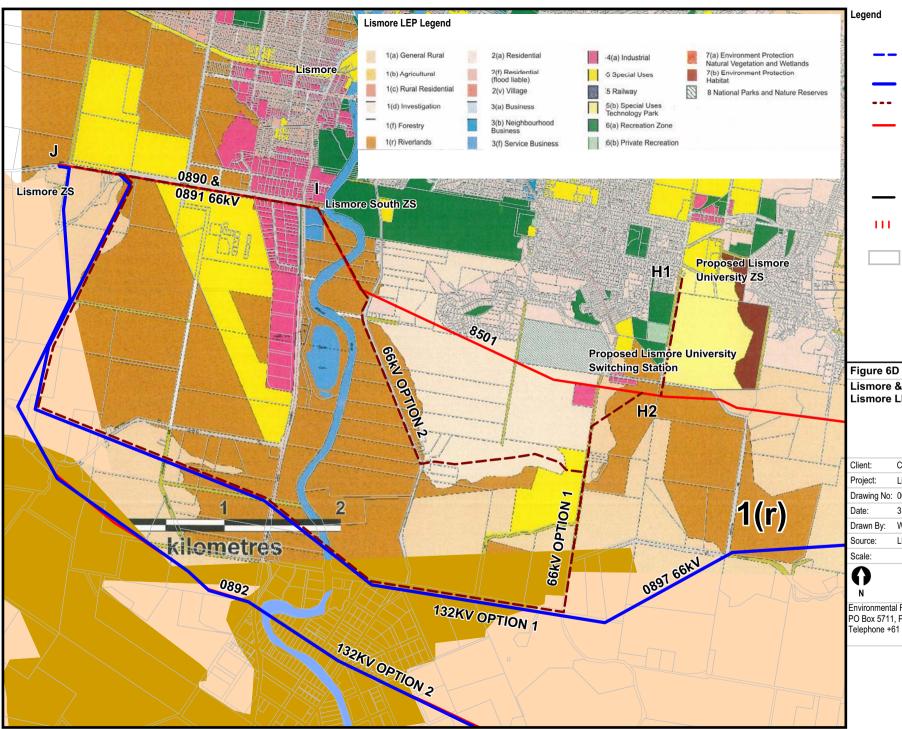



Lismore & Lismore University: Lismore LEP Zoning

N	Kilometres		
0	0	0.5	1
Scale:			
Source:	LPI 2007		
Drawn By:	WW	Reviewed By:	MC
Date:	31/7/07	Drawing Size:	A4
Drawing No:	0051706 6D		
Project:	Lismore to Mullum 132kV		
Client:	Country Energy	y	

Environmental Resources Management Australia Pty Ltd PO Box 5711, Port Macquarie, NSW 2444 Telephone +61 2 6584 7155



