
APPENDIX B

Notes Relating to this Report
Test Pit Logs (TP 1-89)
Borehole Logs (BH 101-112)

NOTES RELATING TO THIS REPORT

Introduction

These notes have been provided to amplify the geotechnical report in regard to classification methods, specialist field procedures and certain matters relating to the Discussion and Comments section. Not all, of course, are necessarily relevant to all reports.

Geotechnical reports are based on information gained from limited subsurface test boring and sampling, supplemented by knowledge of local geology and experience. For this reason, they must be regarded as interpretive rather than factual documents, limited to some extent by the scope of information on which they rely.

Description and Classification Methods

The methods of description and classification of soils and rocks used in this report are based on Australian Standard 1726, Geotechnical Site Investigations Code. In general, descriptions cover the following properties - strength or density, colour, structure, soil or rock type and inclusions.

Soil types are described according to the predominating particle size, qualified by the grading of other particles present (eg. sandy clay) on the following bases:

Soil Classification	Particle Size
Clay	less than 0.002 mm
Silt	0.002 to 0.06 mm
Sand	0.06 to 2.00 mm
Gravel	2.00 to 60.00 mm

Cohesive soils are classified on the basis of strength either by laboratory testing or engineering examination. The strength terms are defined as follows.

Classification	Undrained Shear Strength kPa
Very soft	less than 12
Soft	12—25
Firm	25—50
Stiff	50—100
Very stiff	100—200
Hard	Greater than 200

Non-cohesive soils are classified on the basis of relative density, generally from the results of standard penetration tests (SPT) or Dutch cone penetrometer tests (CPT) as below:

Relative Density	SPT "N" Value (blows/300 mm)	CPT Cone Value (q_c — MPa)
Very loose	less than 5	less than 2
Loose	5—10	2—5
Medium dense	10—30	5—15
Dense	30—50	15—25
Very dense	greater than 50	greater than 25

Rock types are classified by their geological names. Where relevant, further information regarding rock classification is given on the following sheet.

Sampling

Sampling is carried out during drilling to allow engineering examination (and laboratory testing where required) of the soil or rock.

Disturbed samples taken during drilling provide information on colour, type, inclusions and, depending upon the degree of disturbance, some information on strength and structure.

Undisturbed samples are taken by pushing a thin-walled sample tube into the soil and withdrawing with a sample of the soil in a relatively undisturbed state. Such samples yield information on structure and strength, and are necessary for laboratory determination of shear strength and compressibility. Undisturbed sampling is generally effective only in cohesive soils.

Details of the type and method of sampling are given in the report.

Drilling Methods.

The following is a brief summary of drilling methods currently adopted by the Company and some comments on their use and application.

Test Pits — these are excavated with a backhoe or a tracked excavator, allowing close examination of the in-situ soils if it is safe to descent into the pit. The depth of penetration is limited to about 3 m for a backhoe and up to 6 m for an excavator. A potential disadvantage is the disturbance caused by the excavation.

Large Diameter Auger (eg. Pengo) — the hole is advanced by a rotating plate or short spiral auger, generally 300 mm or larger in diameter. The cuttings are returned to the surface at intervals (generally of not more than 0.5 m) and are disturbed but usually unchanged in moisture content. Identification of soil strata is generally much more reliable than with continuous spiral flight augers, and is usually supplemented by occasional undisturbed tube sampling.

Continuous Sample Drilling — the hole is advanced by pushing a 100 mm diameter socket into the ground and withdrawing it at intervals to extrude the sample. This is the most reliable method of drilling in soils, since moisture content is unchanged and soil structure, strength, etc. is only marginally affected.

Continuous Spiral Flight Augers — the hole is advanced using 90—115 mm diameter continuous spiral flight augers which are withdrawn at intervals to allow sampling or in-situ testing. This is a relatively economical means of drilling in clays and in sands above the water

table. Samples are returned to the surface, or may be collected after withdrawal of the auger flights, but they are very disturbed and may be contaminated. Information from the drilling (as distinct from specific sampling by SPTs or undisturbed samples) is of relatively lower reliability, due to remoulding, contamination or softening of samples by ground water.

Non-core Rotary Drilling — the hole is advanced by a rotary bit, with water being pumped down the drill rods and returned up the annulus, carrying the drill cuttings. Only major changes in stratification can be determined from the cuttings, together with some information from 'feel' and rate of penetration.

Rotary Mud Drilling — similar to rotary drilling, but using drilling mud as a circulating fluid. The mud tends to mask the cuttings and reliable identification is again only possible from separate intact sampling (eg. from SPT).

Continuous Core Drilling — a continuous core sample is obtained using a diamond-tipped core barrel, usually 50 mm internal diameter. Provided full core recovery is achieved (which is not always possible in very weak rocks and granular soils), this technique provides a very reliable (but relatively expensive) method of investigation.

Standard Penetration Tests

Standard penetration tests (abbreviated as SPT) are used mainly in non-cohesive soils, but occasionally also in cohesive soils as a means of determining density or strength and also of obtaining a relatively undisturbed sample. The test procedure is described in Australian Standard 1289, "Methods of Testing Soils for Engineering Purposes" — Test 6.3.1.

The test is carried out in a borehole by driving a 50 mm diameter split sample tube under the impact of a 63 kg hammer with a free fall of 760 mm. It is normal for the tube to be driven in three successive 150 mm increments and the 'N' value is taken as the number of blows for the last 300 mm. In dense sands, very hard clays or weak rock, the full 450 mm penetration may not be practicable and the test is discontinued.

The test results are reported in the following form.

- In the case where full penetration is obtained with successive blow counts for each 150 mm of say 4, 6 and 7
as 4, 6, 7
N = 13
- In the case where the test is discontinued short of full penetration, say after 15 blows for the first 150 mm and 30 blows for the next 40 mm
as 15, 30/40 mm.

The results of the tests can be related empirically to the engineering properties of the soil.

Occasionally, the test method is used to obtain samples in 50 mm diameter thin walled sample tubes in clays. In such circumstances, the test results are shown on the borelogs in brackets.

Cone Penetrometer Testing and Interpretation

Cone penetrometer testing (sometimes referred to as Dutch cone — abbreviated as CPT) described in this report has been carried out using an electrical friction cone penetrometer. The test is described in Australian Standard 1289, Test 6.4.1.

In the tests, a 35 mm diameter rod with a cone-tipped end is pushed continuously into the soil, the reaction being provided by a specially designed truck or rig which is fitted with an hydraulic ram system. Measurements are made of the end bearing resistance on the cone and the friction resistance on a separate 130 mm long sleeve, immediately behind the cone. Transducers in the tip of the assembly are connected by electrical wires passing through the centre of the push rods to an amplifier and recorder unit mounted on the control truck.

As penetration occurs (at a rate of approximately 20 mm per second) the information is plotted on a computer screen and at the end of the test is stored on the computer for later plotting of the results.

The information provided on the plotted results comprises: —

- Cone resistance — the actual end bearing force divided by the cross sectional area of the cone — expressed in MPa.
- Sleeve friction — the frictional force on the sleeve divided by the surface area — expressed in kPa.
- Friction ratio — the ratio of sleeve friction to cone resistance, expressed in percent.

There are two scales available for measurement of cone resistance. The lower scale (0—5 MPa) is used in very soft soils where increased sensitivity is required and is shown in the graphs as a dotted line. The main scale (0—50 MPa) is less sensitive and is shown as a full line.

The ratios of the sleeve friction to cone resistance will vary with the type of soil encountered, with higher relative friction in clays than in sands. Friction ratios of 1%—2% are commonly encountered in sands and very soft clays rising to 4%—10% in stiff clays.

In sands, the relationship between cone resistance and SPT value is commonly in the range:—

$$q_c \text{ (MPa)} = (0.4 \text{ to } 0.6) N \text{ (blows per 300 mm)}$$

In clays, the relationship between undrained shear strength and cone resistance is commonly in the range:—

$$q_c = (12 \text{ to } 18) c_u$$

Interpretation of CPT values can also be made to allow estimation of modulus or compressibility values to allow calculation of foundation settlements.

Inferred stratification as shown on the attached reports is assessed from the cone and friction traces and from experience and information from nearby boreholes, etc. This information is presented for general guidance, but must be regarded as being to some extent interpretive. The test method provides a continuous profile of engineering properties, and where precise information on soil classification is required, direct drilling and sampling may be preferable.

Hand Penetrometers

Hand penetrometer tests are carried out by driving a rod into the ground with a falling weight hammer and measuring the blows for successive 150 mm increments of penetration. Normally, there is a depth limitation of 1.2 m but this may be extended in certain conditions by the use of extension rods.

Two relatively similar tests are used.

- Perth sand penetrometer — a 16 mm diameter flat-ended rod is driven with a 9 kg hammer, dropping 600 mm (AS 1289, Test 6.3.3). This test was developed for testing the density of sands (originating in Perth) and is mainly used in granular soils and filling.
- Cone penetrometer (sometimes known as the Scala Penetrometer) — a 16 mm rod with a 20 mm diameter cone end is driven with a 9 kg hammer dropping 510 mm (AS 1289, Test 6.3.2). The test was developed initially for pavement subgrade investigations, and published correlations of the test results with California bearing ratio have been published by various Road Authorities.

Laboratory Testing

Laboratory testing is carried out in accordance with Australian Standard 1289 "Methods of Testing Soil for Engineering Purposes". Details of the test procedure used are given on the individual report forms.

Bore Logs

The bore logs presented herein are an engineering and/or geological interpretation of the subsurface conditions, and their reliability will depend to some extent on frequency of sampling and the method of drilling. Ideally, continuous undisturbed sampling or core drilling will provide the most reliable assessment, but this is not always practicable, or possible to justify on economic grounds. In any case, the boreholes represent only a very small sample of the total subsurface profile.

Interpretation of the information and its application to design and construction should therefore take into account the spacing of boreholes, the frequency of sampling and the possibility of other than 'straight line' variations between the boreholes.

Ground Water

Where ground water levels are measured in boreholes, there are several potential problems;

- In low permeability soils, ground water although present, may enter the hole slowly or perhaps not at all during the time it is left open.
- A localised perched water table may lead to an erroneous indication of the true water table.
- Water table levels will vary from time to time with seasons or recent weather changes. They may not be

the same at the time of construction as are indicated in the report.

- The use of water or mud as a drilling fluid will mask any ground water inflow. Water has to be blown out of the hole and drilling mud must first be washed out of the hole if water observations are to be made.

More reliable measurements can be made by installing standpipes which are read at intervals over several days, or perhaps weeks for low permeability soils. Piezometers, sealed in a particular stratum, may be advisable in low permeability soils or where there may be interference from a perched water table.

Engineering Reports

Engineering reports are prepared by qualified personnel and are based on the information obtained and on current engineering standards of interpretation and analysis. Where the report has been prepared for a specific design proposal (eg. a three storey building), the information and interpretation may not be relevant if the design proposal is changed (eg. to a twenty storey building). If this happens, the Company will be pleased to review the report and the sufficiency of the investigation work.

Every care is taken with the report as it relates to interpretation of subsurface condition, discussion of geotechnical aspects and recommendations or suggestions for design and construction. However, the Company cannot always anticipate or assume responsibility for:

- unexpected variations in ground conditions — the potential for this will depend partly on bore spacing and sampling frequency
- changes in policy or interpretation of policy by statutory authorities
- the actions of contractors responding to commercial pressures.

If these occur, the Company will be pleased to assist with investigation or advice to resolve the matter.

Site Anomalies

In the event that conditions encountered on site during construction appear to vary from those which were expected from the information contained in the report, the Company requests that it immediately be notified. Most problems are much more readily resolved when conditions are exposed than at some later stage, well after the event.

Reproduction of Information for Contractual Purposes

Attention is drawn to the document "Guidelines for the Provision of Geotechnical Information in Tender Documents", published by the Institution of Engineers, Australia. Where information obtained from this investigation is provided for tendering purposes, it is recommended that all information, including the written report and discussion, be made available. In circumstances where the discussion or comments section

is not relevant to the contractual situation, it may be appropriate to prepare a specially edited document. The Company would be pleased to assist in this regard and/or to make additional report copies available for contract purposes at a nominal charge.

Site Inspection

The Company will always be pleased to provide engineering inspection services for geotechnical aspects of work to which this report is related. This could range from a site visit to confirm that conditions exposed are as expected, to full time engineering presence on site.

Copyright © 1998 Douglas Partners Pty Ltd



Douglas Partners

Geotechnics • Environment • Groundwater

DESCRIPTION AND CLASSIFICATION OF ROCKS FOR ENGINEERING PURPOSES

DEGREE OF WEATHERING

Term	Symbol	Definition
Extremely Weathered	EW	Rock substance affected by weathering to the extent that the rock exhibits soil properties - i.e. it can be remoulded and can be classified according to the Unified Classification System, but the texture of the original rock is still evident.
Highly Weathered	HW	Rock substance affected by weathering to the extent that limonite staining or bleaching affects the whole of the rock substance and other signs of chemical or physical decomposition are evident. Porosity and strength may be increased or decreased compared to the fresh rock usually as a result of iron leaching or deposition. The colour and strength of the original fresh rock substance is no longer recognisable.
Moderately Weathered	MW	Rock substance affected by weathering to the extent that staining or discolouration of the rock substance usually by limonite has taken place. The colour of the fresh rock is no longer recognisable.
Slightly Weathered	SW	Rock substance affected by weathering to the extent that partial staining or discolouration of the rock substance usually by limonite has taken place. The colour and texture of the fresh rock is recognisable.
Fresh Stained	Fs	Rock substance unaffected by weathering, but showing limonite staining along joints.
Fresh	Fr	Rock substance unaffected by weathering.

ROCK STRENGTH

Rock strength is defined by the Point Load Strength Index ($I_{S(50)}$) and refers to the strength of the rock substance in the direction normal to the bedding. The test procedure is described by Australian Standard 4133.4.1 - 1993.

Term	Symbol	Field Guide*	Point Load Index $I_{S(50)}$ MPa	Approx Unconfined Compressive Strength q_u ** MPa
Extremely low	EL	Easily remoulded by hand to a material with soil properties	<0.03	< 0.6
Very low	VL	Material crumbles under firm blows with sharp end of pick; can be peeled with a knife; too hard to cut a triaxial sample by hand. SPT will refuse. Pieces up to 3 cm thick can be broken by finger pressure.	0.03-0.1	0.6-2
Low	L	Easily scored with a knife; indentations 1 mm to 3 mm show in the specimen with firm blows of the pick point; has dull sound under hammer. A piece of core 150 mm long 40 mm diameter may be broken by hand. Sharp edges of core may be friable and break during handling.	0.1-0.3	2-6
Medium	M	Readily scored with a knife; a piece of core 150 mm long by 50 mm diameter can be broken by hand with difficulty.	0.3-1.0	6-20
High	H	Can be slightly scratched with a knife. A piece of core 150 mm long by 50 mm diameter cannot be broken by hand but can be broken with pick with a single firm blow, rock rings under hammer.	1 - 3	20-60
Very high	VH	Cannot be scratched with a knife. Hand specimen breaks with pick after more than one blow, rock rings under hammer.	3 - 10	60-200
Extremely high	EH	Specimen requires many blows with geological pick to break through intact material, rock rings under hammer.	>10	> 200

Note that these terms refer to strength of rock material and not to the strength of the rock mass, which may be considerably weaker due to rock defects.

* The field guide assessment of rock strength may be used for preliminary assessment or when point load testing is not able to be done.

** The approximate unconfined compressive strength (q_u) shown in the table is based on an assumed ratio to the point load index of 20:1. This ratio may vary widely.



STRATIFICATION SPACING

Term	Separation of Stratification Planes
Thinly laminated	<6 mm
Laminated	6 mm to 20 mm
Very thinly bedded	20 mm to 60 mm
Thinly bedded	60 mm to 0.2 m
Medium bedded	0.2 m to 0.6 m
Thickly bedded	0.6 m to 2 m
Very thickly bedded	>2 m

DEGREE OF FRACTURING

This classification applies to diamond drill cores and refers to the spacing of all types of natural fractures along which the core is discontinuous. These include bedding plane partings, joints and other rock defects, but exclude known artificial fractures such as drilling breaks. The orientation of rock defects is measured as an angle relative to a plane perpendicular to the core axis. Note that where possible, recordings of the actual defect spacing or range of spacings is preferred to the general terms given below.

Term	Description
Fragmented	The core consists mainly of fragments with dimensions less than 20 mm.
Highly Fractured	Core lengths are generally less than 20 mm - 40 mm with occasional fragments.
Fractured	Core lengths are mainly 40 mm - 200 mm with occasional shorter and longer sections.
Slightly Fractured	Core lengths are generally 200 mm - 1000 mm with occasional shorter and longer sections.
Unbroken	The core does not contain any fracture.

ROCK QUALITY DESIGNATION (RQD)

This is defined as the ratio of sound (i.e. low strength or better) core in lengths of greater than 100 mm to the total length of the core, expressed in percent. If the core is broken by handling or by the drilling process (i.e. the fracture surfaces are fresh, irregular breaks rather than joint surfaces) the fresh broken pieces are fitted together and counted as one piece.

SEDIMENTARY ROCK TYPES






















This classification system provides a standardised terminology for the engineering description of sandstone and shales, particularly in the Sydney area, but the terms and definitions may be used elsewhere when applicable.

Rock Type	Definition
Conglomerate	More than 50% of the rock consists of gravel-sized (greater than 2 mm) fragments
Sandstone:	More than 50% of the rock consists of sand-sized (0.06 to 2 mm) grains
Siltstone:	More than 50% of the rock consists of silt-sized (less than 0.06 mm) granular particles and the rock is not laminated.
Claystone:	More than 50% of the rock consists of clay or sericitic material and the rock is not laminated.
Shale:	More than 50% of the rock consists of silt or clay-sized particles and the rock is laminated.











Rocks possessing characteristics of two groups are described by their predominant particle size with reference also to the minor constituents, eg. clayey sandstone, sandy shale.

GRAPHIC SYMBOLS FOR SOIL & ROCK




SOIL

	BITUMINOUS CONCRETE
	CONCRETE
	TOPSOIL
	FILLING
	PEAT
	CLAY
	SILTY CLAY
	SANDY CLAY
	GRAVELLY CLAY
	SHALY CLAY
	SILT
	CLAYEY SILT
	SANDY SILT
	SAND
	CLAYEY SAND
	SILTY SAND
	GRAVEL
	SANDY GRAVEL
	CLAYEY GRAVEL
	COBBLES/BOULDERS
	TALUS





SEDIMENTARY ROCK

	BOULDER CONGLOMERATE
	CONGLOMERATE
	CONGLOMERATIC SANDSTONE
	SANDSTONE FINE GRAINED
	SANDSTONE COARSE GRAINED
	SILTSTONE
	LAMINITE
	MUDSTONE, CLAYSTONE, SHALE
	COAL
	LIMESTONE

METAMORPHIC ROCK

	SLATE, PHYLITTE, SCHIST
	GNEISS
	QUARTZITE

IGNEOUS ROCK

	GRANITE
	DOLERITE, BASALT
	TUFF
	PORPHYRY



TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 34
EASTING: 293222
NORTHING: 6174928
DIP/AZIMUTH: 90°/--

PIT No: 1
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↗ Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 22
EASTING: 293550
NORTHING: 6174940
DIP/AZIMUTH: 90°/--

PIT No: 2
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
22		TOPSOIL - dark brown friable clay with some roots and rootlets, humid to damp										
	0.15	GRAVELLY CLAY - firm to stiff, dark brown friable gravelly (medium to coarse sandstone) clay with trace rootlets, humid to damp (COLLUVIUM)										
	0.55	CLAY - firm to stiff, orange brown mottled light to mid grey clay with some silt and trace rootlets, damp (RESIDUAL SOIL)		D	0.45							
					0.55							
					1.0		pp = 170-250kPa	1				
				D	1.1							
					1.6		pp = 190-270kPa					
				D	1.7							
		- becoming slightly fissured below 2.0m			2.1		pp = 170-250kPa	2				
				D	2.2							
	2.5	SANDSTONE - extremely low to very low strength, extremely to highly weathered, orange brown to light to mid grey fine grained sandstone		D	2.5							
					2.6							
		- with some extremely low strength bands below 3.0m			3.1			3				
				D	3.1							
	3.2	Pit discontinued at 3.2m (limit of investigation)			3.2							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

REMARKS:

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	Δ	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 34
EASTING: 292914
NORTHING: 6174806
DIP/AZIMUTH: 90°/--

PIT No: 3
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing			Water	Dynamic Penetrometer Test (blows per 150mm)					
				Type	Depth	Sample			Results & Comments				
34		TOPSOIL - grey brown clay with some roots and rootlets, humid											
	0.3	CLAY - very stiff, red brown fissured clay with trace rootlets, humid to damp (RESIDUAL SOIL)											
	0.7	TUFFACEOUS SANDSTONE - low to medium strength, moderately weathered, orange grey brown fine grained tuffaceous sandstone											
33	1												
	1.1	Pit discontinued at 1.1m (very slow progress on low to medium strength tuffaceous sandstone)											

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		⚡	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 293773
NORTHING: 6174780
DIP/AZIMUTH: 90°/--

PIT No: 4
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↕ Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 18
EASTING: 292641
NORTHING: 6174602
DIP/AZIMUTH: 90°/--

PIT No: 5
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
18.0		TOPSOIL - orange brown clayey silt with some roots and rootlets, humid										
	0.35	SANDY SILT - medium dense, orange brown sandy silt with trace rootlets, humid (ALLUVIAL)		D	0.5							
					0.6							
	0.7	CLAY - very stiff, brown fissured clay with trace rootlets, humid (ALLUVIAL)										
				D	1.0		pp > 600kPa					
					1.1							
				D	1.4		pp > 600kPa					
					1.5							
	1.9	SAND - orange brown slightly clayey fine to medium sand with some silt, humid (ALLUVIAL)		D	1.9		pp > 600kPa					
					2.0							
	2.3	SANDY CLAY - hard, orange brown sandy clay, humid to damp (ALLUVIAL)		D	2.4		pp = 470-500kPa					
					2.5							
	2.95	SAND - light to mid grey slightly gravelly (fine to coarse sandstone) medium to coarse sand with some silt, clay and cobbles, wet (ALLUVIAL)										
				D	3.2							
	3.5	Pit discontinued at 3.5m (limit of investigation)			3.5							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: Seepage below 2.9m

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 18
EASTING: 292884
NORTHING: 6174626
DIP/AZIMUTH: 90°/--

PIT No: 6
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
18		TOPSOIL - grey brown clay with some roots and rootlets, humid										
18	0.2	CLAY - very stiff to hard, grey brown fissured clay with trace rootlets, humid (ALLUVIAL)										
				D	0.5		pp > 600kPa					
					0.6							
17	1	- becoming slightly sand below 1.0m		D	1.0		pp > 600kPa	1				
					1.1							
				D	1.4		pp > 600kPa					
					1.5							
16	1.9	SAND - brown to orange grey fissured slightly clayey fine to medium sand, humid (ALLUVIAL)		D	1.9		pp > 600kPa					
					2.0			2				
		- becoming clayey sand below 2.4m		D	2.4		pp > 600kPa					
					2.5							
15	3	- becoming humid to damp below 2.9m										
				D	3.1		pp = 250-260kPa	3				
	3.2	Pit discontinued at 3.2m (limit of investigation)			3.2							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 293228
NORTHING: 6174644
DIP/AZIMUTH: 90°/--

PIT No: 7
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
14		TOPSOIL - dark brown clay with some roots and rootlets, damp										
0.5		CLAY - stiff, orange brown mottled grey fissured clay with some sand and silt with trace rootlets, humid (ALLUVIAL)		U	0.55		pp + 400-580kPa					
1		- becoming humid to damp below 1.0m		D	0.9		pp = 380-450kPa					
1.5		- becoming slightly sandy to sandy below 1.5m		D	1.5		pp = 250-400kPa					
2.1		SILTY SAND - orange brown mottled grey silty fine to medium sand with some clay, humid (ALLUVIAL)		D	2.1							
2.5		- moist to wet below 2.9m		D	2.5							
3.1		Pit discontinued at 3.1m (limit of investigation)		D	3.1							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: Seepage below 2.9m

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		⚡	Water level

CHECKED
Initials:
Date:







Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 11
EASTING: 293534
NORTHING: 6174656
DIP/AZIMUTH: 90°/--

PIT No: 8
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
11		TOPSOIL - dark brown friable clay with some roots and rootlets, humid to damp										
	0.3	CLAY - firm, orange grey brown fissured slightly sandy clay with trace rootlets, humid to damp (ALLUVIAL)		D	0.4		pp = 570-600kPa					
		- becoming very stiff below 0.6m			0.5							
		- becoming hard below 0.75m										
10	1.0	SANDY CLAY - very stiff, orange brown fissured sandy clay with some medium to coarse gravel and trace rootlets, humid (ALLUVIAL)		D	1.0		pp > 600kPa	1				
					1.1							
					1.5		pp > 600kPa					
				D	1.6							
9	1.9	SANDY CLAY - very stiff, orange brown mottled grey fissured sandy clay, humid to damp (ALLUVIAL)			2.1		pp = 410-420kPa	2				
8				D	2.2							
					2.5		pp = 150-190kPa					
		- becoming stiff and slightly sandy below 2.5m		D	2.6							
7					3.2		pp = 50-130kPa	3				
		- becoming firm to stiff below 3.2m		D	3.3							
	3.3	Pit discontinued at 3.3m (limit of investigation)			3.3							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: Free groundwater observed at 3.3m

☐ Sand Penetrometer AS1289.6.3.3

REMARKS:

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 10
EASTING: 293906
NORTHING: 6174564
DIP/AZIMUTH: 90°/--

PIT No: 9
PROJECT No: 48742
DATE: 13 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
10		TOPSOIL - brown silty clay with some rootlets and trace gravel (ironstone), humid		A	0.0							
	0.4	CLAY - firm to stiff, grey mottled brown slightly sandy clay, humid			0.3							
					0.5							
				D, A, B	0.7							
					1.0		pp > 600kPa	1				
				D, A	1.2							
					1.5							
				A	1.7							
					2.0		pp > 600kPa	2				
				D, A	2.2							
		- becoming very stiff, orange mottled grey clay with some organic content and gravel (ironstone) below 2.3m			2.5							
				A	2.7							
					2.9		pp = 410-460kPa	3				
				D, A	3.1							
	3.1	Pit discontinued at 3.1m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS: A = Potential acid sulphate soil sample

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 10
EASTING: 294128
NORTHING: 6174654
DIP/AZIMUTH: 90°/--

PIT No: 10
PROJECT No: 48742
DATE: 13 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
10		TOPSOIL - brown silty clay with some rootlets, humid		A	0.0							
	0.3	CLAY - stiff to very stiff, brown mottled grey slightly sandy clay, humid			0.3							
				A	0.5							
					0.7							
				U ₅₀								
1				D, A	1.1		pp > 600kPa	1				
					1.2							
					1.5							
				D, A	1.7							
					2.0		pp = 260-460kPa	2				
2					2.2							
	2.1	SANDY CLAY - stiff to very stiff, orange mottled grey sandy clay, damp		A								
					2.5							
				D, A	2.7							
					2.8		pp = 170-230kPa					
				A								
3					3.0			3				
	3.1	Pit discontinued at 3.1m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS: A = Potential acid sulphate soil sample

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:





Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 8
EASTING: 294295
NORTHING: 6174544
DIP/AZIMUTH: 90°/--

PIT No: 11
PROJECT No: 48742
DATE: 13 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown clay with some rootlets, humid		A	0.0							
	0.3	CLAY - stiff, brown mottled grey slightly sandy clay, humid			0.3							
					0.5		pp > 600kPa					
		- becoming damp below 0.7m		D, A	0.7							
					1.0		pp = 120-160kPa	1				
				D, A	1.2							
					1.5		pp = 190-210kPa					
				D, A	1.7							
		- becoming orange mottled grey and moist - wet below 1.8m			2.0		pp = 110-140kPa	2				
				D, A	2.2							
					2.5		pp = 90-170kPa					
				A	2.7							
					2.8							
				D, A	3.0							
	3.0	Pit discontinued at 3.0m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: Groundwater seepage observed at 2.8m

REMARKS: A = Potential acid sulphate soil sample

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 22
EASTING: 292348
NORTHING: 6174345
DIP/AZIMUTH: 90°/--

PIT No: 12
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
22		TOPSOIL - brown grey silty clay with some roots and rootlets and trace sand, humid to damp										
	0.35	CLAY - stiff, orange grey brown clay with trace sand and rootlets, humid to damp (ALLUVIAL)		B	0.5		pp = 250-320kPa					
					0.7							
	0.8	SANDY CLAY - stiff, orange brown mottled grey fissured sandy clay, humid to damp (ALLUVIAL)		U	0.75							
				D	1.0		pp = 380-590kPa	1				
					1.1							
				D	1.5		pp > 600kPa					
					1.6							
				D	2.0		pp > 600kPa	2				
					2.1							
	2.4	SILTY CLAY - very stiff, orange red brown mottled grey silty clay with some sand, humid to damp (ALLUVIAL)		D	2.5		pp = 390-510kPa					
					2.6							
		- becoming friable and slightly sandy below 2.8m										
				D	2.9							
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0			3				

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

REMARKS:

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 19
EASTING: 292533
NORTHING: 6174396
DIP/AZIMUTH: 90°/--

PIT No: 13
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
19		TOPSOIL - grey brown clay with some roots and rootlets, humid										
	0.2	CLAY - very stiff, orange brown clay with trace sand and rootlets, humid to damp (ALLUVIAL)										
				D	0.5		pp = 270-360kPa					
					0.6							
	0.7	CLAYEY SAND - dense, orange brown mottled light grey clayey medium to coarse sand with some silt, humid to damp (ALLUVIUM)										
		- becoming medium dense below 0.9m										
				D	1.0		pp = 340->600kPa					
					1.1							
	1.2	CLAY - stiff to very stiff, orange brown mottled light to mid grey clay with some sand and silt, humid to damp (ALLUVIUM)										
				D	1.4		pp = 480->600kPa					
					1.5							
		- becoming slightly sandy below 1.9m										
				D	2.0		pp = 150-210kPa					
					2.1							
				D	2.5		pp = 350-400kPa					
					2.6							
	2.8	SANDY CLAY/CLAYEY SAND - stiff, orange red brown mottled light grey sandy clay/clayey sand, damp with moist patches (ALLUVIUM)										
				D	2.9		pp = 80-240kPa					
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: Water inflow at 2.9m

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	SL Standard penetration test
U _s	Tube sample (x mm dia.)	PS Point load strength Is(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		≡ Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 16
EASTING: 292939
NORTHING: 6174357
DIP/AZIMUTH: 90°/--

PIT No: 14
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↕ Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 13
EASTING: 293211
NORTHING: 6174378
DIP/AZIMUTH: 90°/--

PIT No: 15
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
13.0		TOPSOIL - dark brown friable clay with some roots and rootlets, humid to damp										
	0.3	SANDY SILT - medium dense to dense, light brown grey sandy silt, humid (ALLUVIAL)		B	0.4							
	0.6	SANDY CLAY - very stiff, orange brown mottled grey fissured slightly sandy to sandy clay, humid (ALLUVIAL)			0.6							
					1.0		pp = 510->600kPa					
					1.1							
					1.4		pp > 600kPa					
					1.5							
					1.9		pp = 430-480kPa					
	1.9	CLAY - dark grey mottled orange brown clay, humid to damp (ALLUVIAL)		D	2.0							
					2.4		pp = 410-420kPa					
					2.5							
		- becoming slightly sandy below 2.9m			3.0							
	3.1	Pit discontinued at 3.1m (limit of investigation)		D	3.1							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:





Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 293529
NORTHING: 6174367
DIP/AZIMUTH: 90°/--

PIT No: 16
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
14		TOPSOIL - brown silty clay with some rootlets, humid										
	0.3	CLAY - very stiff to hard, orange mottled grey slightly sandy clay with trace gravel (ironstone), humid										
					0.5		pp = 400-480kPa					
				D								
					0.7							
					1.0		pp > 600kPa	1				
				D								
					1.2							
					1.5		pp > 600kPa					
				D								
					1.7							
					2.0		pp > 600kPa	2				
				D								
					2.2							
					2.5		pp = 480-590kPa					
				D								
					2.7							
	3.0	Pit discontinued at 3.0m (limit of investigation)						3				

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3
☐ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 293881
NORTHING: 6174312
DIP/AZIMUTH: 90°/--

PIT No: 17
PROJECT No: 48742
DATE: 13 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown slightly sandy silty clay with some rootlets and trace gravel (ironstone), humid		A	0.0							
	0.3	SANDY CLAY - stiff to very stiff, light brown sandy clay with some gravel (ironstone), humid			0.3							
				A	0.5							
	0.8	CLAY - very stiff, red mottled grey clay with some gravel (ironstone) and sand, humid		U ₅₀	0.7							
					0.9							
				D, A	1.0							
					1.2							
				D, A	1.5		pp = 250-400kPa					
					1.7							
	1.9	CLAY - hard, orange mottled grey slightly sandy clay with some gravel (ironstone, sandstone), humid			2.0							
				D, A	2.2							
					2.5		pp > 600kPa					
				A	2.7							
					2.9							
				D, A	3.1							
	3.1	Pit discontinued at 3.1m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS: A = Potential acid sulphate soil sample

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 12
EASTING: 294056
NORTHING: 6174171
DIP/AZIMUTH: 90°/--

PIT No: 18
PROJECT No: 48742
DATE: 13 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing			Water	Dynamic Penetrometer Test (blows per 150mm)					
				Type	Depth	Sample		Results & Comments	5	10	15	20	
12		TOPSOIL - brown silty sandy clay with some rootlets, humid		A	0.0								
0.3		CLAY - stiff, brown mottled orange and grey clay with some sand, humid			0.3								
				D, A	0.5		pp > 600kPa						
					0.7								
		- becoming grey sandy clay below 0.9m			1.0								
11	1			D	1.2								
					1.5		pp > 600kPa						
				D	1.7								
					2.0								
10	2			D	2.2								
					2.8								
9	3	Pit discontinued at 3.0m (limit of investigation)		D	3.0								

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS: A = Potential acid sulphate soil sample

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		⬇	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 6
EASTING: 294463
NORTHING: 6174297
DIP/AZIMUTH: 90°/--

PIT No: 19
PROJECT No: 48742
DATE: 13 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
	0.0	TOPSOIL - brown silty clay with some sand and rootlets, humid		A	0.0							
	0.2	CLAY - stiff, brown mottled orange and grey clay with some sand, humid			0.2							
					0.5		pp = 170-200kPa					
				A, D, B	0.7							
	0.9	CLAY - stiff, grey mottled red and orange clay, damp			1.0		pp = 130-150kPa	1				
				D, A	1.2							
					1.5		pp = 130-160kPa					
				D, A	1.7							
		- with some sand below 1.8m			2.0		pp = 170-200kPa	2				
				A	2.2							
					2.5		pp = 130-190kPa					
				D, A	2.7							
					2.8		pp = 180-200kPa					
				D								
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0			3				

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS: A = Potential acid sulphate soil sample

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 6
EASTING: 294580
NORTHING: 6174438
DIP/AZIMUTH: 90°/--

PIT No: 20
PROJECT No: 48742
DATE: 13 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
	0.1	TOPSOIL - brown silty sandy clay with some rootlets, humid			0.1							
		SAND - medium dense, light brown slightly clayey sand, humid		A	0.3							
	0.4	CLAY - stiff, brown mottled black and orange slightly sandy clay, humid			0.5		pp = 520-560kPa					
				A	0.7							
				U ₅₀	0.9							
					1.0		pp = 350-540kPa					
				D, A	1.2							
		- becoming damp to moist below 1.9m			2.0		pp = 120-220kPa					
				D, A	2.2							
					2.5		pp = 60-110kPa					
				A	2.7							
					3.3							
				D, A								
	3.5	Pit discontinued at 3.5m (limit of investigation)			3.5							

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS: A = Potential acid sulphate soil sample

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 24
EASTING: 292325
NORTHING: 6174051
DIP/AZIMUTH: 90°/--

PIT No: 21
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↕ Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 22
EASTING: 292723
NORTHING: 6174120
DIP/AZIMUTH: 90°/--

PIT No: 22
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		↕	Water level

CHECKED
Initials:
Date:







Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 20
EASTING: 292912
NORTHING: 6174054
DIP/AZIMUTH: 90°/--

PIT No: 23
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown silty clay with some roots and rootlets, humid to damp										
	0.45	CLAY - stiff, dark orange grey brown fissured clay with trace fine gravel (ironstone), humid to damp (RESIDUAL SOIL)		D	0.5		pp = 390-460kPa					
					0.6							
				D	0.9		pp > 600kPa					
					1.0							
				D	1.5		pp = 340-470kPa					
					1.6							
		SANDSTONE - extremely low to very low strength, extremely to highly weathered, orange brown to light grey fine grained sandstone		D	2.0		pp = 260-310kPa					
					2.1							
				D	2.4		pp = 250-310kPa					
					2.5							
	2.9	SANDSTONE - extremely low to very low strength, extremely to highly weathered, orange brown to light grey fine grained sandstone Pit discontinued at 3.0m (limit of investigation)		D	2.9							
	3.0				3.0							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 18
EASTING: 292911
NORTHING: 6174054
DIP/AZIMUTH: 90°/--

PIT No: 24
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
18		TOPSOIL - brown silty clay with some rootlets, humid										
	0.3	CLAY - very stiff to hard, brown clay with some gravel (ironstone), humid			0.5		pp = 410-480kPa					
				U ₅₀								
	0.9	CLAY - hard, brown mottled orange clay with some gravel (ironstone), humid			0.9							
17	1			D	1.0		pp > 600kPa	1				
					1.2							
				D	1.5		pp > 600kPa					
					1.7							
16	2							2				
				D	2.5							
					2.7							
15	2.8	Pit discontinued at 2.8m (limit of investigation)										
14	3							3				

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 16
EASTING: 293509
NORTHING: 6174096
DIP/AZIMUTH: 90°/--

PIT No: 25
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
16.0		TOPSOIL - dark brown silty clay with some roots and rootlets, damp										
	0.3	CLAY - stiff, red brown fissured clay with trace rootlets, damp (ALLUVIAL)										
				U	0.6		pp = 220-420kPa					
		- becoming red brown mottled grey below 0.9m			0.95							
	1.0			D	1.0		pp = 180->600kPa	1				
					1.1							
		- becoming slightly sandy, slightly silty clay below 1.5m			1.5		pp = 400-580kPa					
				D	1.6							
					2.0		pp = 330-500kPa	2				
				D	2.1							
					2.5		pp = 220-310kPa					
				D	2.6							
	3.0	SANDY CLAY - light grey mottled orange brown sandy clay/clayey sand, damp to moist (ALLUVIAL)										
					3.2							
				D	3.3							
	3.3	Pit discontinued at 3.3m (limit of investigation)										

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:










Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 16
EASTING: 293822
NORTHING: 6174011
DIP/AZIMUTH: 90°/--

PIT No: 26
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - dark brown silt with some roots and rootlets and trace sand, humid										
	0.45	CLAY - stiff, red brown fissured clay with trace rootlets, humid to damp (RESIDUAL SOIL)		D	0.5 0.6		pp = 390-530kPa					
	1	- becoming red brown mottled grey below 1.0m		D	1.0 1.1		pp > 600kPa	1				
	1.5	SANDY CLAY - light grey mottled yellow orange brown sandy clay with trace root remains, humid to damp (RESIDUAL SOIL)		D	1.6 1.7		pp > 600kPa					
	2			D	2.0 2.1		pp > 600kPa	2				
				D	2.4 2.5		pp = 430-560kPa					
	3			D	3.0		pp > 600kPa	3				
	3.1	Pit discontinued at 3.1m (limit of investigation)		D	3.1							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 294042
NORTHING: 6173950
DIP/AZIMUTH: 90°/--

PIT No: 27
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - dark brown friable slightly clayey silt with some roots and rootlets, humid										
	0.3	SANDY CLAY - stiff, orange red brown friable sandy clay with trace rootlets, humid to damp (RESIDUAL SOIL)		D	0.5							
	0.6				0.6							
	0.9	CLAY - stiff, red brown mottled light to mid grey clay with some sand, humid to damp (RESIDUAL SOIL)		D	1.0		pp = 360-420kPa	1				
					1.1							
		- becoming slightly sandy with medium to coarse gravel sized pockets of sand below 1.5m		D	1.6		pp = 350-420kPa					
					1.7							
	2.0	SANDY CLAY - red brown mottled light to mid grey sandy clay, humid to damp (RESIDUAL SOIL)		D	2.1		pp = 220-480kPa	2				
					2.2							
				D	2.5		pp = 430-540kPa					
					2.6							
	3.0	SANDSTONE - extremely low to very low strength, extremely to highly weathered, orange brown to grey fine to medium grained sandstone Pit discontinued at 3.1m (limit of investigation)						3				
	3.1											

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	Δ	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 36
EASTING: 293266
NORTHING: 6174025
DIP/AZIMUTH: 90°/--

PIT No: 28
PROJECT No: 48742
DATE: 12 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		FILLING - brown silty clay and coalwash gravel with some rootlets, humid										
	0.3	CLAY - firm to stiff, brown clay with trace sand, humid			0.4		pp = 250-350kPa					
				U ₅₀	0.8							
	0.9	CLAY - hard, grey mottled orange and red clay with some sand and gravel (ironstone), humid			1.0							
				D	1.2							
					1.5		pp > 600kPa					
				D	1.7							
		- becoming very stiff below 1.8m										
					2.5		pp = 280-410kPa					
				D	2.7							
	3.1	Pit discontinued at 3.1m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:














Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 34
EASTING: 292357
NORTHING: 6173774
DIP/AZIMUTH: 90°/--

PIT No: 29
PROJECT No: 48742
DATE: 12 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
34		TOPSOIL - brown silty clay with some rootlets, humid										
	0.4	CLAY - stiff, brown mottled red and black clay with some gravel (ironstone, latite), humid		D	0.5		pp = 440-510kPa					
	0.7	CLAY - very stiff, brown mottled orange clay, humid			0.7							
33	1			D	1.0		pp > 600kPa	1				
					1.2							
				D	1.5		pp = 310-410kPa					
					1.7							
	1.8	CLAY - very stiff to hard, brown mottled red and black clay with some gravel (latite), humid										
32	2			D	2.0		pp > 600kPa	2				
					2.2							
31	3							3				
	3.1	Pit discontinued at 3.1m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:







Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 30
EASTING: 292542
NORTHING: 6173751
DIP/AZIMUTH: 90°/--

PIT No: 30
PROJECT No: 48742
DATE: 12 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
30		TOPSOIL - brown silty clay with some rootlets and trace gravel (ironstone), humid										
	0.3	CLAY - stiff to very stiff, red mottled grey clay, humid			0.5		pp = 360-460kPa					
	0.9	CLAY - very stiff, grey mottled orange clay with trace sand, humid		U ₅₀	0.9							
				D	1.0		pp = 330-380kPa					
					1.2							
28	1.8	SANDSTONE - very low strength, extremely weathered, orange and grey sandstone			2.0							
				D	2.2							
					2.5							
				D	2.7							
		- becoming low strength below 2.7m										
27	3.0	Pit discontinued at 3.0m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 22
EASTING: 292943
NORTHING: 6173857
DIP/AZIMUTH: 90°/--

PIT No: 31
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
22		TOPSOIL - brown slightly silty clay with some rootlets, damp										
	0.4	CLAY - firm to stiff, brown mottled orange clay with trace gravel (sandstone), humid		D	0.5		pp = 200-300kPa					
					0.7							
21	1			D	1.0				1			
					1.2							
	1.5	CLAY - very stiff to hard, orange and white clay, humid										
					2.0		pp > 600kPa		2			
20	2			D	2.2							
					2.7							
				D								
	2.9	Pit discontinued at 2.9m (slow progress)			2.9							
19	3								3			

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 22
EASTING: 293527
NORTHING: 6173759
DIP/AZIMUTH: 90°/--

PIT No: 32
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
22.0		TOPSOIL - dark brown slightly silty clay with some roots and rootlets, humid to damp										
	0.3	CLAY - firm, orange brown clay with trace rootlets, humid to damp (RESIDUAL SOIL)										
		- becoming red brown mottled light grey below 0.8m		D	0.5		pp = 330-430kPa					
					0.6							
	1.0	- becoming stiff below 1.0m		D	1.0		pp = 170-250kPa	1				
					1.1							
	1.2	TUFFACEOUS SANDSTONE - very low to low strength, highly weathered, orange brown to white and grey fine grained tuffaceous sandstone with some extremely low strength bands										
				D	1.4		pp = 240-370kPa					
					1.5							
		- becoming low to medium strength below 1.7m		D	1.7							
	1.8	Pit discontinued at 1.8m (slow progress in low to medium strength tuffaceous sandstone)			1.8							
20.0	2							2				
18.0	3							3				

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

REMARKS:

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:





Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 18
EASTING: 293819
NORTHING: 6173711
DIP/AZIMUTH: 90°/--

PIT No: 33
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
18.0		TOPSOIL - dark brown slightly silty clay with some roots and rootlets, humid to damp										
	0.3	CLAY - stiff, grey mottled orange brown fissured clay with trace rootlets (RESIDUAL SOIL)										
				D	0.5		pp = 250-450kPa					
					0.6							
				D	1.0		pp = 330-370kPa	1				
					1.1							
		- becoming mid to dark grey mottled red brown below 1.5m		D	1.5		pp = 250-320kPa					
					1.6							
				D	2.0		pp = 370-430kPa	2				
					2.1							
				D	2.4		pp = 440-460kPa					
					2.5							
		- becoming light to mid grey mottled orange brown fissured slightly silty clay with some sand below 2.4m										
				D	2.9		pp = 470-570kPa					
					3.0							
15.0	3.0	Pit discontinued at 3.0m (limit of investigation)										

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

REMARKS:

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 64
EASTING: 293232
NORTHING: 6173475
DIP/AZIMUTH: 90°/--

PIT No: 34
PROJECT No: 48742
DATE: 12 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)
				Type	Depth	Sample	Results & Comments		
84		TOPSOIL - brown silty clay with some rootlets, humid							<div>5</div> <div>10</div> <div>15</div> <div>20</div>
	0.4	CLAY - very stiff to hard, brown mottled orange slightly sandy clay with trace gravel (ironstone), humid		U ₅₀	0.5				
					0.9				
83	1			D	1.0				
					1.2				
	1.5	SANDSTONE - very low strength, extremely weathered, orange and grey fine grained sandstone		D	1.5				
					1.7				
62	2								
					2.5				
	2.7	Pit discontinued at 2.7m (limit of investigation)		D	2.7				
61	3								

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		↕	Water level

CHECKED
Initials:
Date:






Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 48
EASTING: 292991
NORTHING: 6173472
DIP/AZIMUTH: 90°/--

PIT No: 35
PROJECT No: 48742
DATE: 12 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown silty clay with some rootlets, humid										
	0.4	CLAY - hard, brown mottled orange clay with trace gravel (ironstone) and sand, humid		D, B	0.5		pp > 600kPa					
					0.7							
	1			D	1.0							
	1.2	SILTSTONE - very low to low strength, extremely weathered, brown and orange siltstone		D	1.2							
					1.4							
	1.6	Pit discontinued at 1.6m (refusal on medium strength siltstone)			1.6							
	2											
	3											

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 58
EASTING: 292345
NORTHING: 6173504
DIP/AZIMUTH: 90°/--

PIT No: 36
PROJECT No: 48742
DATE: 12 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
38.0		TOPSOIL - brown silty gravelly (latite, siltstone) clay with some rootlets and cobbles (siltstone, latite), humid										
	0.2	GRAVELLY CLAY - stiff to very stiff, red brown gravelly (latite, siltstone) slightly sandy clay with some cobbles (latite, siltstone), humid										
					0.5							
				D, B	0.7							
					1.0							
37.0	-1	- gravel content increasing below 0.8m		D	1.2							
36.0	1.4	Pit discontinued at 1.4m (slow progress)										
35.0	-2											
34.0	-3											

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 34
EASTING: 292343
NORTHING: 6172271
DIP/AZIMUTH: 90°/--

PIT No: 37
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
34		TOPSOIL - brown silty clay with some rootlets, humid										
	0.3	CLAY - very stiff to hard, orange mottled grey clay with some gravel (ironstone, sandstone), humid			0.5							
	0.7	SANDSTONE - very low to low strength, moderately weathered, brown and grey sandstone		U ₅₀	0.8							
	0.9	Pit discontinued at 0.9m (refusal on medium strength sandstone)		D	0.9							
33	1											
32	2											
31	3											

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 32
EASTING: 292643
NORTHING: 6173484
DIP/AZIMUTH: 90°/--

PIT No: 38
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 28
EASTING: 293524
NORTHING: 6173470
DIP/AZIMUTH: 90°/--

PIT No: 39
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
28.0	0.15	TOPSOIL - grey brown friable clay with some roots and rootlets, humid to damp		U			pp = 210-320kPa pp = 250-370kPa					
		CLAY - firm, orange brown mottled grey clay with trace rootlets, humid to damp (RESIDUAL SOIL)										
		- becoming very stiff and fissured with some sand below 0.6m										
27.0	1.0	TUFFACEOUS SANDSTONE - extremely low to very low strength, extremely to highly weathered, orange brown to grey fine grained tuffaceous sandstone		D								
		- low to medium strength band between 1.2 - 1.3m										
26.0	2.0	Pit discontinued at 2.0m (slow progress in low strength tuffaceous sandstone)		D								
25.0	3.0											

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

REMARKS:

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:










Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 16
EASTING: 293922
NORTHING: 6173404
DIP/AZIMUTH: 90°/--

PIT No: 40
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
16.0		TOPSOIL - dark brown friable clay with some roots and rootlets, humid to damp										
	0.4	CLAY - firm, orange grey brown fissured clay with trace sand and rootlets, humid to damp (RESIDUAL SOIL)		D	0.5 0.6		pp = 540-580kPa					
	1.0	- becoming grey mottled orange brown below 1.0m		D	1.0 1.1		pp = 260-270kPa	1				
	1.4	- becoming light grey mottled orange brown fissured slightly silty clay below 1.5m		D	1.4 1.5		pp = 400-410kPa					
	2.0			D	2.0 2.1		pp = 500-570kPa	2				
	2.5			D	2.5 2.6		pp = 460->600kPa					
	3.1	- becoming dark grey mottled yellow orange brown clay with some medium gravel and damp below 2.7m		D	3.1 3.2		pp = 270-360kPa	3				
	3.2	Pit discontinued at 3.2m (limit of investigation)										

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 294103
NORTHING: 6173451
DIP/AZIMUTH: 90°/--

PIT No: 41
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
14.0		TOPSOIL - dark brown silty clay with some roots and rootlets, humid										
	0.4	CLAY - stiff, red brown mottled grey clay with trace rootlets, humid to damp (RESIDUAL SOIL)		Dx2	0.5 0.6		pp = 360-450kPa					
		- becoming very stiff below 0.7m										
	1.0	- becoming fissured below 1.0m		Dx2	1.0 1.1		pp > 600kPa	1				
	1.3	CLAYEY SAND - red brown mottled grey fissured slightly clayey to clayey medium sand, humid (RESIDUAL SOIL)		Dx2	1.4 1.5		pp > 600kPa					
	1.8	SILTY CLAY - light grey mottled orange red brown fissured silty clay, humid to damp (RESIDUAL SOIL)		Dx2	1.9 2.0		pp > 600kPa	2				
				Dx2	2.4 2.5		pp = 340-350kPa					
11.3	3.0	Pit discontinued at 3.0m (limit of investigation)						3				

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Dx2 = two disturbed samples

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 11
EASTING: 294446
NORTHING: 6173474
DIP/AZIMUTH: 90°/--

PIT No: 42
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
11		TOPSOIL - dark brown clayey silt with some roots and rootlets, humid to damp										
	0.25	SILTY SAND - medium dense, brown silty fine to medium sand with some clay and medium to coarse gravel sized pockets of clayey sand, humid (ALLUVIAL)										
				Dx2	0.5 0.6							
	0.8	SANDY CLAY - very stiff, red brown mottled grey sandy clay, humid to damp (ALLUVIAL)										
				Dx2	1.0 1.1							
				Dx2	1.5 1.6							
	1.7	SILTY CLAY - very stiff, light grey mottled orange brown silty clay with some sandy clay bands, humid to damp (ALLUVIAL)										
				Dx2	1.9 2.0		pp = 240-300kPa					
	2.5	SAND - red brown slightly clayey medium to coarse sand, humid to damp (ALLUVIAL)										
				Dx2	2.5 2.6							
	2.9	SANDY CLAY - light to mid grey slightly gravelly (medium to coarse sandstone) sandy clay, humid to damp (ALLUVIAL)										
				Dx2	3.1 3.2							
	3.2	Pit discontinued at 3.2m (limit of investigation)										

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Dx2 = two disturbed samples

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 72
EASTING: 292227
NORTHING: 6173340
DIP/AZIMUTH: 90°/--

PIT No: 43
PROJECT No: 48742
DATE: 12 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
72	0.0	TOPSOIL - brown silty clay with some rootlets and trace gravel (ironstone), humid										
71	0.2	CLAY - stiff to very stiff, brown mottled orange clay with some sand and trace gravel (sandstone), humid										
	0.4			U ₅₀			pp = 510-590kPa					
	0.8											
	1.0			D			pp = 450-600kPa					
	1.2											
	1.5			D			pp > 600kPa					
	1.7											
	2.0			D								
	2.2											
68	3.1	SANDSTONE - very low to low strength, extremely weathered, orange, brown and grey sandstone		D	3.1							
	3.3	Pit discontinued at 3.3m (limit of investigation)			3.3							

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		↕	Water level

CHECKED
Initials:
Date:







Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 70
EASTING: 292929
NORTHING: 6172889
DIP/AZIMUTH: 90°/--

PIT No: 44
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing			Water	Dynamic Penetrometer Test (blows per 150mm)								
				Type	Depth	Sample		Results & Comments	5	10	15	20				
70		TOPSOIL - brown silty clay with some rootlets and gravel (ironstone), humid														
	0.3	GRAVELLY CLAY - very stiff, brown slightly sandy gravelly (latite, sandstone) clay, humid					pp = 450-510kPa									
				D	0.5											
					0.7											
	0.8	CLAY - very stiff to hard, orange mottled grey slightly gravelly (latite, sandstone) clay with trace sand, humid					pp > 600kPa									
				D	1.0											
					1.2											
	1.4	LATITE - very low to low strength, extremely weathered, brown, orange and grey latite														
				D	1.6											
	1.8	Pit discontinued at 1.8m (refusal on medium strength latite)			1.8											
68	2															
67	3															

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↕ Water level

CHECKED
Initials:
Date:






Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 44
EASTING: 292624
NORTHING: 6173173
DIP/AZIMUTH: 90°/--

PIT No: 45
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing			Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample		Results & Comments	5	10	15
44		TOPSOIL - brown silty clay with some rootlets, humid									
	0.3	CLAY - stiff to very stiff, orange mottled grey clay with some gravel (siltstone), humid					pp > 600kPa				
				U ₅₀	0.5						
					0.9						
43	-1			D	1.0		pp > 600kPa	-1			
	1.2	SILTSTONE - very low to low strength, extremely weathered, brown and grey siltstone			1.2						
	1.4	Pit discontinued at 1.4m (refusal on medium strength siltstone)									

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		↕	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 45
EASTING: 293029
NORTHING: 6173263
DIP/AZIMUTH: 90°/--

PIT No: 46
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		↕	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 32
EASTING: 293633
NORTHING: 6173170
DIP/AZIMUTH: 90°/--

PIT No: 47
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		⚡	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 20
EASTING: 293828
NORTHING: 6173166
DIP/AZIMUTH: 90°/-

PIT No: 48
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
20		TOPSOIL - dark brown silty clay with some roots and rootlets, humid to damp										
	0.35	CLAY - stiff, dark grey mottled red brown fissured clay, humid to damp (RESIDUAL SOIL)		D	0.4		pp > 600kPa					
					0.5							
				U								
					0.9							
	1			Dx2	1.0		pp > 600kPa	1				
					1.1							
	1.2	SANDY CLAY - very stiff, light grey mottled orange brown slightly sandy to sandy clay, humid to damp (RESIDUAL SOIL)										
					1.6		pp = 570->600kPa					
				Dx2	1.7							
	1.9	CLAY - very stiff, dark brown grey fissured clay, humid to damp (RESIDUAL SOIL)										
	2			Dx2	2.0		pp = 300-420kPa	2				
					2.1							
					2.5		pp = 250-420kPa					
				Dx2	2.6							
					2.8		pp = 330-350kPa					
				Dx2	2.9							
	2.9	Pit discontinued at 2.9m (refusal on low to medium strength sandstone)										
	3											

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Dx2 = two disturbed samples

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 10
EASTING: 294094
NORTHING: 6173170
DIP/AZIMUTH: 90°/--

PIT No: 49
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown grey clay with some roots and rootlets, humid										
	0.3	CLAY - stiff, grey mottled orange brown fissured clay with trace rootlets, humid to damp (ALLUVIAL)										
				D B	0.5		pp = 240-430kPa					
					0.7							
	1			Dx2	1.0		pp = 580->600kPa	1				
					1.1							
		- becoming orange brown below 1.4m		Dx2	1.4		pp = 370-460kPa					
					1.5							
	2			Dx2	1.9		pp = 130-230kPa	2				
		- becoming orange brown mottled light grey slightly sandy clay below 1.9m			2.0							
	2.4	SAND - orange brown mottled light to mid grey fine to medium sand with some silt and clay, moist (ALLUVIAL)										
				Dx2	2.6							
					2.7							
		- becoming wet below 2.9m										
	3			Dx2	3.0			3				
	3.1	Pit discontinued at 3.1m (limit of investigation)			3.1							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: Seepage below 2.9m

REMARKS: Dx2 = two disturbed samples

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 10
EASTING: 294406
NORTHING: 6173166
DIP/AZIMUTH: 90°/--

PIT No: 50
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown clayey silt with some roots and rootlets, humid to damp										
	0.2	SILTY SAND - medium dense, brown silty fine sand, humid (ALLUVIAL)										
				Dx2	0.5							
					0.6							
	1.0	CLAY - stiff to very stiff, dark grey clay with some silt, humid to damp (ALLUVIAL)		Dx2	1.0		pp = 210-220kPa	1				
					1.1							
				Dx2	1.6		pp = 180-250kPa					
					1.7							
	2	- becoming light to mid grey mottled red brown below 2.0m		Dx2	2.1		pp = 250-300kPa	2				
					2.2							
		- becoming orange red brown mottled light grey below 2.3m		Dx2	2.4		pp = 140-160kPa					
					2.5							
		- with some moist pockets below 2.9m		Dx2	2.9		pp = 150-180kPa					
					3.0							
	3.0	Pit discontinued at 3.0m (limit of investigation)						3				

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Dx2 = two disturbed samples

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 64
EASTING: 292962
NORTHING: 6173038
DIP/AZIMUTH: 90°/--

PIT No: 51
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
64		TOPSOIL - brown slightly silty clay with some sand and rootlets, humid										
	0.3	CLAY - very stiff, grey mottled brown clay with some gravel (latite), humid			0.4		pp = 450-550kPa					
				U ₅₀								
					0.8							
					1.0							
				D								
		- gravel content increasing below 1.2m			1.2							
	1.4	LATITE -very low to low strength, extremely weathered, grey and brown latite										
	1.8	Pit discontinued at 1.8m (refusal on medium strength shale)										
62	2											
60	3											

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:





Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 78
EASTING: 293232
NORTHING: 6172884
DIP/AZIMUTH: 90°/--

PIT No: 52
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
78		TOPSOIL - brown slightly silty clay with trace gravel (latite), humid										
	0.3	CLAY - very stiff to hard, brown clay with some gravel (latite), humid		D	0.3		pp > 600kPa					
	0.5	Pit discontinued at 0.5m (refusal on high strength latite)			0.5							
77	1											
76	2											
75	3											

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 62
EASTING: 293229
NORTHING: 6173174
DIP/AZIMUTH: 90°/--

PIT No: 53
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown silty gravelly (latite) clay with some rootlets, humid										
	0.3	GRAVELLY CLAY - very stiff to hard, brown slightly silty gravelly (latite) clay with trace sand, humid										
					0.5		pp > 600kPa					
				D	0.7							
					1.0							
				D	1.2							
		- gravel content increasing below 1.2m			1.5							
				D	1.7							
	1.7	Pit discontinued at 1.7m (slow progress)			1.7							
	2											
	3											

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:






Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 40
EASTING: 293823
NORTHING: 6172869
DIP/AZIMUTH: 90°/--

PIT No: 54
PROJECT No: 48742
DATE: 11 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown slightly silty clay with some sand and rootlets, humid										
	0.3	CLAY - stiff, grey mottled orange clay, humid			0.5		pp = 410-430kPa					
	0.8	SANDSTONE - very low to low strength, moderately weathered, brown and grey sandstone		U ₅₀	0.8							
	1.0	Pit discontinued at 1.0m (refusal on medium strength sandstone)		D	1.0							
1												
2												
3												

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 12
EASTING: 294142
NORTHING: 6172953
DIP/AZIMUTH: 90°/--

PIT No: 55
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↗ Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 12
EASTING: 294143
NORTHING: 6172953
DIP/AZIMUTH: 90°/--

PIT No: 56
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown clayey silt with some roots and rootlets, humid to damp										
	0.35	CLAY - stiff, dark grey mottled orange brown clay with some silt and trace rootlets, humid to damp (ALLUVIAL)		Dx2	0.5		pp = 320-450kPa					
		- firm below 0.75m			0.6							
	1			Dx2	1.0		pp = 150-210kPa					
					1.1							
				Dx2	1.4		pp = 170-250kPa					
					1.5							
	1.7	CLAY - stiff to very stiff, red brown clay, humid to damp (ALLUVIAL)										
				Dx2	2.0		pp = 200-370kPa					
					2.1							
				Dx2	2.4		pp = 160-210kPa					
					2.5							
		- becoming stiff, red brown mottled light grey below 2.8m										
				Dx2	2.9		pp = 100-150kPa					
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Dx2 = two disturbed samples

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:







Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 42
EASTING: 292879
NORTHING: 6172146
DIP/AZIMUTH: 90°/--

PIT No: 57
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing			Water	Dynamic Penetrometer Test (blows per 150mm)					
				Type	Depth	Sample		Results & Comments	5	10	15	20	
42		TOPSOIL - brown silty clay with some gravel (sandstone, ironstone), humid											
	0.4	CLAY - hard, grey and brown clay with some gravel (sandstone), humid											
				D	0.5		pp > 600kPa						
					0.7								
41	1				1.0		pp > 600kPa	1					
				D	1.2								
	1.3	SANDSTONE - very low to low strength, extremely weathered, grey and orange sandstone			1.5								
				D	1.7								
		- becoming extremely low strength below 1.8m			2.0			2					
40	2			D	2.2								
	2.5	Pit discontinued at 2.5m (refusal on medium strength sandstone)											
39	3							3					

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↗ Water level

CHECKED
Initials:
Date:






Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 20
EASTING: 293514
NORTHING: 6172852
DIP/AZIMUTH: 90°/--

PIT No: 58
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
19.30		TOPSOIL - brown silty clay with some sand and rootlets, humid					pp > 600kPa					
19.03	0.3	CLAY - stiff, brown mottled orange clay with some gravel (siltstone), humid										
18.70	0.7	SILTSTONE - very low to low strength, extremely weathered, grey and orange siltstone										
18.10	1											
18.00	1											
17.80	1											
17.60	1											
17.40	1											
17.20	1											
17.00	1											
16.80	1											
16.60	1											
16.40	1											
16.20	1											
16.00	1											
15.80	1											
15.60	1											
15.40	1											
15.20	1											
15.00	1											
14.80	1											
14.60	1											
14.40	1											
14.20	1											
14.00	1											
13.80	1											
13.60	1											
13.40	1											
13.20	1											
13.00	1											
12.80	1											
12.60	1											
12.40	1											
12.20	1											
12.00	1											
11.80	1											
11.60	1											
11.40	1											
11.20	1											
11.00	1											
10.80	1											
10.60	1											
10.40	1											
10.20	1											
10.00	1											
9.80	1											
9.60	1											
9.40	1											
9.20	1											
9.00	1											
8.80	1											
8.60	1											
8.40	1											
8.20	1											
8.00	1											
7.80	1											
7.60	1											
7.40	1											
7.20	1											
7.00	1											
6.80	1											
6.60	1											
6.40	1											
6.20	1											
6.00	1											
5.80	1											
5.60	1											
5.40	1											
5.20	1											
5.00	1											
4.80	1											
4.60	1											
4.40	1											
4.20	1											
4.00	1											
3.80	1											
3.60	1											
3.40	1											
3.20	1											
3.00	1											
2.80	1											
2.60	1											
2.40	2											
2.20	2											
2.00	2											
1.80	2											
1.60	2											
1.40	2											
1.20	2											
1.00	2											
0.80	2											
0.60	2											
0.40	2											
0.20	2											
0.00	2											
19.30												
19.03	0.3											
18.70	0.7											
18.10	1											
18.00	1											
17.80	1											
17.60	1											
17.40	1											
17.20	1											
17.00	1											
16.80	1											
16.60	1											
16.40	1											
16.20	1											
16.00	1											
15.80	1											
15.60	1											
15.40	1											
15.20	1											
15.00	1											
14.80	1											
14.60	1											
14.40	1											
14.20	1											
14.00	1											
13.80	1											
13.60	1											
13.40	1											
13.20	1											
13.00	1											
12.80	1											
12.60	1											
12.40	1											
12.20	1											
12.00	1											
11.80	1											
11.60	1											
11.40	1											
11.20	1											
11.00	1											
10.80	1											
10.60	1											
10.40	1											
10.20	1											
10.00	1											
9.80	1											
9.60	1											
9.40	1											
9.20	1											
9.00	1											
8.80	1											
8.60	1											
8.40	1											
8.20	1											
8.00	1											
7.80	1											
7.60	1											
7.40	1											
7.20	1											
7.00	1											
6.80	1											
6.60	1											
6.40	1											
6.20	1											
6.00	1											
5.80	1											
5.60	1											
5.40	1											
5.20	1											
5.00	1											
4.80	1											
4.60	1											
4.40	1											
4.20	1											
4.00	1											
3.80	1											
3.60	1											
3.40	1											
3.20	1											
3.00	1											
2.80	1											
2.60	1											
2.40	2	Pit discontinued at 2.4m (slow progress)										
2.20	2											
2.00	2											
1.80	2											
1.60	2											
1.40	2											
1.20	2											
1.00	2											
0.80	2											
0.60	2											
0.40	2											
0.20	2											
0.00	2											
19.30												
19.03	0.3											
18.70	0.7											
18.10	1											
18.00	1											
17.80	1											
17.60	1											
17.40	1											
17.20	1											
17.00	1											
16.80	1											
16.60	1											
16.40	1											
16.20	1											
16.00	1											
15.80	1											
15.60	1											
15.40	1											
15.20	1											
15.00	1											
14.80	1											
14.60	1											
14.40	1											
14.20	1											
14.00	1											
13.80	1											
13.60	1											

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 12
EASTING: 293428
NORTHING: 6172495
DIP/AZIMUTH: 90°/--

PIT No: 59
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown slightly silty clay with some rootlets and trace sand, humid										
	0.5	SAND - loose to medium dense, brown fine to medium sand with trace gravel (ironstone) and silt, humid		D	0.5							
					0.7							
	1			D	1.0							
					1.2							
	1.4	SAND - loose to medium dense, orange brown fine to medium sand with trace clay and gravel (ironstone), humid		D	1.5							
					1.7							
	2											
				D	2.5							
					2.7							
	3.0	Pit discontinued at 3.0m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 294972
NORTHING: 6172506
DIP/AZIMUTH: 90°/--

PIT No: 60
PROJECT No: 48742
DATE: 13 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown silty clay with some rootlets		D	0.0							
	0.3	CLAY - very stiff to hard, brown clay with some silt			0.3							
				D	0.6							
				U ₅₀	0.7							
					1.0							
				D, D	1.2							
	1.5	CLAYEY SAND - medium dense, light brown clayey fine to medium grained sand		D, D	1.5							
	1.7	CLAY - very stiff to hard, brown slightly sandy clay			1.7							
				D	2.0							
					2.2							
				D, D	2.5		pp = 370-550kPa					
				D	2.8		pp > 600kPa					
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0							

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 294131
NORTHING: 6172514
DIP/AZIMUTH: 90°/--

PIT No: 61
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
14		TOPSOIL - grey clay with some silt, roots and rootlets, damp										
	0.3	CLAY - grey slightly silty clay with trace rootlets, humid to damp (ALLUVIAL)										
	0.6	SILTY SAND - orange brown silty fine to medium sand with trace rootlets, humid (ALLUVIAL)		D, D	0.5							
					0.6							
13	1			D, D	1.0							
					1.1							
		- becoming humid to damp below 1.3m										
				D, D	1.5		pp = 170-300kPa					
					1.6							
12	2			D, D	2.0							
					2.1							
		- with some clay below 2.4m										
				D, D	2.4							
					2.5							
					2.9							
11	3	Pit discontinued at 3.0m (limit of investigation)		D, D	3.0							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 36
EASTING: 292213
NORTHING: 6171527
DIP/AZIMUTH: 90°/--

PIT No: 62
PROJECT No: 48742
DATE: 09 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown slightly silty clay with some rootlets and trace gravel (latite), humid										
	0.3	CLAY - stiff, brown mottled orange slightly sandy clay with some gravel (latite), humid										
				D	0.5		pp = 200-270kPa					
					0.7							
	-1	- gravel content increasing below 0.9m with some cobbles (latite)		D	1.0							
		- becoming damp to moist below 1.2m			1.2							
				D	1.5							
					1.7							
	-2			D	2.0							
					2.2							
	2.6	Pit discontinued at 2.6m (limit of investigation)										
	-3											

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: Groundwater seepage at 2.0m

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 62
EASTING: 291586
NORTHING: 6172398
DIP/AZIMUTH: 90°/--

PIT No: 63
PROJECT No: 48742
DATE: 09 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
87		TOPSOIL - dark brown slightly silty clay with some rootlets, humid										
61	0.3	SANDY CLAY - stiff, red-brown sandy clay with trace gravel (sandstone), humid		D, B	0.5		pp = 310-450kPa					
					0.7							
					1.0	D			1			
					1.2							
	1.4	SANDSTONE - very low to low strength, slightly weathered, orange brown fine to medium grained sandstone		D	1.5							
	1.7	Pit discontinued at 1.7m (refusal on medium strength sandstone)			1.7							
60	2								2			
59	3								3			

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		↕	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 58
EASTING: 292091
NORTHING: 6172141
DIP/AZIMUTH: 90°/--

PIT No: 64
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↗ Water level

CHECKED
Initials:
Date:





Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 18
EASTING: 292600
NORTHING: 6172347
DIP/AZIMUTH: 90°/--

PIT No: 65
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
18.0		CLAY - firm, dark brown slightly sandy clay, moist										
					0.5		pp = 70-90kPa					
				D	0.7							
				U ₅₀	1.1							
17.1	1				1.1							
		CLAY - firm to stiff, grey mottled orange slightly sandy clay with some gravel (sandstone, latite), moist			1.5		pp = 50-90kPa					
				D	1.7							
		- becoming stiff below 1.8m										
16.2	2				2.5		pp = 110-150kPa					
				D	2.7							
15.3	3.0	Pit discontinued at 3.0m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: Groundwater seepage at 1.2m

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	Δ	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 18
EASTING: 293067
NORTHING: 6172340
DIP/AZIMUTH: 90°/--

PIT No: 66
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
18.0		TOPSOIL - brown silty clay with some gravel (ironstone) and rootlets, humid										
	0.3	CLAY - very stiff to hard, grey brown slightly silty clay, humid										
				D	0.5		pp = 510-600kPa					
					0.6							
	0.7	CLAY - very stiff to hard, brown mottled orange clay with some sand and gravel (ironstone), humid		U ₅₀								
					1.0							
				D								
					1.2							
					1.5							
				D								
					1.7							
					2.5							
				D								
					2.7							
15.0	3.0	Pit discontinued at 3.0m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

REMARKS:

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:








Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 12
EASTING: 293786
NORTHING: 6172357
DIP/AZIMUTH: 90°/--

PIT No: 67
PROJECT No: 48742
DATE: 13 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown silty clay with some rootlets		D	0.0							
	0.3	CLAYEY SAND - medium dense, brown clayey fine sand and silt			0.3							
					0.5							
				D, D, B	0.7							
					1.0							
	1.2	SANDY CLAY - very stiff to hard, brown mottled grey sandy clay			1.2							
					1.5		pp = 360-490kPa					
				D, D	1.7							
	1.8	SAND - loose, grey and brown medium to coarse sand with some silt and clay			2.0							
					2.2							
				D, D	2.5							
				D	2.7							
	2.7	SANDY CLAY - soft to firm, brown and grey sandy clay with some alluvial gravel, moist to wet			2.7							
					2.8		pp = 30-70kPa					
				D, D								
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0							

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 293922
NORTHING: 6172347
DIP/AZIMUTH: 90°/--

PIT No: 68
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - grey brown slightly silty clay with some roots and rootlets, humid										
	0.3	CLAY - very stiff, grey brown highly fissured silty clay with trace rootlets, humid (ALLUVIAL)		D, D	0.5 0.6							
	0.7	SILTY SAND - medium dense to dense, orange grey brown silty fine to medium sand, humid (ALLUVIAL)										
				D, D	1.0 1.1							
		- becoming slightly clayey below 1.8m		D, D	1.8 1.9							
		- becoming humid to damp below 2.4m		D, D	2.4 2.5							
	2.8	SANDY CLAY - stiff, red brown mottled light grey slightly sandy to sandy clay, damp (ALLUVIAL)										
				D, D	2.9		PP = 110-150kPa					
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 13
EASTING: 294051
NORTHING: 6172340
DIP/AZIMUTH: 90°/--

PIT No: 69
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown grey slightly silty clay with some roots and rootlets, humid										
	0.3	CLAY - stiff to very stiff, grey mottled brown highly fissured clay with some silt and trace rootlets, humid										
				D	0.5		pp = 580->600kPa					
					0.6							
	1.0	SANDY SILT - medium dense, orange brown sandy silt, humid (ALLUVIAL)		D	1.0							
					1.1							
					1.5							
				D	1.6							
					2.0							
				D	2.1							
	2.5	CLAY - firm to stiff, light to mid grey clay with some silt, damp (ALLUVIAL)										
				D	2.6		pp = 90-130kPa					
					2.7							
	2.8	SANDY CLAY - firm, grey mottled orange red brown slightly sandy to sandy clay, damp (ALLUVIAL)										
					3.0		pp = 80-90kPa					
	3.1	Pit discontinued at 3.1m (limit of investigation)										

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 28
EASTING: 293242
NORTHING: 6172285
DIP/AZIMUTH: 90°/--

PIT No: 70
PROJECT No: 48742
DATE: 09 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
28		TOPSOIL - brown silty clay with some rootlets, humid										
	0.4	CLAY - stiff, dark brown mottled red slightly sandy clay with some gravel (sandstone), humid		D, B	0.5							
					0.7							
27	1			D	1.0		pp = 570->600kPa	1				
					1.2							
				D	1.5		pp = 550-600kPa					
					1.7							
		- with some sand below 1.8m										
26	2							2				
		- becoming very stiff to hard below 2.4m										
				D	2.5		pp = 590-600kPa					
					2.7							
25	3							3				
	3.1	Pit discontinued at 3.1m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 26
EASTING: 293027
NORTHING: 6172584
DIP/AZIMUTH: 90°/--

PIT No: 71
PROJECT No: 48742
DATE: 09 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown silty clay with some rootlets, humid										
	0.3	- trace ceramic fragments observed within topsoil										
		CLAY - stiff, brown mottled orange clay with trace sand, humid										
					0.5		pp = 350-390kPa					
				D	0.7							
					1.0		pp = 550-600kPa					
	1.2	CLAY - very stiff to hard, brown and grey slightly sandy clay with some gravel (latite), humid		D	1.2							
					1.5		pp = 380-500kPa					
				D	1.7							
	1.7	CLAY - very stiff to hard, brown mottled orange clay with some gravel (latite) and trace sand, humid										
					2.5		pp = 400-600kPa					
				D	2.7							
		- gravel content increasing and becoming damp below 2.4m										
	3.0	Pit discontinued at 3.0m (limit of investigation)										

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 38
EASTING: 291795
NORTHING: 6172082
DIP/AZIMUTH: 90°/--

PIT No: 72
PROJECT No: 48742
DATE: 09 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Metal rod, some plastic at surface

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		↕	Water level

CHECKED
Initials:
Date:






Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 52
EASTING: 293219
NORTHING: 6173756
DIP/AZIMUTH: 90°/--

PIT No: 73
PROJECT No: 48742
DATE: 09 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
52.0		TOPSOIL - brown silty clay with some rootlets, humid										
	0.4	CLAY - stiff to very stiff, grey mottled orange slightly sandy clay, humid		D	0.5		pp = 150-210kPa					
					0.7							
51.0	1.0			D	1.0		pp = 190-210kPa	1				
	1.2	CLAY - very stiff to hard, yellow orange clay with some gravel (latite), humid			1.2							
				D	1.5		pp = 270-400kPa					
					1.7							
50.0	1.8	Pit discontinued at 1.8m (refusal on high strength latite)										
50.0	2.0											
50.0	3.0											

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:




Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 40
EASTING: 291496
NORTHING: 6171446
DIP/AZIMUTH: 90°/--

PIT No: 74
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)						
				Type	Depth	Sample	Results & Comments		5	10	15	20			
40	0.1	TOPSOIL - brown silty clay with some sand and rootlets, humid					pp = 170-290kPa								
		GRAVELLY CLAY - stiff to very stiff, orange and grey gravelly (latite) clay with some sand, humid													
		- gravel content increasing below 0.8m													
39	1														
	1.1	Pit discontinued at 1.1m (refusal on medium strength latite)													

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		↕	Water level

CHECKED
Initials:
Date:





Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 36
EASTING: 292541
NORTHING: 6172394
DIP/AZIMUTH: 90°/--

PIT No: 75
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing			Water	Dynamic Penetrometer Test (blows per 150mm)					
				Type	Depth	Sample		Results & Comments	5	10	15	20	
36		TOPSOIL - brown silty clay with some rootlets, humid											
	0.3	CLAY - stiff to very stiff, brown mottled orange slightly gravelly (sandstone) clay, humid											
				U ₅₀	0.5								
					0.7								
35	1				1.0		pp > 600kPa		1				
	1.1	Pit discontinued at 1.1m (refusal on medium strength sandstone)		D	1.1								

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength ls(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	▷	Water seep
		↕	Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 293580
NORTHING: 6172204
DIP/AZIMUTH: 90°/--

PIT No: 76
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
14.0		TOPSOIL - brown silty sand with some fine to medium gravel sized pockets of clay, roots and rootlets, humid to damp										
	0.3	SILTY SAND - medium dense, brown silty fine to medium sand with trace rootlets, humid to damp (ALLUVIUM)										
				B	0.5							
				D	0.6							
					0.7							
	0.8	SILTY CLAY - stiff, grey highly fissured silty clay, humid to damp (ALLUVIAL)										
13.0	1			Dx2	1.0			1				
					1.1							
	1.4	SILTY SAND - brown silty fine to medium sand, humid (ALLUVIAL)										
				Dx2	1.5							
					1.6							
				Dx2	1.9							
12.0	2				2.0			2				
		- becoming slightly clayey to clayey below 2.3m										
				Dx2	2.5							
					2.6							
				Dx2	2.9							
11.0	3	Pit discontinued at 3.0m (limit of investigation)			3.0			3				

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

REMARKS:

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 293728
NORTHING: 6172157
DIP/AZIMUTH: 90°/--

PIT No: 77
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - grey brown slightly silty clay with some roots and rootlets, humid										
	0.2	CLAY - stiff, grey mottled brown highly fissured slightly silty clay with trace rootlets, humid (ALLUVIAL)										
				D, D	0.5							
					0.6							
				D, D	1.0		pp > 600kPa					
					1.1							
				D, D	1.5		pp = 460->600kPa					
					1.6							
	1.9	CLAY - very stiff, light to mid grey mottled orange brown fissured clay with some silt, damp (ALLUVIAL)										
				D, D	2.0		pp = 320-480kPa					
					2.1							
				D, D	2.4		pp = 260-280kPa					
					2.5							
				D, D	2.9		pp = 260-410kPa					
					3.0							
	3.0	- with some sand below 2.9m										
		Pit discontinued at 3.0m (limit of investigation)										

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

REMARKS:

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 293945
NORTHING: 6172191
DIP/AZIMUTH: 90°/--

PIT No: 78
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - grey brown fissured slightly silty clay with some roots and rootlets, humid										
	0.2	SILTY SAND - medium dense, orange brown silty sand, humid (ALLUVIAL)										
				D, D	0.5							
					0.6							
	1			D, D	1.0							
					1.1							
	1.5	GRAVELLY CLAY - very stiff, light to mid grey medium to coarse gravelly (sandstone, ironstone) clay, damp (COLLUVIUM)		D, D	1.6		pp = 270-360kPa					
					1.7							
	2.0	CLAY - stiff to very stiff, light to mid grey clay with some gravel and trace sand, damp (RESIDUAL)		D, D	2.0		pp = 300-480kPa					
					2.1							
				D, D	2.4		pp = 260-270kPa					
					2.5							
				D, D	2.9		pp = 170-220kPa					
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:









Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 12
EASTING: 294105
NORTHING: 6172187
DIP/AZIMUTH: 90°/--

PIT No: 79
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown clayey silt with some roots and rootlets, humid										
	0.25	CLAY - very stiff, grey mottled brown friable silty clay with trace rootlets, humid (ALLUVIAL)										
				D	0.5		pp > 600kPa					
					0.6							
	0.8	CLAY - stiff to very stiff, grey mottled brown fissured clay, humid to damp (ALLUVIAL)										
				D	1.0		pp > 600kPa					
					1.1							
					1.4		pp = 450-570kPa					
		- becoming light grey mottled orange brown below 1.5m		D	1.5							
	1.8	SANDY CLAY - very stiff, orange red brown mottled light grey sandy clay with pockets of sand, humid to damp (ALLUVIAL)										
				D	1.9		pp = 390-550kPa					
					2.0							
					2.4		pp = 300-330kPa					
				D	2.5							
		- becoming stiff below 2.9m										
					3.1		pp = 130-170kPa					
	3.2	Pit discontinued at 3.2m (limit of investigation)		D	3.2							

RIG: New Holland LB110B - 450mm bucket


LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

REMARKS:

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
			Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 294291
NORTHING: 6172189
DIP/AZIMUTH: 90°/--

PIT No: 80
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↕ Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 293452
NORTHING: 6171987
DIP/AZIMUTH: 90°/--

PIT No: 81
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - grey brown slightly sandy clay with some silt, roots and rootlets, humid to damp										
	0.3	CLAYEY SILTY SAND - medium dense, brown slightly clayey to clayey silty fine to medium sand with trace rootlets (ALLUVIAL)		D, D	0.5 0.6							
	0.8	SILTY SAND - loose to medium dense, orange brown slightly silty to silty sand, humid (ALLUVIAL)		D, D	1.0 1.1							
		- becoming slightly clayey below 1.5m		D, D	1.5 1.6							
	2.0	SANDY CLAY - very stiff, orange red brown sandy clay with some silt, humid to damp (ALLUVIAL)		D, D	2.1 2.2		pp = 500->600kPa					
				D, D	2.4 2.5		pp = 470->600kPa					
					2.9		pp = 260-320kPa					
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 293552
NORTHING: 6172055
DIP/AZIMUTH: 90°/--

PIT No: 82
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown slightly clayey to clayey fine to medium sand with some silt, roots and rootlets, humid to damp										
	0.3	SILTY SAND - medium dense, brown silty fine to medium sand with trace rootlets, humid (ALLUVIAL)										
				D, D	0.5							
					0.6							
	0.8	SILTY CLAY - very stiff, grey mottled brown fissured silty clay, humid to damp (ALLUVIAL)										
				D, D	1.0		pp > 600kPa					
					1.1							
				D, D	1.5		pp = 420->600kPa					
					1.6							
				D, D	2.1		pp = 300kPa					
					2.2							
				D, D	2.4		pp > 600kPa					
					2.5							
	2.8	SANDY CLAY - hard, grey mottled orange brown sandy clay, humid to damp (ALLUVIUM)										
				D, D	2.9		pp = 420-580kPa					
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:







Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 15
EASTING: 293742
NORTHING: 6172038
DIP/AZIMUTH: 90°/--

PIT No: 83
PROJECT No: 48742
DATE: 10 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - mid to dark grey clay with some roots and rootlets, humid to damp										
	0.25	CLAY - very stiff, mid to dark grey heavily fissured slightly silty clay with trace rootlets, humid (ALLUVIAL)										
				D, D	0.5		pp = 230-530kPa					
					0.6							
				D, D	1.0		pp = 570->600kPa					
					1.1							
	1.4	CLAY - hard, grey mottled orange brown fissured clay, humid to damp (ALLUVIAL)										
				D, D	1.6		pp = 520-540kPa					
					1.7							
				D, D	1.9		pp = 470-530kPa					
					2.0							
				D, D	2.4		pp = 430-460kPa					
					2.5							
		- with some silt below 2.5m										
	2.8	SILTY CLAY - grey mottled red brown silty clay, humid to damp (ALLUVIAL)										
				D, D	2.9		pp = 220-270kPa					
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0							

RIG: New Holland LB110B - 450mm bucket

LOGGED: RJH

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 24
EASTING: 291670
NORTHING: 6171553
DIP/AZIMUTH: 90°/--

PIT No: 84
PROJECT No: 48742
DATE: 09 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
24		TOPSOIL - brown silty clay with some rootlets, humid										
	0.3	SAND - medium dense, brown slightly clayey fine to medium grained sand, humid			0.5							
				D	0.7							
	0.9	CLAY - firm to stiff, grey mottled orange brown slightly sandy clay with trace gravel (sandstone), humid			1.0		pp = 70-120kPa	1				
				D	1.2							
					1.5		pp = 180-240kPa					
				D	1.7							
		- becoming very stiff below 1.8m										
	2.0				2.0		pp = 310-370kPa	2				
				D	2.2							
	2.6	SANDY CLAY - variable firm to very stiff, orange and grey sandy clay with some gravel (sandstone), humid			2.8		pp = 260-410kPa					
				D								
	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0			3				

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

REMARKS:

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:







Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: -
EASTING: 292049
NORTHING: 6171685
DIP/AZIMUTH: 90°/--

PIT No: 85
PROJECT No: 48742
DATE: 13 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown silty clay with some rootlets, humid		A	0.0							
	0.3	SILTY CLAY - stiff, brown silty clay with some sand, humid		D, A	0.2		pp > 600kPa					
	0.9	CLAY - very stiff to hard, brown mottled orange clay with some gravel (sandstone, latite) and sand, humid		D, A	0.5		pp > 600kPa					
1					0.7							
					1.0							
					1.2							
					1.5							
					1.7							
2		- becoming gravelly (sandstone, latite) clay and moist below 1.9m		A	2.0							
					2.2							
					2.5							
	2.7	Pit discontinued at 2.7m (slow progress)		D, A	2.7							
3												

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS: A = Potential acid sulphate soil sample

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: -
EASTING: 292079
NORTHING: 6171963
DIP/AZIMUTH: 90°/--

PIT No: 86
PROJECT No: 48742
DATE: 13 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)
				Type	Depth	Sample	Results & Comments		
		TOPSOIL - brown silty clay with some rootlets, humid		A	0.0				
	0.2	GRAVELLY CLAY - hard, brown red and black gravelly (latite, siltstone) clay, humid			0.2				
				A	0.5		pp > 600kPa		
				U ₅₀	0.7				
					0.9				
	1			D	1.0				
					1.2				
				D	1.5		pp > 600kPa		
					1.7				
	2								
					2.4				
	2.6	Pit discontinued at 2.6m (limit of investigation)		D	2.6				
	3								

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS: A = Potential acid sulphate soil sample

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 27
EASTING: 291613
NORTHING: 6171977
DIP/AZIMUTH: 90°/--

PIT No: 87
PROJECT No: 48742
DATE: 09 Nov 09
SHEET 1 OF 1

[illegible]

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↕ Water level

CHECKED
Initials:
Date:






Douglas Partners
Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: 18
EASTING: 291459
NORTHING: 6171699
DIP/AZIMUTH: 90°/--

PIT No: 88
PROJECT No: 48742
DATE: 09 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
18.0		TOPSOIL - brown silty clay with some sand and rootlets, humid										
	0.3	CLAY - very stiff, dark brown slightly sandy clay with some silt and gravel (ironstone), humid										
				D	0.5		pp = 450-550kPa					
					0.7							
	0.9	SAND - loose, brown fine to medium slightly clayey fine to medium grained sand with some gravel (ironstone), humid										
				D	1.0				1			
					1.2							
					1.5							
				D	1.7							
					2.0							
				D	2.2				2			
	2.2	SAND - loose, orange brown slightly clayey medium to coarse grained sand with some gravel (ironstone, sandstone), humid										
					2.8							
				D	3.0							
	3.0	Pit discontinued at 3.0m (limit of investigation)							3			

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

REMARKS:

☐ Sand Penetrometer AS1289.6.3.3
☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:





Douglas Partners
 Geotechnics • Environment • Groundwater

TEST PIT LOG

CLIENT: Delfin Lend Lease
PROJECT: Proposed Urban Development
LOCATION: Calderwood

SURFACE LEVEL: -
EASTING: 292888
NORTHING: 6172755
DIP/AZIMUTH: 90°/--

PIT No: 89
PROJECT No: 48742
DATE: 09 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Dynamic Penetrometer Test (blows per 150mm)			
				Type	Depth	Sample	Results & Comments		5	10	15	20
		TOPSOIL - brown silty clay with some rootlets, humid										
	0.4	CLAY - stiff, grey mottled brown slightly sandy clay, humid										
				D	0.5		pp = 180-240kPa					
					0.7							
	1			D	1.0		pp = 300-380kPa	1				
		- becoming very stiff below 1.2m			1.2							
				D	1.5		pp = 310-390kPa					
					1.7							
	2	- extremely low strength sandstone band at 1.8-2.3m		D	2.0			2				
					2.2							
		- becoming gravelly (sandstone) clay below 2.6m										
					2.8		pp = 350-410kPa					
				D								
3	3.0	Pit discontinued at 3.0m (limit of investigation)			3.0			3				

RIG: New Holland LB110B backhoe - 450mm bucket

LOGGED: AAW

WATER OBSERVATIONS: No free groundwater observed

☐ Sand Penetrometer AS1289.6.3.3

REMARKS:

☒ Cone Penetrometer AS1289.6.3.2

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED
Initials:
Date:









Douglas Partners
 Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 16
EASTING: 293421
NORTHING: 6172019
DIP/AZIMUTH: 90°/--

BORE No: 101
PROJECT No: 48742
DATE: 02 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
16	0.15	TOPSOIL - dark brown clay with some roots and rootlets, humid								
		CLAY - firm, dark brown clay with some sand and silt with trace rootlets, humid to damp								
15	1			S	1.0		2,2,3 N = 5			
					1.45					
14	2	- becoming soft to firm below 2.0m		S	2.0		2,2,2 N = 4			
					2.45					
13	3	- becoming firm, grey mottled orange brown slightly sandy clay below 3.0m (ALLUVIUM)		S	3.0		2,3,4 N = 7			
					3.45					
12	3.5	SANDY CLAY - firm, grey mottled orange brown sandy clay, humid to damp (ALLUVIUM)								
11	4									
				S	4.5		3,3,2 N = 5			
10	4.7	SAND - very loose, orange brown fine to medium grained sand with some silt, humid (ALLUVIUM)								
					4.95					
9	6.0	SANDY CLAY - very stiff, slightly gravelly (medium to coarse sandstone) sandy clay, wet (RESIDUAL SOIL)		S	6.0		7,9/110mm,- refusal			
		- becoming firm to stiff below 6.42m			6.24					
8	6.72	TUFFACEOUS SANDSTONE - extremely low to very low strength, extremely to highly weathered, orange brown tuffaceous sandstone								
		- becoming very low to low strength below 7.24m								
7	8.57	Bore discontinued at 8.57m (refusal on low to medium strength sandstone)								

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: RJH

CASING: -

TYPE OF BORING: SFA (v-bit) to 7.24m, SFA (TC-bit) to 8.57m

WATER OBSERVATIONS: Free groundwater observed at 6.0m, at 6.2m after 30 minutes

REMARKS: No well installed

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED

Initials:

Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 16
EASTING: 293324
NORTHING: 6172066
DIP/AZIMUTH: 90°/--

BORE No: 102
PROJECT No: 48742
DATE: 02 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
16	0.2	TOPSOIL - brown clay with some roots and rootlets, humid		S	1.0		2,2,3 N = 5		backfill	
15	1	CLAY - firm, dark orange brown grey clay with trace sand and rootlets, humid to damp (ALLUVIUM)			1.45				bentonite	
14	2.1	SAND - very loose, orange brown fine to medium sand with some silt, humid (ALLUVIUM)		S	2.0		2,1,1 N = 2			
13	3	- becoming very loose to loose, fine to coarse grained sand with some silt and trace medium to coarse gravel (quartz) below 3.0m			2.45				case	
12	4			S	3.0		2,2,3 N = 5			
11	5	- becoming loose below 4.5m			3.45					
10	6.0			S	4.5		3,3,3 N = 6		sand	
9	6.15	CLAYEY SAND - medium dense, orange brown to grey slightly gravelly (medium to coarse sandstone) clayey fine to coarse grained sand, damp (RESIDUAL SOIL)			4.95					
8	7	TUFFACEOUS SANDSTONE - extremely low to very low strength, extremely to highly weathered, orange brown tuffaceous sandstone		S	6.0		3,16,- refusal		screen	
7	8.27	- becoming very low to low strength below 8.20m Bore discontinued at 8.27m (refusal on low to medium strength sandstone)			6.3					
6	9									

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: RJH

CASING: -

TYPE OF BORING: SFA (v-bit) to 8.20m, SFA (TC-bit) to 8.27m

WATER OBSERVATIONS: Free groundwater observed at 6.0m

REMARKS: Water level dipped 4/12/09

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	Δ	Water seep
		▽	Water level

CHECKED

Initials:

Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 16
EASTING: 294590
NORTHING: 6174429
DIP/AZIMUTH: 90°/--

BORE No: 103
PROJECT No: 48742
DATE: 25 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
16		SILTY SAND - brown silty fine grained sand, humid							bentonite	
15	1									
14	1.6	CLAY - stiff to very stiff, dark grey clay with some silt, humid							case	
13	2									
12	3	- becoming damp to moist								
11	4.0	SILTY CLAY - stiff, light grey silty clay, moist to wet							sand	
10	5	- saturated							screen	
9	6									
8	6.4	SILTSTONE								
7	6.48	Bore discontinued at 6.48m (TC-bit refusal)								
6	7									
5	8									
4	9									

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: CCK

CASING: -

TYPE OF BORING: 140mm SFA

WATER OBSERVATIONS: Free groundwater observed at 4.5m

REMARKS: Water level dipped 4/12/09

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED

Initials:

Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 16
EASTING: 293216
NORTHING: 6173922
DIP/AZIMUTH: 90°/--

BORE No: 104
PROJECT No: 48742
DATE: 25 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
16.0	0.1	TOPSOIL - brown silt topsoil								
		CLAY - firm, brown clay with some roots and trace gravel								
15.7	0.7	SILTSTONE - extremely low strength, moderately weathered, light grey siltstone								
15.0	1									
14.0	2	- becoming dark grey								
13.0	3	- becoming light grey								
12.0	3.0	Bore discontinued at 3.0m (slow progress in shale)								
11.0	4									
10.0	5									
9.0	6									
8.0	7									
7.0	8									
6.0	9									

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: CCK

CASING: -

TYPE OF BORING: 140mm SFA

WATER OBSERVATIONS: No free groundwater observed

REMARKS: No well installed due to dry conditions and shallow rock.

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED

Initials:

Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 14
EASTING: 293220
NORTHING: 6174104
DIP/AZIMUTH: 90°/--

BORE No: 105
PROJECT No: 48742
DATE: 25 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
	0.3	TOPSOIL - brown clayey silt with some rootlets							case	
	1.1	SILTY CLAY - dark brown silty clay, humid - with some gravel							backfill	
	2.0	SILTY SAND - light brown/yellow silty sand with some sandstone gravel, humid							bentonite	
	2.6	SILTY SANDY CLAY - light brown silty sandy clay with some sandstone gravel, damp								
	3.0	CLAY - light grey clay with trace silt, damp to moist								
	4.0	CLAY - yellow brown clay with some sand and quartz gravel, wet							sand	
	5.0	SILTSTONE - low strength, extremely weathered siltstone							screen	
	5.48	Bore discontinued at 5.48m (slow progress in siltstone)								
	6.0									
	7.0									
	8.0									
	9.0									

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: CCK

CASING: -

TYPE OF BORING: 140mm SFA

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Water level dipped 4/12/09

SAMPLING & IN SITU TESTING LEGEND			
A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	Δ	Water seep
		▽	Water level

CHECKED
Initials:
Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 10
EASTING: 294387
NORTHING: 6173297
DIP/AZIMUTH: 90°/--

BORE No: 106
PROJECT No: 48742
DATE: 25 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
10		TOPSOIL - brown clay and silt with some rootlets								
0.4		CLAY - very stiff, dark grey clay, humid								
1.1		CLAY - very stiff, brown clay, damp								
2		- becoming moist								
3.4		SILTY CLAY - firm, yellow brown silty clay, moist								
4		- saturated								
6		- with some fine grained sand								
7		- with some gravel								
8.2		Bore discontinued at 8.2m (refusal on rock/gravel)								
9										

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: CCK

CASING: -

TYPE OF BORING: 140mm SFA

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Water level dipped 4/12/09

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED

Initials:

Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 10
EASTING: 294150
NORTHING: 6173129
DIP/AZIMUTH: 90°/--

BORE No: 107
PROJECT No: 48742
DATE: 25 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
10		TOPSOIL - brown silty clay topsoil with some rootlets								
0.7		CLAY - stiff, brown clay, humid								
1									1	backfill
1.6		CLAY - stiff, yellow brown clay, damp								
2									2	bentonite
3		- with some silt and trace fine grained sand								
3		- becoming moist							3	case
4									4	
4		- becoming saturated								
5									5	sand
6									6	screen
7									7	
7.7		Bore discontinued at 7.7m (target depth reached)								
8									8	
9									9	

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: CCK

CASING: -

TYPE OF BORING: 140mm SFA

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Water level dipped 4/12/09

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED

Initials:

Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 19
EASTING: 292585
NORTHING: 6174410
DIP/AZIMUTH: 90°/--

BORE No: 108
PROJECT No: 48742
DATE: 26 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
19.0	0.2	TOPSOIL - brown clayey silt							backfill	
	0.5	CLAYEY SILT - light grey clayey silt, humid							bentonite	
		CLAY - firm, grey mottled yellow clay, damp								
18.0	1								case	
17.0	2									
	2.3	CLAY - firm, brown clay, damp to moist								
	2.7	CLAY - yellow brown clay with trace sand and gravel, moist								
16.0	3								sand	
	4	- sand content increasing, becoming saturated							screen	
15.0	5	- gravel content increasing								
14.0	5.5	SANDSTONE - low strength, extremely weathered sandstone								
13.0	5.65	Bore discontinued at 5.65m (target depth reached)								
12.0	6									
11.0	7									
10.0	8									
9.0	9									

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: CCK

CASING: -

TYPE OF BORING: 140mm SFA

WATER OBSERVATIONS: Free groundwater observed at 2.0m after installing piezometer

REMARKS: Water level dipped 4/12/09

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED

Initials:

Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 21
EASTING: 292990
NORTHING: 6172385
DIP/AZIMUTH: 90°/--

BORE No: 109
PROJECT No: 48742
DATE: 26 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
21		TOPSOIL - brown silty sandy clay topsoil							backfill	
0.25	CLAYEY GRAVEL - medium dense, 10mm sandstone gravel in a clay matrix, humid									
1										
20	1									
19	1.8	GRAVELLY CLAY - brown sandstone gravelly clay with some sand, humid (weathered rock)							2	sand
18	3								3	screen
17	3.9	SANDSTONE							4	
16	4.0	Bore discontinued at 4.0m (slow progress in weathered rock)								
15	5								5	
14	6								6	
13	7								7	
12	8								8	
11	9								9	

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: CCK

CASING: -

TYPE OF BORING: 140mm SFA

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Water level dipped 4/12/09

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↕ Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 10
EASTING: 294108
NORTHING: 6172194
DIP/AZIMUTH: 90°/--

BORE No: 110
PROJECT No: 48742
DATE: 26 Nov 09
SHEET 1 OF 1

[illegible]

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: CCK

CASING: -

TYPE OF BORING: 140mm SFA

WATER OBSERVATIONS: Free groundwater observed at 1.4m after piezometer installation

REMARKS: Water level dipped 4/12/09

SAMPLING & IN SITU TESTING LEGEND		
A	Auger sample	pp Pocket penetrometer (kPa)
D	Disturbed sample	PID Photo ionisation detector
B	Bulk sample	S Standard penetration test
U	Tube sample (x mm dia.)	PL Point load strength ls(50) MPa
W	Water sample	V Shear Vane (kPa)
C	Core drilling	▷ Water seep
		↕ Water level

CHECKED
Initials:
Date:



Douglas Partners
Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 13
EASTING: 293593
NORTHING: 6172311
DIP/AZIMUTH: 90°/--

BORE No: 111
PROJECT No: 48742
DATE: 25 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
13		SILT - loose, brown silt with trace sand, humid								
		- gravel bands (quartz)								
		- with some sand								
12	1.0	SAND - loose to medium dense, brown medium grained sand with some silt						1		
11	2							2		
10	3							3		
	3.3	SAND AND CLAY - fine grained sand and brown clay with trace fine gravel, moist to wet								
9	4	- becoming saturated						4		
8	5	- gravel bands						5		
	5.4									
	5.5	SANDSTONE - extremely weathered, extremely low strength sandstone								
7	6	Bore discontinued at 5.5m (slow progress in sandstone)						6		
6	7							7		
5	8							8		
4	9							9		

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: CCK

CASING: -

TYPE OF BORING: 140mm SFA

WATER OBSERVATIONS: No free groundwater observed

REMARKS: No well installed, gravel collapse at 1.5m and 3.0m

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED

Initials:

Date:



Douglas Partners
 Geotechnics • Environment • Groundwater

BOREHOLE LOG

CLIENT: Delfin Lend Lease
PROJECT: Master Planning Geotechnical Study
LOCATION: Calderwood

SURFACE LEVEL: 12
EASTING: 293623
NORTHING: 6172339
DIP/AZIMUTH: 90°/--

BORE No: 112
PROJECT No: 48742
DATE: 26 Nov 09
SHEET 1 OF 1

RL	Depth (m)	Description of Strata	Graphic Log	Sampling & In Situ Testing				Water	Well Construction Details	
				Type	Depth	Sample	Results & Comments			
12.0	0.3	TOPSOIL - loose, brown silt with trace sand, humid								
		SAND - loose, brown medium grained sand with some silt								
	1								backfill	
									case	
									bentonite	
	2	- gravel bands								
	3	- becoming wet								
	4	- becoming saturated								
	5									
	5.5	Bore discontinued at 5.5m (target depth reached)							screen	
	6									
	7									
	8									
	9									

RIG: Gemco 210B

DRILLER: Paul Boers

LOGGED: CCK

CASING: -

TYPE OF BORING: 140mm SFA

WATER OBSERVATIONS: No free groundwater observed

REMARKS: Water level dipped 4/12/09

SAMPLING & IN SITU TESTING LEGEND

A	Auger sample	pp	Pocket penetrometer (kPa)
D	Disturbed sample	PID	Photo ionisation detector
B	Bulk sample	S	Standard penetration test
U	Tube sample (x mm dia.)	PL	Point load strength Is(50) MPa
W	Water sample	V	Shear Vane (kPa)
C	Core drilling	>	Water seep
		≡	Water level

CHECKED

Initials:

Date:



Douglas Partners
 Geotechnics • Environment • Groundwater


APPENDIX C

Laboratory Results



RESULT OF CALIFORNIA BEARING RATIO TEST

Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Planning Geotech Study	Report No. :	UL09-218N
Location :	Calderwood	Report Date :	4/12/2009
Test Location :	9	Date Sampled :	9-13/11/2009
Depth / Layer :	0.5 - 0.7m	Date of Test:	30/11/2009
		Page:	1 of 1

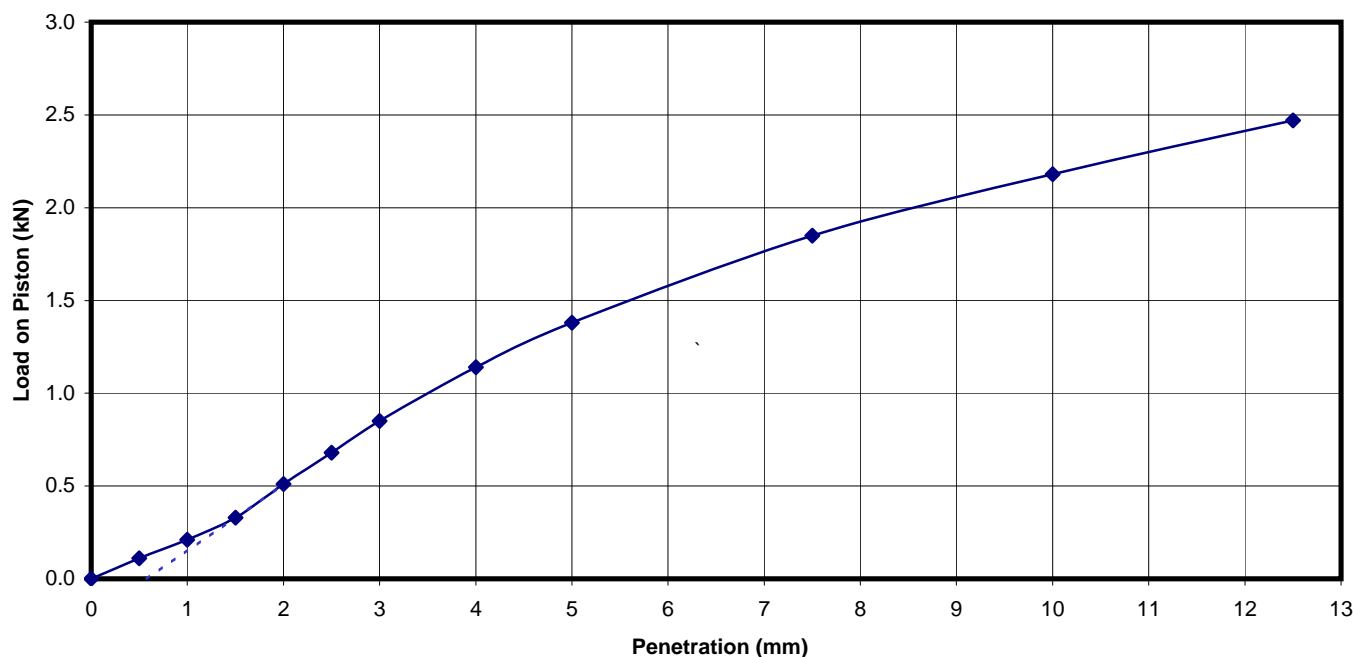

Description: Brown silty clay

Test Method(s): AS 1289.6.1.1, AS 1289.2.1.1

Sampling Method(s): Sampled by Wollongong Engineering Department

Percentage > 19mm: 0.0%

LEVEL OF COMPACTION: 100% of STD MDD
MOISTURE RATIO: 100% of STD OMC

SURCHARGE: 4.5 kg
SOAKING PERIOD: 4 days

SWELL: 1.5%

CONDITION	MOISTURE CONTENT %	DRY DENSITY t/m ³
At compaction	24.4	1.49
After soaking	28.4	1.47
After test		
Top 30mm of sample	30.5	-
Remainder of sample	26.6	-
Field values	21.7	-
Standard Compaction	24.4	1.49

RESULTS		
TYPE	PENETRATION	CBR (%)
TOP	2.5 mm	7
	5.0 mm	8

Approved Signatory:


Tested: JB, TZ
Checked: DE

David Evans
Laboratory Manager



RESULT OF CALIFORNIA BEARING RATIO TEST

Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Planning Geotech Study	Report No. :	UL09-2180
Location :	Calderwood	Report Date :	4/12/2009
Test Location :	35	Date Sampled :	9-13/11/2009
Depth / Layer :	0.5 - 0.7m	Date of Test:	30/11/2009
		Page:	1 of 1

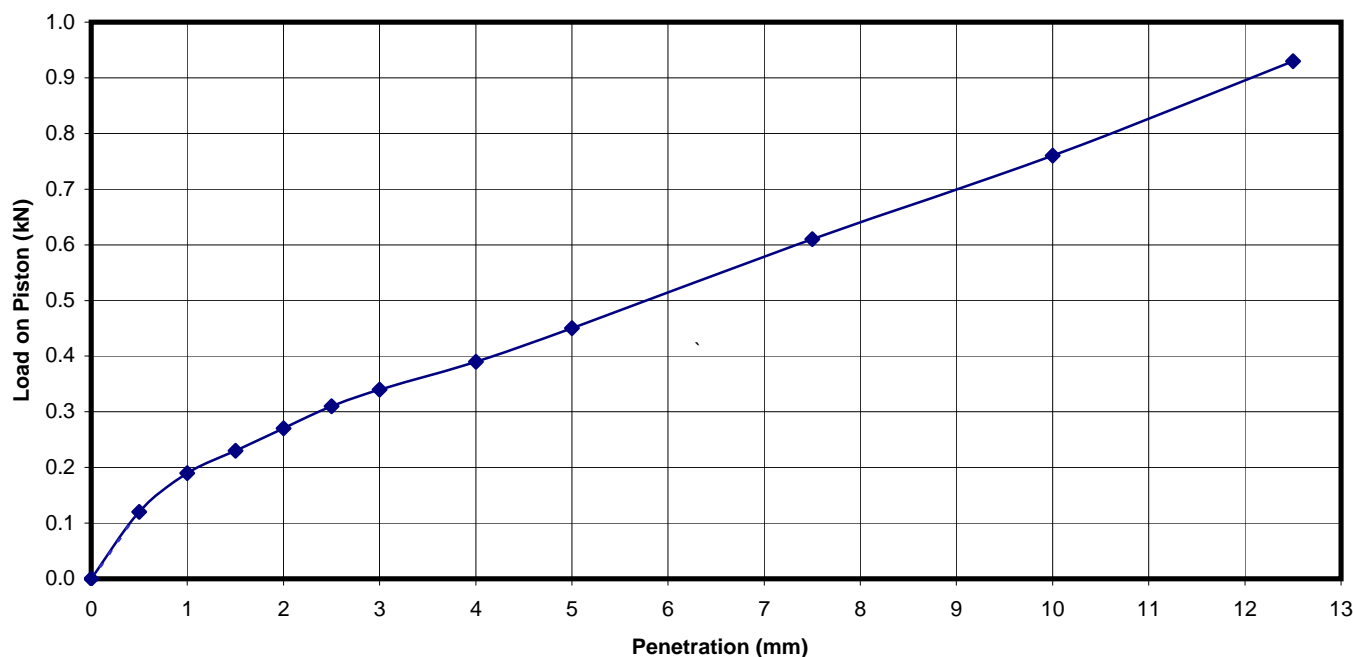

Description: Light brown silty clay

Test Method(s): AS 1289.6.1.1, AS 1289.2.1.1

Sampling Method(s): Sampled by Wollongong Engineering Department

Percentage > 19mm: 0.0%

LEVEL OF COMPACTION: 100% of STD MDD

SURCHARGE: 4.5 kg

SWELL: 3.3%

MOISTURE RATIO: 98% of STD OMC

SOAKING PERIOD: 4 days

CONDITION	MOISTURE CONTENT %	DRY DENSITY t/m ³
At compaction	23.2	1.58
After soaking	26.8	1.53
After test		
Top 30mm of sample	33.0	-
Remainder of sample	24.2	-
Field values	21.2	-
Standard Compaction	23.6	1.57

RESULTS		
TYPE	PENETRATION	CBR (%)
TOP	2.5 mm	2.5
	5.0 mm	2.5

Approved Signatory:


Tested:	JB, TZ
Checked:	DE

David Evans
Laboratory Manager



RESULT OF CALIFORNIA BEARING RATIO TEST

Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Planning Geotech Study	Report No. :	UL09-218P
Location :	Calderwood	Report Date :	4/12/2009
Test Location :	70	Date Sampled :	9-13/11/2009
Depth / Layer :	0.5 - 0.7m	Date of Test:	30/11/2009
		Page:	1 of 1

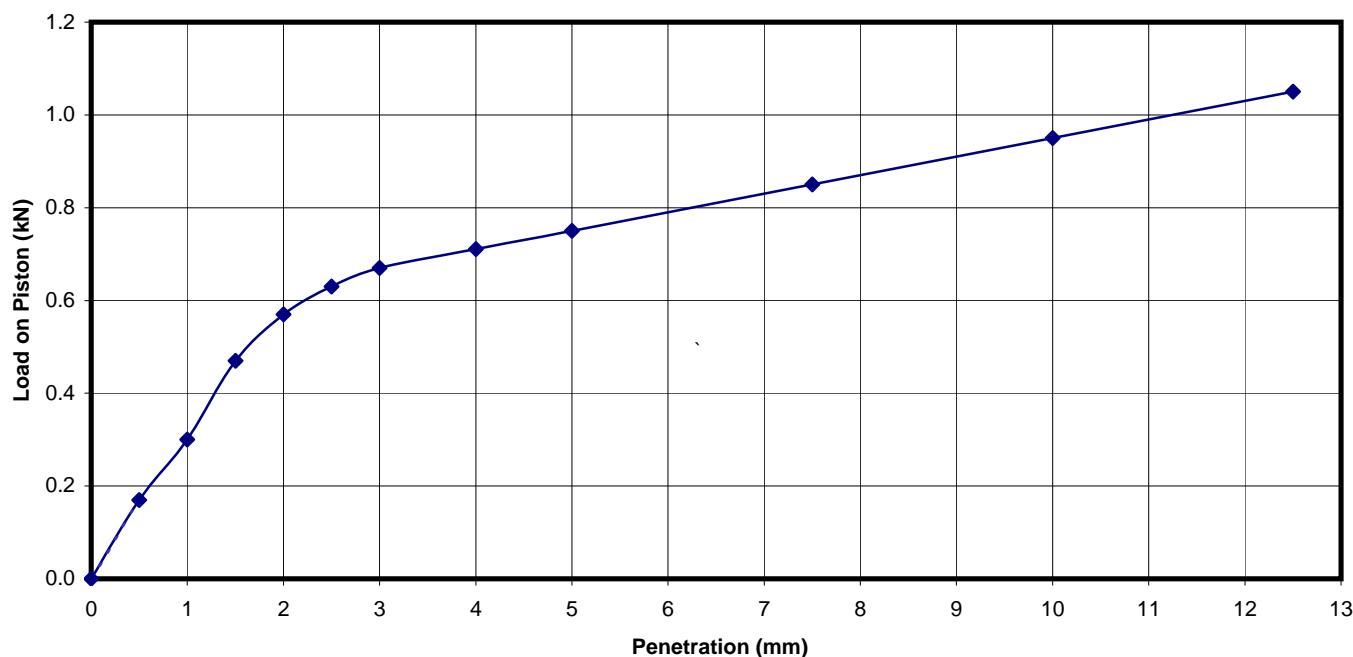

Description: Brown silty clay

Test Method(s): AS 1289.6.1.1, AS 1289.2.1.1

Sampling Method(s): Sampled by Wollongong Engineering Department

Percentage > 19mm: 0.0%

LEVEL OF COMPACTION: 101% of STD MDD

SURCHARGE: 4.5 kg

SWELL: 2.0%

MOISTURE RATIO: 98% of STD OMC

SOAKING PERIOD: 4 days

CONDITION	MOISTURE CONTENT %	DRY DENSITY t/m ³
At compaction	36.2	1.30
After soaking	40.1	1.28
After test		
Top 30mm of sample	42.1	-
Remainder of sample	38.8	-
Field values	32.8	-
Standard Compaction	36.8	1.30

RESULTS		
TYPE	PENETRATION	CBR (%)
TOP	2.5 mm	5.0
	5.0 mm	4.0

Approved Signatory:

Tested: JB, TZ

Checked: DE

David Evans
Laboratory Manager



RESULTS OF COMPACTION TEST

Client : DELFIN LEND LEASE

Project : Master Planning Geotech Study

Location : Calderwood

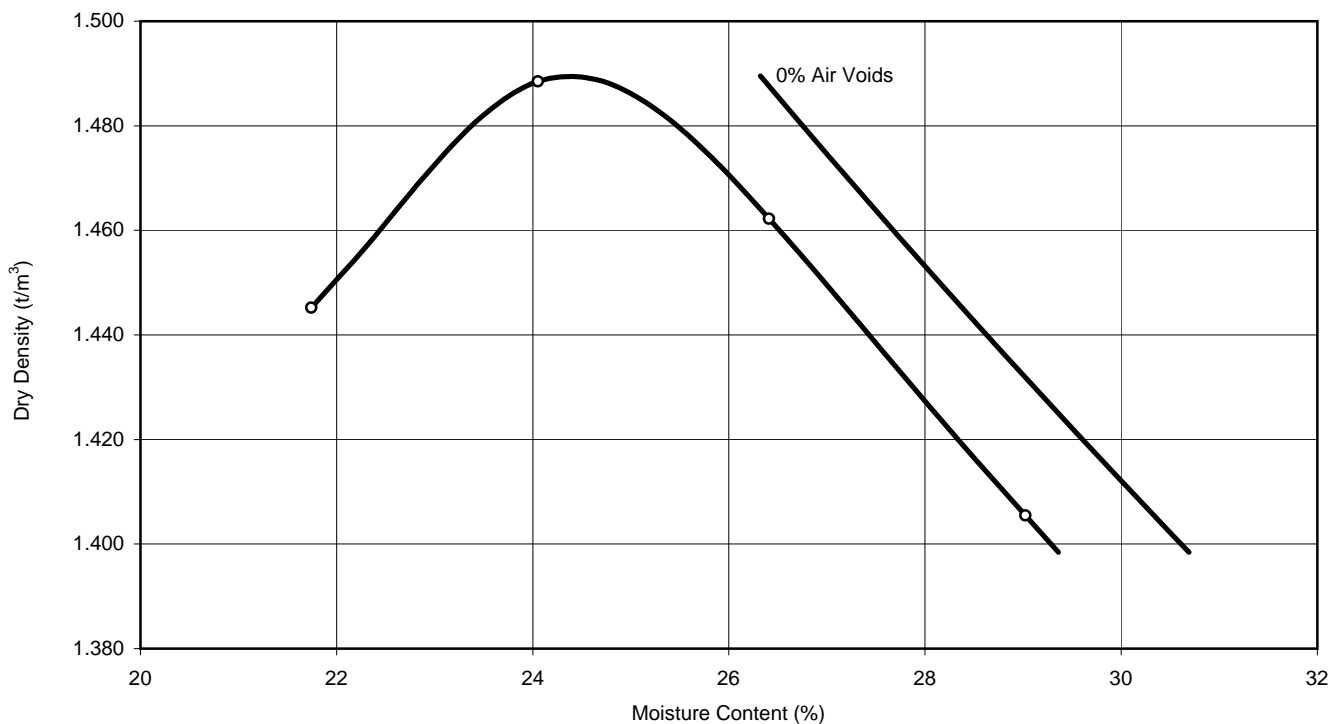
Project No. : 48742

Report No. : UL09-218Q

Report Date : 4/12/2009

Date of Test: 23/11/2009

Page: 1 of 1



Sample Details Location: 9

Depth: 0.5 - 0.7m

Particles > 19mm: 0%

Description: Brown silty clay

Maximum Dry Density: 1.49 t/m³

Optimum Moisture Content: 24.5 %

Remarks: -

Test Methods: AS 1289.2.1.1, AS 1289. 5.1.1, AS 1289.5.2.1

Sampling Methods: Sampled by Wollongong Engineering Department

Approved Signatory:

Tested:	JB
Checked:	DE

David Evans
Laboratory Manager



RESULTS OF COMPACTION TEST

Client : DELFIN LEND LEASE

Project : Master Planning Geotech Study

Location : Calderwood

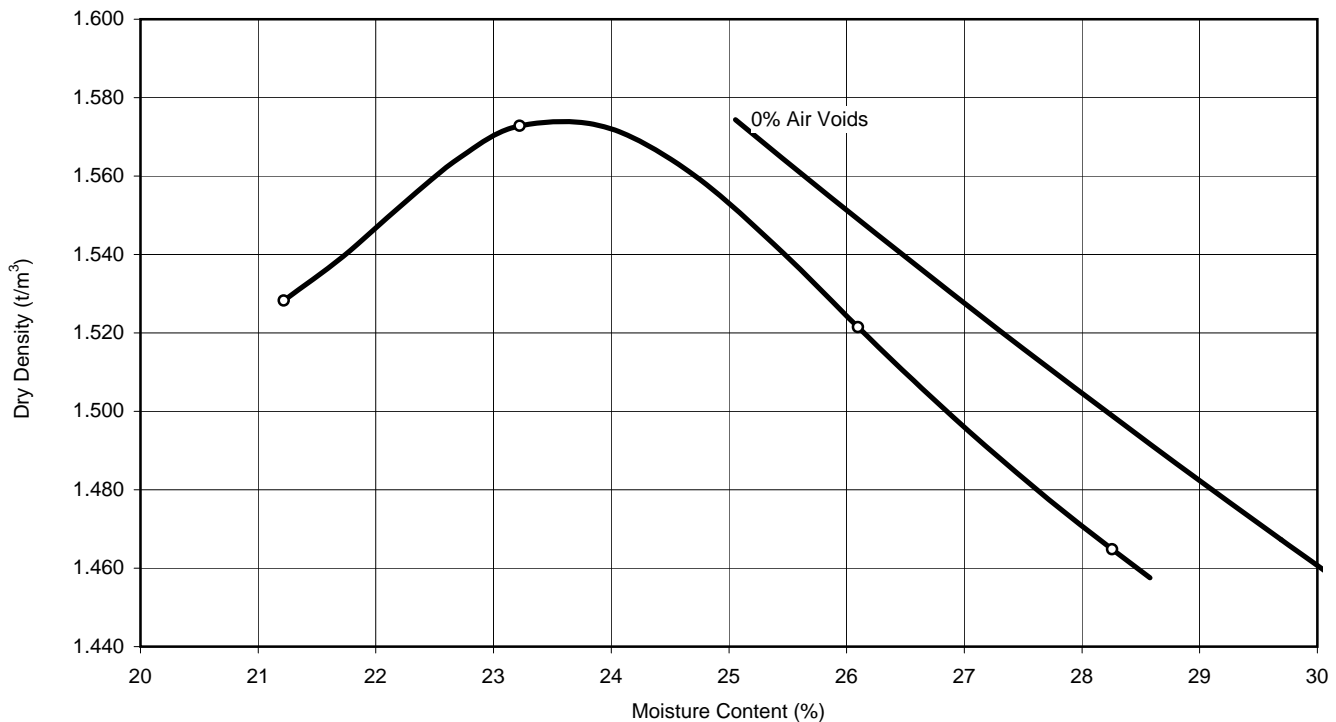
Project No. : 48742

Report No. : UL09-218R

Report Date : 4/12/2009

Date of Test: 23/11/2009

Page: 1 of 1



Sample Details **Location:** 35
 Depth: 0.5 - 0.7m

Particles > 19mm: 0%

Description: Light brown silty clay

Maximum Dry Density:	1.57 t/m³
Optimum Moisture Content:	23.5 %

Remarks: -

Test Methods: AS 1289.2.1.1, AS 1289. 5.1.1, AS 1289.5.2.1

Sampling Methods: Sampled by Wollongong Engineering Department

Approved Signatory:


Tested:	JB
Checked:	DE

David Evans
Laboratory Manager



RESULTS OF COMPACTION TEST

Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Planning Geotech Study	Report No. :	UL09-218S
Location :	Calderwood	Report Date :	4/12/2009
		Date of Test:	23/11/2009
		Page:	1 of 1

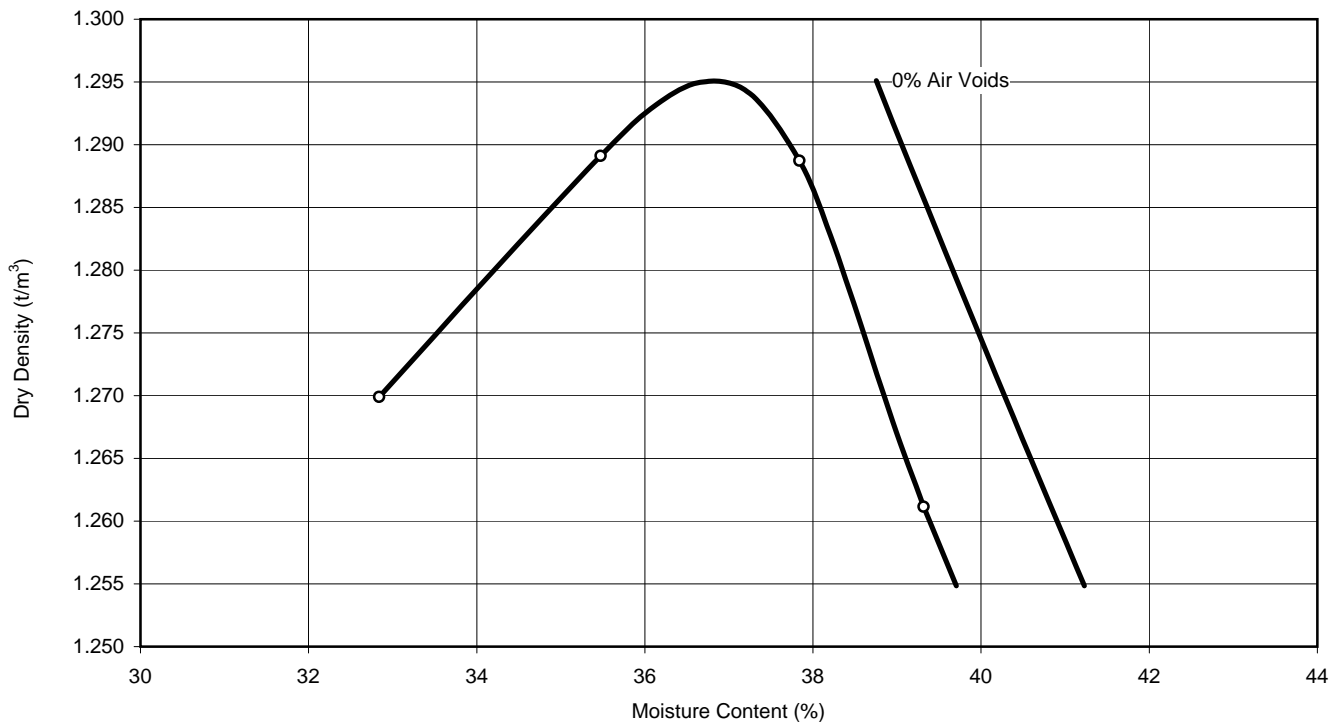

Sample Details **Location:** 70
Depth: 0.5 - 0.7m

Particles > 19mm: 0%

Description: Brown silty clay

Maximum Dry Density:	1.30 t/m³
Optimum Moisture Content:	37.0 %

Remarks: -

Test Methods: AS 1289.2.1.1, AS 1289. 5.1.1, AS 1289.5.2.1

Sampling Methods: Sampled by Wollongong Engineering Department



NATA Accredited Laboratory Number: 828
This Document is issued in accordance with NATA's accreditation requirements.
Accredited for compliance with ISO/IEC 17025

Approved Signatory:

Tested:	JB
Checked:	DE

David Evans
Laboratory Manager



DETERMINATION OF EMERSON CLASS NUMBER OF SOIL

Client:	DELFIN LEND LEASE	Project No:	48742
Project:	Master Planning Geotech Study	Report No:	UL09-218A
		Report Date:	3/12/2009
Location:	Calderwood	Date of Test:	23/11/2009
		Page:	1 of 1

SAMPLE NO	DEPTH (m)	DESCRIPTION	WATER TYPE	WATER TEMP	CLASS NO.
39	0.9 - 1.0	Brown silty clay	Distilled	22°	4
40	0.5 - 0.6	Brown silty clay	Distilled	22°	4
47	0.4 - 0.6	Brown clay	Distilled	22°	4
22	0.5 - 0.6	Brown silty clay	Distilled	22°	4
31	0.5 - 0.7	Brown sandy silty clay	Distilled	22°	4
38	1.0 - 1.2	Brown clay	Distilled	22°	4
43	1.0 - 1.2	Brown silty clay	Distilled	22°	4
46	0.5 - 0.7	Brown clay	Distilled	22°	4
52	0.3 - 0.5	Brown gravelly silty clay	Distilled	22°	4
62	1.5 - 1.7	Brown gravelly silty clay	Distilled	22°	4
71	1.0 - 1.2	Brown silty clay	Distilled	22°	4
65	0.5 - 0.7	Dark brown gravelly silty sandy clay	Distilled	22°	4
88	0.5 - 0.7	Brown sandy clayey silt	Distilled	22°	4

Test Method(s): AS 1289 3.8.1

Sampling Method(s): Sampled by Wollongong Engineering Department

Remarks:

Approved Signatory:



NATA Accredited Laboratory Number: 828

This Document is issued in accordance with
NATA's accreditation requirements.
Accredited for compliance with ISO/IEC 17025

Tested: TZ
Checked: TZ

David Evans
Laboratory Manager



RESULTS OF MOISTURE CONTENT TEST

Client:	DELFIN LEND LEASE	Project No:	48742
Project:	Master Planning Geotech Study	Report No:	UL09-218T
		Report Date:	4/12/2009
Location:	Calderwood	Date Sampled:	9-13/11/2009
		Date of Test:	20/11/2009
		Page:	1 of 2

TEST LOCATION	DEPTH (m)	DESCRIPTION	MOISTURE CONTENT (%)
40	0.5 - 0.6	Brown silty clay	28.0
41	1.0 - 1.1	Brown red grey silty clay	27.8
43	1.0 - 1.2	Brown silty clay	22.4
46	0.5 - 0.7	Brown clay	24.9
47	0.4 - 0.6	Brown clay	26.3
48	1.0 - 1.1	Brown red clay	22.1
52	0.3 - 0.5	Brown gravelly silty clay	19.6
53	0.5 - 0.7	Brown gravelly silty clay	21.5
55	2.0 - 2.2	Brown silty clay	29.3
58	1.0 - 1.2	Light brown silty clay	20.9
64	0.5 - 0.7	Light brown gravelly sandy clay	11.7
62	1.5 - 1.7	Brown gravelly silty clay	22.5
71	1.0 - 1.2	Brown silty clay	16.9
74	0.5 - 0.7	Brown gravelly silty clay	22.7
87	0.5 - 0.7	Orange brown silty clay	26.1
84	1.5 - 1.7	Brown gravelly silty clay	20.4
85	0.5 - 0.7	Brown clayey silt	16.4
3	1.0 - 1.2	Brown orange silty clay	31.8
14	2.4 - 2.5	Brown clayey silty sand	11.9
18	1.0 - 1.2	Light brown gravelly silty clay	17.1
89	0.5 - 0.7	Brown silty clay	34.6
6	1.0 - 1.1	Brown clayey silty sand	11.5
16	0.5 - 0.7	Brown orange grey sandy clay	17.3
23	0.9 - 1.0	Brown clay	37.1
30	1.0 - 1.2	Light brown silty clay	26.3
51	1.0 - 1.2	Brown clay	37.3
33	1.0 - 1.1	Brown clay	39.4
22	0.5 - 0.6	Brown silty clay	37.8
32	0.5 - 0.6	Brown silty clay	27.0
44	1.0 - 1.2	Brown clay	28.3
19	0.5 - 0.7	Brown clayey silt	17.7

Test Method(s): AS 1289.2.1.1, .2.1.2, .2.1.4, .2.1.5

Sampling Method(s): Sampled by Wollongong Engineering Department

Remarks:



NATA Accredited Laboratory Number: 828

This Document is issued in accordance with
NATA's Accreditation requirements.
Accredited for compliance with ISO/IEC 17025

Approved Signatory:

Tested: TZ
Checked: TZ

Dave Evans
Laboratory Manager



RESULTS OF MOISTURE CONTENT TEST

Client: DELFIN LEND LEASE		Project No: 48742	
Project: Master Planning Geotech Study		Report No: UL09-218T	
		Report Date: 4/12/2009	
Location: Calderwood		Date Sampled: 9-13/11/2009	
		Date of Test: 20/11/2009	
		Page: 2 of 2	
TEST LOCATION	DEPTH (m)	DESCRIPTION	MOISTURE CONTENT (%)
24	1.0 - 1.2	Brown silty clay	18.1
25	1.0 - 1.1	Orange brown silty clay	21.6
27	0.5 - 0.6	Brown sandy clay	12.9
28	1.0 - 1.2	Brown sandy silty clay	25.4
49	0.5 - 0.7	Brown silty clay	22.6
38	1.0 - 1.2	Brown clay	30.5
9	0.9 - 1.0	Brown silty clay	24.0

Test Method(s): AS 1289.2.1.1, .2.1.2, .2.1.4, .2.1.5

Sampling Method(s): Sampled by Wollongong Engineering Department

Remarks:

Approved Signatory:

Tested: TZ

Checked: TZ

Dave Evans
Laboratory Manager



NATA Accredited Laboratory Number: 828


This Document is issued in accordance with
NATA's Accreditation requirements.
Accredited for compliance with ISO/IEC 17025



RESULTS OF PARTICLE SIZE DISTRIBUTION

Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Geotech Study	Report No. :	UL09-218B
Location :	Calderwood	Report Date :	03-Nov-09
Road No:	-	Date Sampled:	9-13-Nov-09
Chainage:	-	Date of Test:	23-Nov-09
	Sample / Pit No: 8	Depth / Layer:	1.0 - 1.1m
	Section / Lot No: -	Test Request No: -	
		Page:	1 of 1

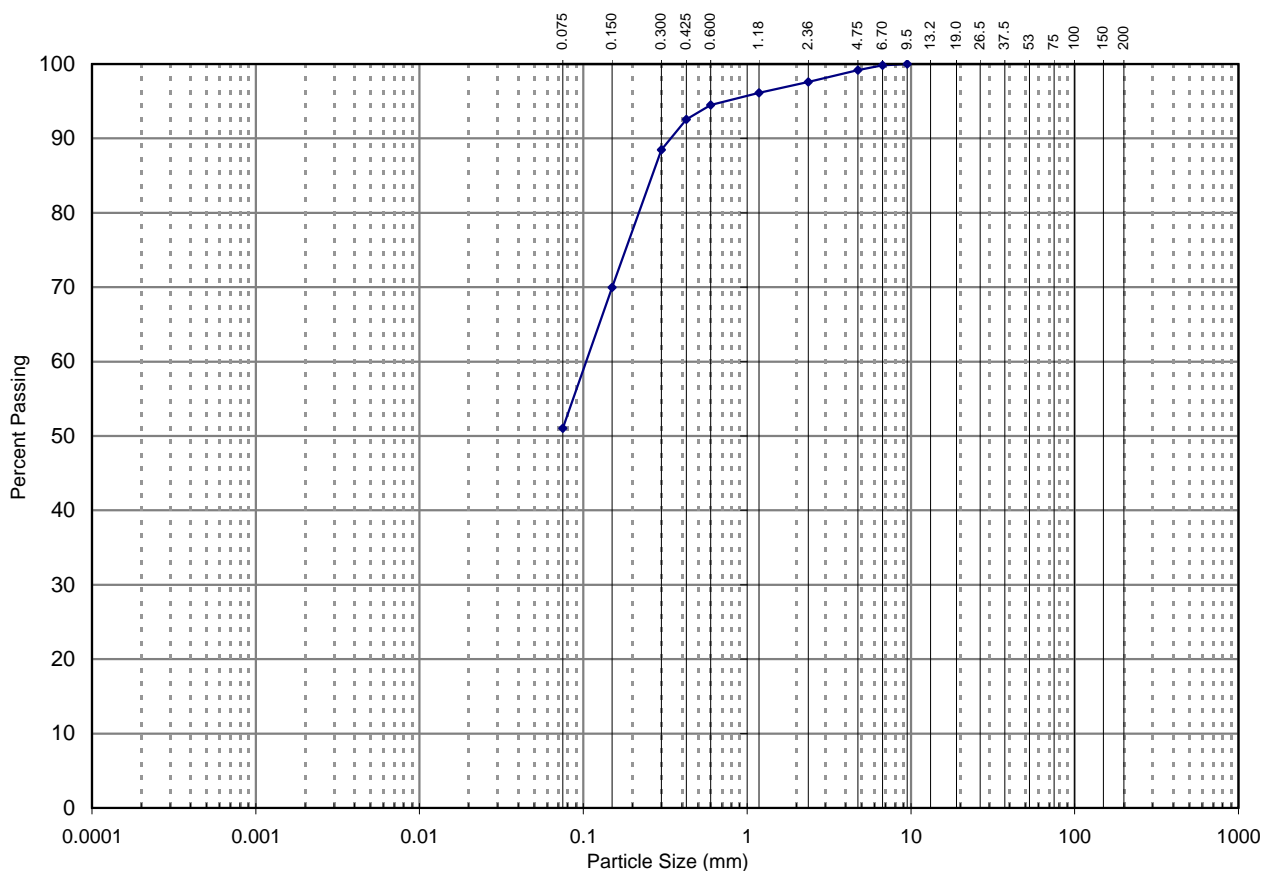AUSTRALIAN STANDARD SIEVE APERTURES



Sieve Size (mm)	% Passing
75.0	~
53.0	~
37.5	~
26.5	~
19.0	~
13.2	~
9.5	100%
6.7	100%
4.75	99%
2.36	98%
1.18	96%
0.600	95%
0.425	93%
0.300	88%
0.150	70%
0.075	51%

CLAY FRACTION	SILT FRACTION			SAND FRACTION			GRAVEL FRACTION			COBBLES
	Fine	Medium	Coarse	Fine	Medium	Coarse	Fine	Medium	Coarse	
	0.002	0.006	0.02	0.06	0.2	0.6	2.0	6.0	20	60

Description: Brown silty sandy clay
Test Method(s): AS 1289.3.6.1
Sampling Method(s): Sampled by Wollongong Engineering Department
Remarks: -

Approved Signatory:

Tested:	JR
Checked:	DE


David Evans
Laboratory Manager



RESULTS OF PARTICLE SIZE DISTRIBUTION

Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Geotech Study	Report No. :	UL09-218C
Location :	Calderwood	Report Date :	03-Nov-09
Road No:	-	Date Sampled:	9-13-Nov-09
Chainage:	-	Date of Test:	23-Nov-09
	Sample / Pit No:	Depth / Layer:	1.0 - 1.1m
	Section / Lot No:	Test Request No:	-
		Page:	1 of 1

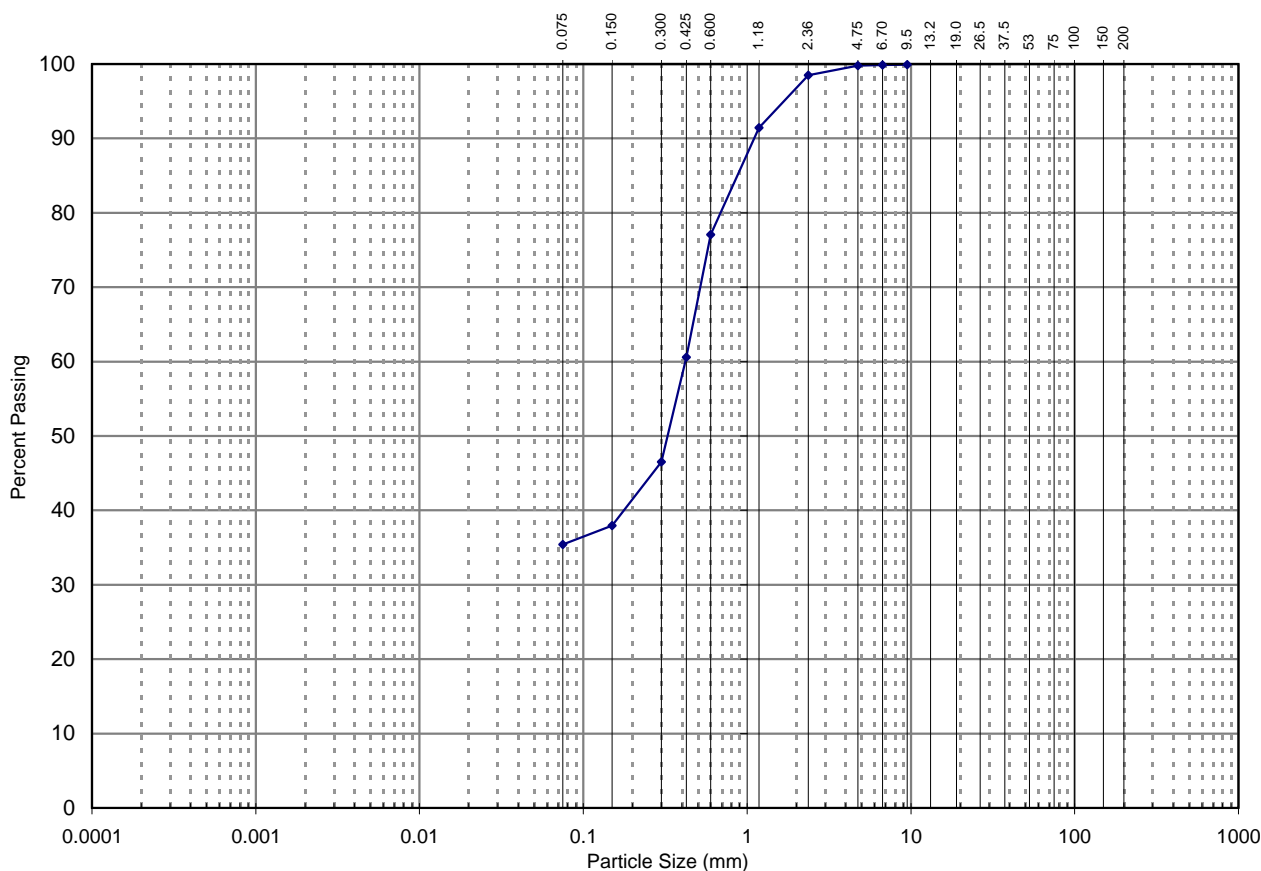AUSTRALIAN STANDARD SIEVE APERTURES



Sieve Size (mm)	% Passing
75.0	~
53.0	~
37.5	~
26.5	~
19.0	~
13.2	~
9.5	100%
6.7	100%
4.75	100%
2.36	98%
1.18	91%
0.600	77%
0.425	61%
0.300	47%
0.150	38%
0.075	35%

CLAY FRACTION	SILT FRACTION			SAND FRACTION			GRAVEL FRACTION			COBBLES
	Fine	Medium	Coarse	Fine	Medium	Coarse	Fine	Medium	Coarse	
	0.002	0.006	0.02	0.06	0.2	0.6	2.0	6.0	20	60

Description: Orange brown silty clayey sand
Test Method(s): AS 1289.3.6.1
Sampling Method(s): Sampled by Wollongong Engineering Department
Remarks: -

Approved Signatory:

Tested:	JR
Checked:	DE


David Evans
Laboratory Manager



RESULTS OF PARTICLE SIZE DISTRIBUTION

Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Geotech Study	Report No. :	UL09-218D
Location :	Calderwood	Report Date :	03-Nov-09
Road No:	-	Date Sampled:	9-13-Nov-09
Chainage:	-	Date of Test:	23-Nov-09
	Sample / Pit No: 56	Depth / Layer:	0.5 - 0.7m
	Section / Lot No: -	Test Request No: -	
		Page:	1 of 1

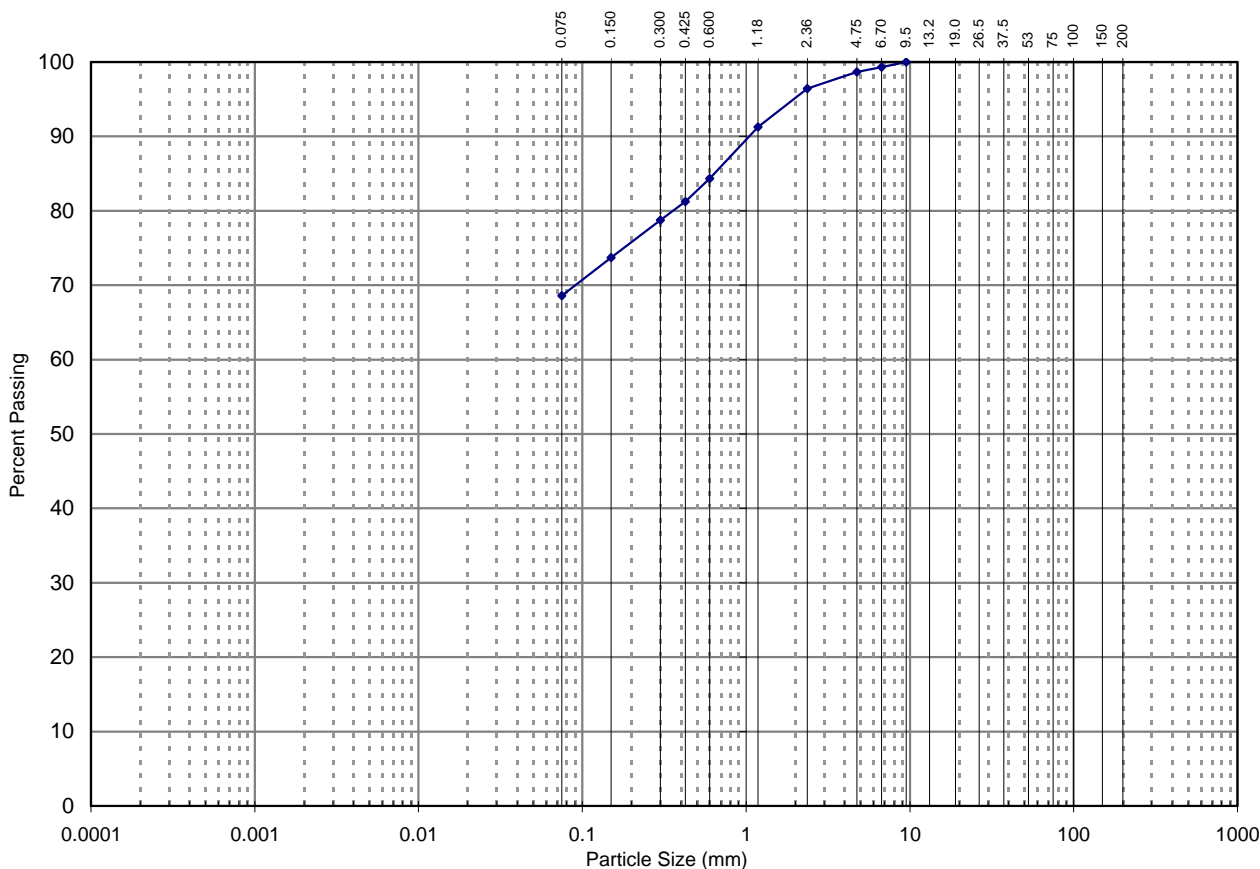AUSTRALIAN STANDARD SIEVE APERTURES



Sieve Size (mm)	% Passing
75.0	~
53.0	~
37.5	~
26.5	~
19.0	~
13.2	~
9.5	100%
6.7	99%
4.75	99%
2.36	96%
1.18	91%
0.600	84%
0.425	81%
0.300	79%
0.150	74%
0.075	69%

CLAY FRACTION	SILT FRACTION			SAND FRACTION			GRAVEL FRACTION			COBBLES
	Fine	Medium	Coarse	Fine	Medium	Coarse	Fine	Medium	Coarse	
	0.002	0.006	0.02	0.06	0.2	0.6	2.0	6.0	20	60

Description: Brown sandy silty clay
 Test Method(s): AS 1289.3.6.1
 Sampling Method(s): Sampled by Wollongong Engineering Department
 Remarks: -

Approved Signatory:

Tested:	JR
Checked:	DE


David Evans
Laboratory Manager



RESULTS OF PARTICLE SIZE DISTRIBUTION

Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Geotech Study	Report No. :	UL09-218E
Location :	Calderwood	Report Date :	03-Nov-09
Road No:	-	Date Sampled:	9-13-Nov-09
Chainage:	-	Date of Test:	23-Nov-09
	Sample / Pit No: 59	Depth / Layer:	0.5 - 0.7m
	Section / Lot No: -	Test Request No: -	
		Page:	1 of 1

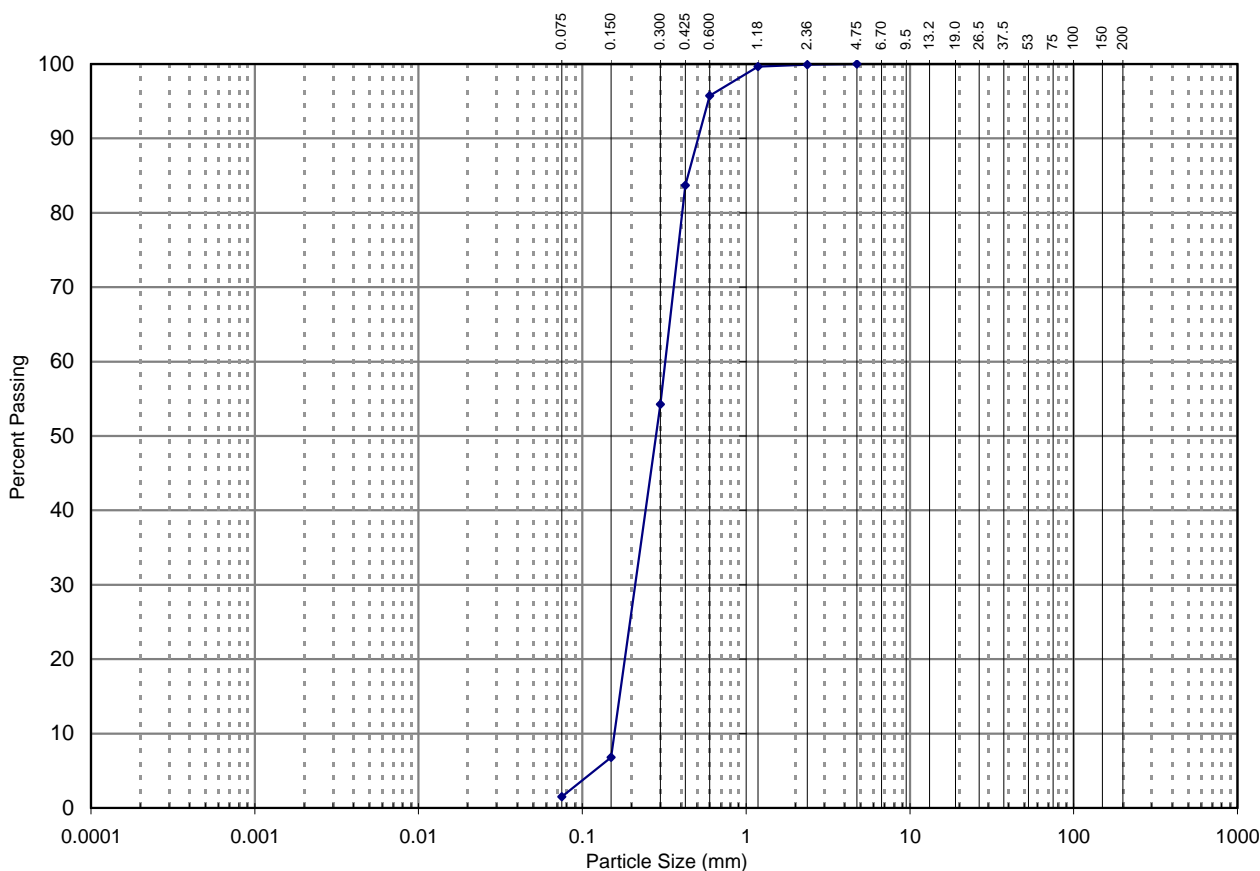AUSTRALIAN STANDARD SIEVE APERTURES



Sieve Size (mm)	% Passing
75.0	~
53.0	~
37.5	~
26.5	~
19.0	~
13.2	~
9.5	~
6.7	~
4.75	100%
2.36	100%
1.18	100%
0.600	96%
0.425	84%
0.300	54%
0.150	7%
0.075	2%

CLAY FRACTION	SILT FRACTION			SAND FRACTION			GRAVEL FRACTION			COBBLES
	Fine	Medium	Coarse	Fine	Medium	Coarse	Fine	Medium	Coarse	
	0.002	0.006	0.02	0.06	0.2	0.6	2.0	6.0	20	60

Description: Brown sand
 Test Method(s): AS 1289.3.6.1
 Sampling Method(s): Sampled by Wollongong Engineering Department
 Remarks: -

Approved Signatory:

Tested:	JR
Checked:	DE


David Evans
Laboratory Manager



RESULTS OF PARTICLE SIZE DISTRIBUTION

Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Geotech Study	Report No. :	UL09-218F
Location :	Calderwood	Report Date :	03-Nov-09
Road No:	-	Date Sampled:	9-13-Nov-09
Chainage:	-	Date of Test:	23-Nov-09
	Sample / Pit No: 7	Depth / Layer:	0.9 - 1.0m
	Section / Lot No: -	Test Request No: -	
		Page:	1 of 1

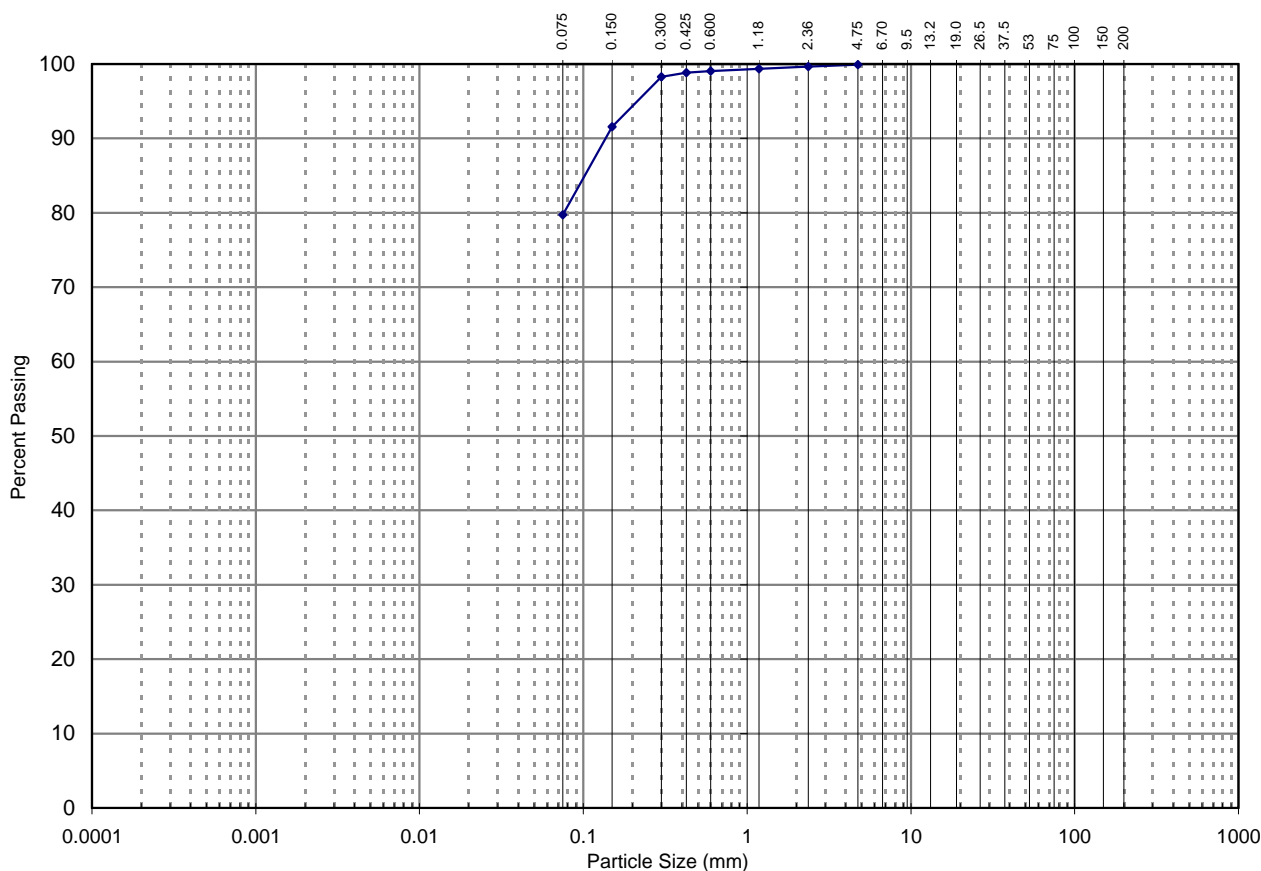AUSTRALIAN STANDARD SIEVE APERTURES



Sieve Size (mm)	% Passing
75.0	~
53.0	~
37.5	~
26.5	~
19.0	~
13.2	~
9.5	~
6.7	~
4.75	100%
2.36	100%
1.18	99%
0.600	99%
0.425	99%
0.300	98%
0.150	92%
0.075	80%

CLAY FRACTION	SILT FRACTION			SAND FRACTION			GRAVEL FRACTION			COBBLES
	Fine	Medium	Coarse	Fine	Medium	Coarse	Fine	Medium	Coarse	
	0.002	0.006	0.02	0.06	0.2	0.6	2.0	6.0	20	60


Description: Orange brown sandy silty clay
Test Method(s): AS 1289.3.6.1
Sampling Method(s): Sampled by Wollongong Engineering Department
Remarks: -



RESULTS OF PARTICLE SIZE DISTRIBUTION

Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Geotech Study	Report No. :	UL09-218G
Location :	Calderwood	Report Date :	03-Nov-09
Road No:	-	Date Sampled:	9-13-Nov-09
Chainage:	-	Date of Test:	23-Nov-09
		Depth / Layer:	1.0 - 1.1m
		Test Request No:	-
		Page:	1 of 1

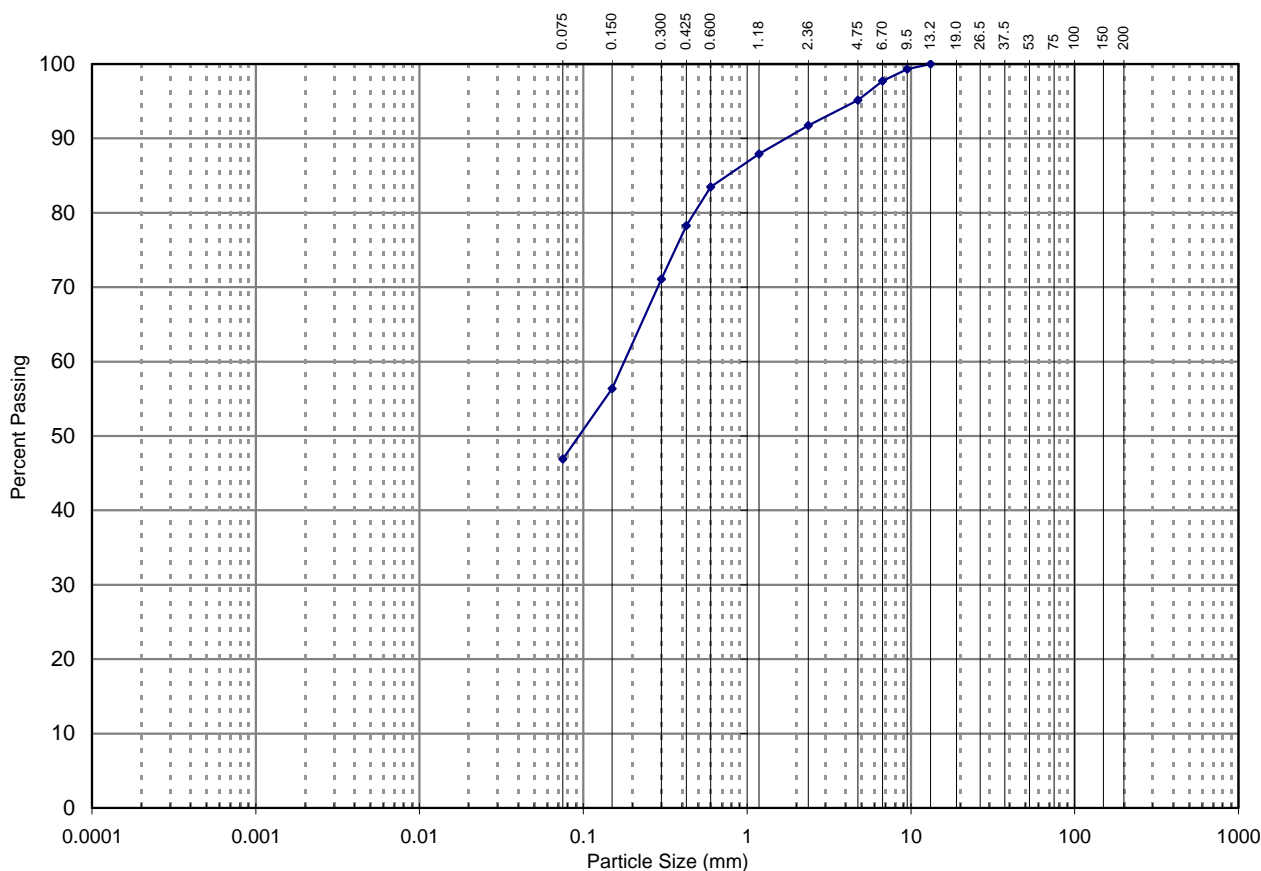AUSTRALIAN STANDARD SIEVE APERTURES



Sieve Size (mm)	% Passing
75.0	~
53.0	~
37.5	~
26.5	~
19.0	~
13.2	100%
9.5	99%
6.7	98%
4.75	95%
2.36	92%
1.18	88%
0.600	83%
0.425	78%
0.300	71%
0.150	56%
0.075	47%

CLAY FRACTION	SILT FRACTION			SAND FRACTION			GRAVEL FRACTION			COBBLES
	Fine	Medium	Coarse	Fine	Medium	Coarse	Fine	Medium	Coarse	
	0.002	0.006	0.02	0.06	0.2	0.6	2.0	6.0	20	60

Description: Brown gravelly silty clayey sand
Test Method(s): AS 1289.3.6.1
Sampling Method(s): Sampled by Wollongong Engineering Department
Remarks: -

Approved Signatory:

Tested:	JR
Checked:	DE


David Evans
Laboratory Manager



RESULTS OF PARTICLE SIZE DISTRIBUTION

Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Geotech Study	Report No. :	UL09-218H
Location :	Calderwood	Report Date :	03-Nov-09
Road No:	-	Date Sampled:	9-13-Nov-09
Chainage:	-	Date of Test:	23-Nov-09
	Sample / Pit No: 31	Depth / Layer:	0.5 - 0.7m
	Section / Lot No: -	Test Request No: -	
		Page:	1 of 1

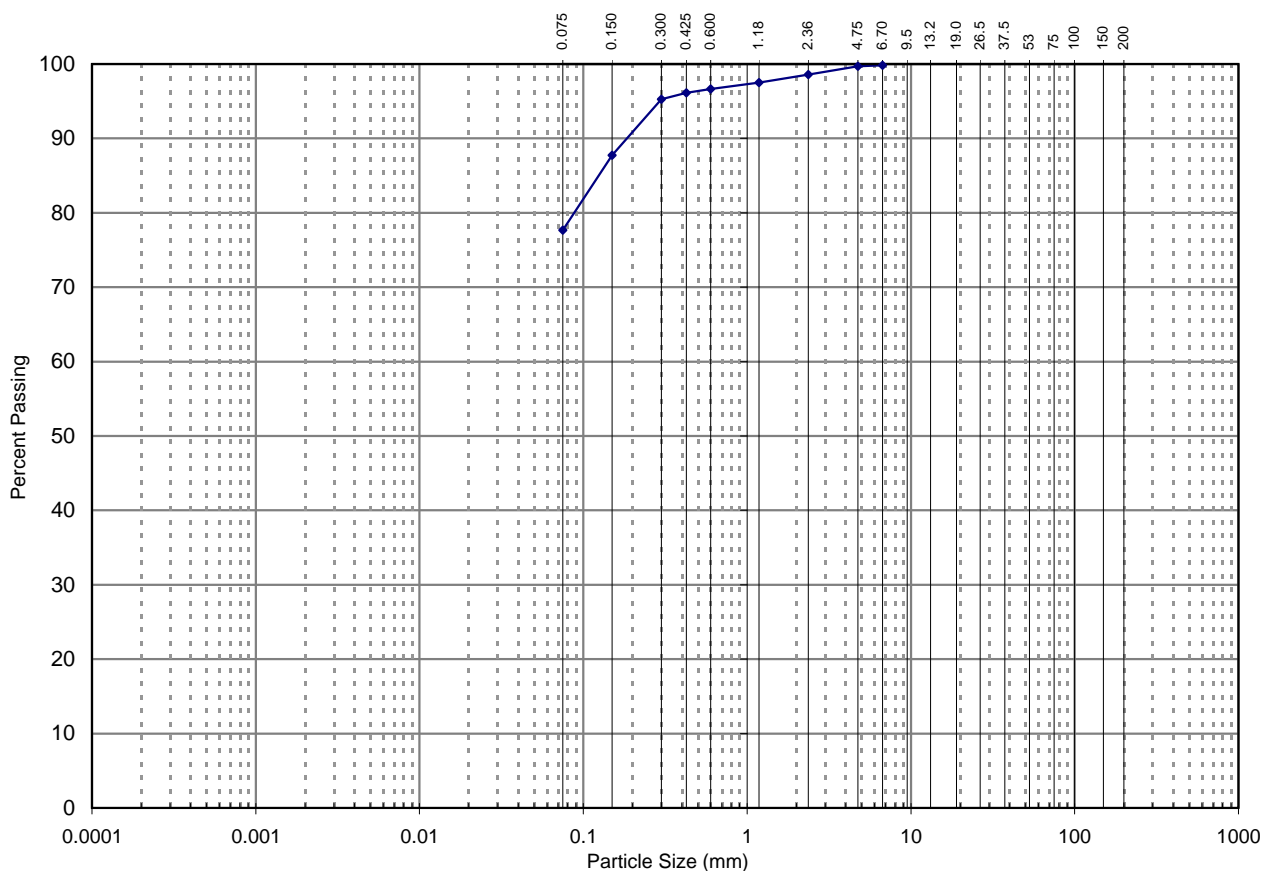AUSTRALIAN STANDARD SIEVE APERTURES



Sieve Size (mm)	% Passing
75.0	~
53.0	~
37.5	~
26.5	~
19.0	~
13.2	~
9.5	~
6.7	100%
4.75	100%
2.36	99%
1.18	98%
0.600	97%
0.425	96%
0.300	95%
0.150	88%
0.075	78%

CLAY FRACTION	SILT FRACTION			SAND FRACTION			GRAVEL FRACTION			COBBLES
	Fine	Medium	Coarse	Fine	Medium	Coarse	Fine	Medium	Coarse	
	0.002	0.006	0.02	0.06	0.2	0.6	2.0	6.0	20	60

Description: Brown sandy silty clay
 Test Method(s): AS 1289.3.6.1
 Sampling Method(s): Sampled by Wollongong Engineering Department
 Remarks: -

Approved Signatory:

Tested:	JR
Checked:	DE

David Evans
Laboratory Manager



RESULTS OF MOISTURE CONTENT, PLASTICITY AND LINEAR SHRINKAGE TESTS

Client:		DELFIN LEND LEASE		Project No:		48742		
Project:		Master Planning Geotech Study		Report No:		UL09-218U		
				Report Date:		9/12/2009		
Location:		Calderwood		Date Sampled:		9-13/11/2009		
				Date of Test:		7/12/2009		
				Page:		1 of 1		
TEST LOCATION	DEPTH (m)	DESCRIPTION	CODE	W _F %	W _L %	W _P %	PI %	*LS %
32	0.5 - 0.6	Brown silty clay	2,3,5	27.0	62	25	37	16.5
33	1.0 - 1.1	Brown clay	2,3,5	39.4	97	35	62	22.0
23	0.9 - 1.0	Brown clay	2,3,5	37.1	90	35	55	21.5
30	1.0 - 1.2	Light brown silty clay	2,3,5	26.3	67	23	44	15.0
44	1.0 - 1.2	Brown clay	2,3,5	28.3	96	30	66	16.5
51	1.0 - 1.2	Brown clay	2,3,5	37.3	102	33	69	20

Legend:

W_F Field Moisture Content
W_L Liquid limit
W_P Plastic limit
PI Plasticity index
LS Linear shrinkage from liquid limit condition (Mould length 125mm)

Test Methods:

Moisture Content: AS 1289 2.1.1
Liquid Limit: AS 1289 3.1.2
Plastic Limit: AS 1289 3.2.1
Plasticity Index: AS 1289 3.3.1
Linear Shrinkage: AS 1289 3.4.1

Code

Sample history for plasticity tests

1. Air dried
2. Low temperature (<50°C) oven dried
3. Oven (105°C) dried
4. Unknown

Method of preparation for plasticity tests

5. Dry sieved
6. Wet sieved
7. Natural

*Specify if sample crumbled CR or curled CU

Sampling Method(s): Sampled by Wollongong Engineering Department

Remarks:

Approved Signatory:

Tested: TZ, JR
Checked: DE

David Evans
Laboratory Manager



NATA Accredited Laboratory Number: 828

This Document is issued in accordance with
NATA's accreditation requirements.
Accredited for compliance with ISO/IEC 17025



RESULT OF SHRINK-SWELL INDEX DETERMINATION


Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Planning Geotech Study	Report No. :	UL09-218K
Location :	Calderwood	Report Date :	3/12/2009
Test Location :	28	Date Sampled :	9-13/11/2009
Depth / Layer :	0.4 - 0.8m	Date of Test:	23/11/2009
		Page:	1 of 1

CORE SHRINKAGE TEST

Shrinkage - air dried	6.8 %
Shrinkage - oven dried	7.9 %
Significant inert inclusions	0.0 %
Extent of cracking	HC
Extent of soil crumbling	0.0 %
Moisture content of core	31.7 %

SWELL TEST

Pocket penetrometer reading at initial moisture content	200 kPa
Pocket penetrometer reading at final moisture content	130 kPa
Initial Moisture Content	34.1 %
Final Moisture Content	38.3 %
Swell under 25kPa	2.2 %

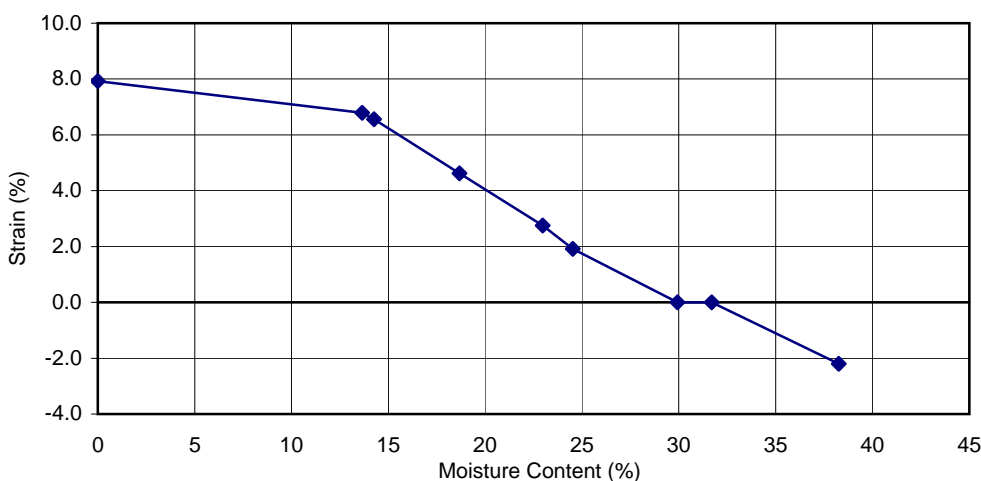

SHRINK-SWELL INDEX Iss 5.0% per Δ pF

Description:	Brown silty clay
Test Method(s):	AS 1289.7.1.1, AS 1289.2.1.1
Sampling Method(s):	Sampled by Wollongong Engineering Department
Extent of Cracking:	<div> UC - Uncracked SC - Slightly cracked MC - Moderately cracked </div> <div> HC - Highly cracked FR - Fractured </div>

Remarks: -

Note that NATA accreditation does not cover the performance of pocket penetrometer readings

Approved Signatory:

Tested:	TZ
Checked:	TZ

Dave Evans
Laboratory Manager



NATA Accredited Laboratory Number: 828
This Document is issued in accordance with NATA's accreditation requirements.
Accredited for compliance with ISO/IEC 17025



RESULT OF SHRINK-SWELL INDEX DETERMINATION


Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Planning Geotech Study	Report No. :	UL09-218L
Location :	Calderwood	Report Date :	3/12/2009
Test Location :	45	Date Sampled :	9-13/11/2009
Depth / Layer :	0.5 - 0.9m	Date of Test:	23/11/2009
		Page:	1 of 1

CORE SHRINKAGE TEST

Shrinkage - air dried	3.2 %
Shrinkage - oven dried	4.1 %
Significant inert inclusions	3.0 %
Extent of cracking	SC
Extent of soil crumbling	0.0 %
Moisture content of core	20.9 %

SWELL TEST

Pocket penetrometer reading at initial moisture content	600 kPa
Pocket penetrometer reading at final moisture content	300 kPa
Initial Moisture Content	21.6 %
Final Moisture Content	27.0 %
Swell under 25kPa	4.2 %

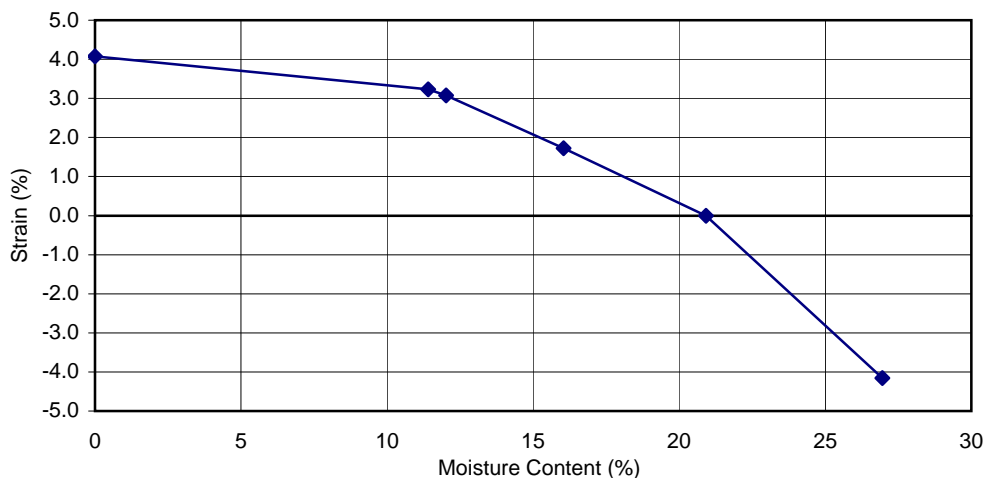

SHRINK-SWELL INDEX I_{ss} 3.4% per ΔpF

Description:	Orange grey brown silty clay
Test Method(s):	AS 1289.7.1.1, AS 1289.2.1.1
Sampling Method(s):	Sampled by Wollongong Engineering Department
Extent of Cracking:	<div> UC - Uncracked HC - Highly cracked </div> <div> SC - Slightly cracked FR - Fractured </div> <div> MC - Moderately cracked </div>

Remarks: -

Note that NATA accreditation does not cover the performance of pocket penetrometer readings

Approved Signatory:

Tested:	TZ
Checked:	TZ

Dave Evans
Laboratory Manager



NATA Accredited Laboratory Number: 828
This Document is issued in accordance with NATA's accreditation requirements.
Accredited for compliance with ISO/IEC 17025



RESULT OF SHRINK-SWELL INDEX DETERMINATION


Client :	DELFIN LEND LEASE	Project No. :	48742
Project :	Master Planning Geotech Study	Report No. :	UL09-218M
Location :	Calderwood	Report Date :	3/12/2009
Test Location :	65	Date Sampled :	9-13/11/2009
Depth / Layer :	0.7 - 1.1m	Date of Test:	23/11/2009
		Page:	1 of 1

CORE SHRINKAGE TEST

Shrinkage - air dried	0.7 %
Shrinkage - oven dried	1.6 %
Significant inert inclusions	3.0 %
Extent of cracking	MC
Extent of soil crumbling	1.0 %
Moisture content of core	27.2 %

SWELL TEST

Pocket penetrometer reading at initial moisture content	70 kPa
Pocket penetrometer reading at final moisture content	80 kPa
Initial Moisture Content	32.2 %
Final Moisture Content	33.4 %
Swell under 25kPa	0.0 %

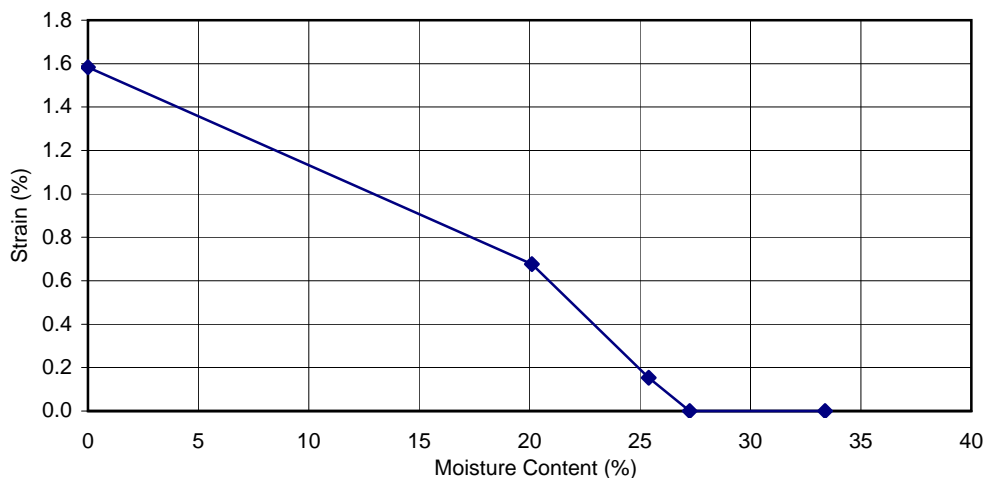

SHRINK-SWELL INDEX I_{ss} 0.9% per ΔpF

Description:	Dark brown silty sandy clay
Test Method(s):	AS 1289.7.1.1, AS 1289.2.1.1
Sampling Method(s):	Sampled by Wollongong Engineering Department
Extent of Cracking:	<div> UC - Uncracked SC - Slightly cracked MC - Moderately cracked </div> <div> HC - Highly cracked FR - Fractured </div>

Remarks: -

Note that NATA accreditation does not cover the performance of pocket penetrometer readings

Approved Signatory:

Tested:	TZ
Checked:	TZ

Dave Evans
Laboratory Manager



NATA Accredited Laboratory Number: 828
This Document is issued in accordance with NATA's accreditation requirements.
Accredited for compliance with ISO/IEC 17025

APPENDIX D

*CSIRO Publication
Extracts from Australian Geomechanics Society*

Foundation Maintenance and Footing Performance: A Homeowner's Guide



BTF 18
replaces
Information
Sheet 10/91

Buildings can and often do move. This movement can be up, down, lateral or rotational. The fundamental cause of movement in buildings can usually be related to one or more problems in the foundation soil. It is important for the homeowner to identify the soil type in order to ascertain the measures that should be put in place in order to ensure that problems in the foundation soil can be prevented, thus protecting against building movement.

This Building Technology File is designed to identify causes of soil-related building movement, and to suggest methods of prevention of resultant cracking in buildings.

Soil Types

The types of soils usually present under the topsoil in land zoned for residential buildings can be split into two approximate groups – granular and clay. Quite often, foundation soil is a mixture of both types. The general problems associated with soils having granular content are usually caused by erosion. Clay soils are subject to saturation and swell/shrink problems.

Classifications for a given area can generally be obtained by application to the local authority, but these are sometimes unreliable and if there is doubt, a geotechnical report should be commissioned. As most buildings suffering movement problems are founded on clay soils, there is an emphasis on classification of soils according to the amount of swell and shrinkage they experience with variations of water content. The table below is Table 2.1 from AS 2870, the Residential Slab and Footing Code.

Causes of Movement

Settlement due to construction

There are two types of settlement that occur as a result of construction:

- Immediate settlement occurs when a building is first placed on its foundation soil, as a result of compaction of the soil under the weight of the structure. The cohesive quality of clay soil mitigates against this, but granular (particularly sandy) soil is susceptible.
- Consolidation settlement is a feature of clay soil and may take place because of the expulsion of moisture from the soil or because of the soil's lack of resistance to local compressive or shear stresses. This will usually take place during the first few months after construction, but has been known to take many years in exceptional cases.

These problems are the province of the builder and should be taken into consideration as part of the preparation of the site for construction. Building Technology File 19 (BTF 19) deals with these problems.

Erosion

All soils are prone to erosion, but sandy soil is particularly susceptible to being washed away. Even clay with a sand component of say 10% or more can suffer from erosion.

Saturation

This is particularly a problem in clay soils. Saturation creates a bog-like suspension of the soil that causes it to lose virtually all of its bearing capacity. To a lesser degree, sand is affected by saturation because saturated sand may undergo a reduction in volume – particularly imported sand fill for bedding and blinding layers. However, this usually occurs as immediate settlement and should normally be the province of the builder.

Seasonal swelling and shrinkage of soil

All clays react to the presence of water by slowly absorbing it, making the soil increase in volume (see table below). The degree of increase varies considerably between different clays, as does the degree of decrease during the subsequent drying out caused by fair weather periods. Because of the low absorption and expulsion rate, this phenomenon will not usually be noticeable unless there are prolonged rainy or dry periods, usually of weeks or months, depending on the land and soil characteristics.

The swelling of soil creates an upward force on the footings of the building, and shrinkage creates subsidence that takes away the support needed by the footing to retain equilibrium.

Shear failure

This phenomenon occurs when the foundation soil does not have sufficient strength to support the weight of the footing. There are two major post-construction causes:

- Significant load increase.
- Reduction of lateral support of the soil under the footing due to erosion or excavation.
- In clay soil, shear failure can be caused by saturation of the soil adjacent to or under the footing.

GENERAL DEFINITIONS OF SITE CLASSES

Class	Foundation
A	Most sand and rock sites with little or no ground movement from moisture changes
S	Slightly reactive clay sites with only slight ground movement from moisture changes
M	Moderately reactive clay or silt sites, which can experience moderate ground movement from moisture changes
H	Highly reactive clay sites, which can experience high ground movement from moisture changes
E	Extremely reactive sites, which can experience extreme ground movement from moisture changes
A to P	Filled sites
P	Sites which include soft soils, such as soft clay or silt or loose sands; landslip; mine subsidence; collapsing soils; soils subject to erosion; reactive sites subject to abnormal moisture conditions or sites which cannot be classified otherwise

Tree root growth

Trees and shrubs that are allowed to grow in the vicinity of footings can cause foundation soil movement in two ways:

- Roots that grow under footings may increase in cross-sectional size, exerting upward pressure on footings.
- Roots in the vicinity of footings will absorb much of the moisture in the foundation soil, causing shrinkage or subsidence.

Unevenness of Movement

The types of ground movement described above usually occur unevenly throughout the building's foundation soil. Settlement due to construction tends to be uneven because of:

- Differing compaction of foundation soil prior to construction.
- Differing moisture content of foundation soil prior to construction.

Movement due to non-construction causes is usually more uneven still. Erosion can undermine a footing that traverses the flow or can create the conditions for shear failure by eroding soil adjacent to a footing that runs in the same direction as the flow.

Saturation of clay foundation soil may occur where subfloor walls create a dam that makes water pond. It can also occur wherever there is a source of water near footings in clay soil. This leads to a severe reduction in the strength of the soil which may create local shear failure.

Seasonal swelling and shrinkage of clay soil affects the perimeter of the building first, then gradually spreads to the interior. The swelling process will usually begin at the uphill extreme of the building, or on the weather side where the land is flat. Swelling gradually reaches the interior soil as absorption continues. Shrinkage usually begins where the sun's heat is greatest.

Effects of Uneven Soil Movement on Structures

Erosion and saturation

Erosion removes the support from under footings, tending to create subsidence of the part of the structure under which it occurs. Brickwork walls will resist the stress created by this removal of support by bridging the gap or cantilevering until the bricks or the mortar bedding fail. Older masonry has little resistance. Evidence of failure varies according to circumstances and symptoms may include:

- Step cracking in the mortar beds in the body of the wall or above/below openings such as doors or windows.
- Vertical cracking in the bricks (usually but not necessarily in line with the vertical beds or perpendes).

Isolated piers affected by erosion or saturation of foundations will eventually lose contact with the bearers they support and may tilt or fall over. The floors that have lost this support will become bouncy, sometimes rattling ornaments etc.

Seasonal swelling/shrinkage in clay

Swelling foundation soil due to rainy periods first lifts the most exposed extremities of the footing system, then the remainder of the perimeter footings while gradually permeating inside the building footprint to lift internal footings. This swelling first tends to create a dish effect, because the external footings are pushed higher than the internal ones.

The first noticeable symptom may be that the floor appears slightly dished. This is often accompanied by some doors binding on the floor or the door head, together with some cracking of cornice mitres. In buildings with timber flooring supported by bearers and joists, the floor can be bouncy. Externally there may be visible dishing of the hip or ridge lines.

As the moisture absorption process completes its journey to the innermost areas of the building, the internal footings will rise. If the spread of moisture is roughly even, it may be that the symptoms will temporarily disappear, but it is more likely that swelling will be uneven, creating a difference rather than a disappearance in symptoms. In buildings with timber flooring supported by bearers and joists, the isolated piers will rise more easily than the strip footings or piers under walls, creating noticeable doming of flooring.



As the weather pattern changes and the soil begins to dry out, the external footings will be first affected, beginning with the locations where the sun's effect is strongest. This has the effect of lowering the external footings. The doming is accentuated and cracking reduces or disappears where it occurred because of dishing, but other cracks open up. The roof lines may become convex.

Doming and dishing are also affected by weather in other ways. In areas where warm, wet summers and cooler dry winters prevail, water migration tends to be toward the interior and doming will be accentuated, whereas where summers are dry and winters are cold and wet, migration tends to be toward the exterior and the underlying propensity is toward dishing.

Movement caused by tree roots

In general, growing roots will exert an upward pressure on footings, whereas soil subject to drying because of tree or shrub roots will tend to remove support from under footings by inducing shrinkage.

Complications caused by the structure itself

Most forces that the soil causes to be exerted on structures are vertical – i.e. either up or down. However, because these forces are seldom spread evenly around the footings, and because the building resists uneven movement because of its rigidity, forces are exerted from one part of the building to another. The net result of all these forces is usually rotational. This resultant force often complicates the diagnosis because the visible symptoms do not simply reflect the original cause. A common symptom is binding of doors on the vertical member of the frame.

Effects on full masonry structures

Brickwork will resist cracking where it can. It will attempt to span areas that lose support because of subsided foundations or raised points. It is therefore usual to see cracking at weak points, such as openings for windows or doors.

In the event of construction settlement, cracking will usually remain unchanged after the process of settlement has ceased.

With local shear or erosion, cracking will usually continue to develop until the original cause has been remedied, or until the subsidence has completely neutralised the affected portion of footing and the structure has stabilised on other footings that remain effective.

In the case of swell/shrink effects, the brickwork will in some cases return to its original position after completion of a cycle, however it is more likely that the rotational effect will not be exactly reversed, and it is also usual that brickwork will settle in its new position and will resist the forces trying to return it to its original position. This means that in a case where swelling takes place after construction and cracking occurs, the cracking is likely to at least partly remain after the shrink segment of the cycle is complete. Thus, each time the cycle is repeated, the likelihood is that the cracking will become wider until the sections of brickwork become virtually independent.

With repeated cycles, once the cracking is established, if there is no other complication, it is normal for the incidence of cracking to stabilise, as the building has the articulation it needs to cope with the problem. This is by no means always the case, however, and monitoring of cracks in walls and floors should always be treated seriously.

Upheaval caused by growth of tree roots under footings is not a simple vertical shear stress. There is a tendency for the root to also exert lateral forces that attempt to separate sections of brickwork after initial cracking has occurred.

The normal structural arrangement is that the inner leaf of brickwork in the external walls and at least some of the internal walls (depending on the roof type) comprise the load-bearing structure on which any upper floors, ceilings and the roof are supported. In these cases, it is internally visible cracking that should be the main focus of attention, however there are a few examples of dwellings whose external leaf of masonry plays some supporting role, so this should be checked if there is any doubt. In any case, externally visible cracking is important as a guide to stresses on the structure generally, and it should also be remembered that the external walls must be capable of supporting themselves.

Effects on framed structures

Timber or steel framed buildings are less likely to exhibit cracking due to swell/shrink than masonry buildings because of their flexibility. Also, the doming/dishing effects tend to be lower because of the lighter weight of walls. The main risks to framed buildings are encountered because of the isolated pier footings used under walls. Where erosion or saturation cause a footing to fall away, this can double the span which a wall must bridge. This additional stress can create cracking in wall linings, particularly where there is a weak point in the structure caused by a door or window opening. It is, however, unlikely that framed structures will be so stressed as to suffer serious damage without first exhibiting some or all of the above symptoms for a considerable period. The same warning period should apply in the case of upheaval. It should be noted, however, that where framed buildings are supported by strip footings there is only one leaf of brickwork and therefore the externally visible walls are the supporting structure for the building. In this case, the subfloor masonry walls can be expected to behave as full brickwork walls.

Effects on brick veneer structures

Because the load-bearing structure of a brick veneer building is the frame that makes up the interior leaf of the external walls plus perhaps the internal walls, depending on the type of roof, the building can be expected to behave as a framed structure, except that the external masonry will behave in a similar way to the external leaf of a full masonry structure.

Water Service and Drainage

Where a water service pipe, a sewer or stormwater drainage pipe is in the vicinity of a building, a water leak can cause erosion, swelling or saturation of susceptible soil. Even a minuscule leak can be enough to saturate a clay foundation. A leaking tap near a building can have the same effect. In addition, trenches containing pipes can become watercourses even though backfilled, particularly where broken rubble is used as fill. Water that runs along these trenches can be responsible for serious erosion, interstrata seepage into subfloor areas and saturation.

Pipe leakage and trench water flows also encourage tree and shrub roots to the source of water, complicating and exacerbating the problem.

Poor roof plumbing can result in large volumes of rainwater being concentrated in a small area of soil:

- Incorrect falls in roof guttering may result in overflows, as may gutters blocked with leaves etc.

- Corroded guttering or downpipes can spill water to ground.
- Downpipes not positively connected to a proper stormwater collection system will direct a concentration of water to soil that is directly adjacent to footings, sometimes causing large-scale problems such as erosion, saturation and migration of water under the building.

Seriousness of Cracking

In general, most cracking found in masonry walls is a cosmetic nuisance only and can be kept in repair or even ignored. The table below is a reproduction of Table C1 of AS 2870.

AS 2870 also publishes figures relating to cracking in concrete floors, however because wall cracking will usually reach the critical point significantly earlier than cracking in slabs, this table is not reproduced here.

Prevention/Cure

Plumbing

Where building movement is caused by water service, roof plumbing, sewer or stormwater failure, the remedy is to repair the problem. It is prudent, however, to consider also rerouting pipes away from the building where possible, and relocating taps to positions where any leakage will not direct water to the building vicinity. Even where gully traps are present, there is sometimes sufficient spill to create erosion or saturation, particularly in modern installations using smaller diameter PVC fixtures. Indeed, some gully traps are not situated directly under the taps that are installed to charge them, with the result that water from the tap may enter the backfilled trench that houses the sewer piping. If the trench has been poorly backfilled, the water will either pond or flow along the bottom of the trench. As these trenches usually run alongside the footings and can be at a similar depth, it is not hard to see how any water that is thus directed into a trench can easily affect the foundation's ability to support footings or even gain entry to the subfloor area.

Ground drainage

In all soils there is the capacity for water to travel on the surface and below it. Surface water flows can be established by inspection during and after heavy or prolonged rain. If necessary, a grated drain system connected to the stormwater collection system is usually an easy solution.

It is, however, sometimes necessary when attempting to prevent water migration that testing be carried out to establish watertable height and subsoil water flows. This subject is referred to in BTF 19 and may properly be regarded as an area for an expert consultant.

Protection of the building perimeter


It is essential to remember that the soil that affects footings extends well beyond the actual building line. Watering of garden plants, shrubs and trees causes some of the most serious water problems.

For this reason, particularly where problems exist or are likely to occur, it is recommended that an apron of paving be installed around as much of the building perimeter as necessary. This paving

CLASSIFICATION OF DAMAGE WITH REFERENCE TO WALLS

Description of typical damage and required repair	Approximate crack width limit (see Note 3)	Damage category
Hairline cracks	<0.1 mm	0
Fine cracks which do not need repair	<1 mm	1
Cracks noticeable but easily filled. Doors and windows stick slightly	<5 mm	2
Cracks can be repaired and possibly a small amount of wall will need to be replaced. Doors and windows stick. Service pipes can fracture. Weathertightness often impaired	5–15 mm (or a number of cracks 3 mm or more in one group)	3
Extensive repair work involving breaking-out and replacing sections of walls, especially over doors and windows. Window and door frames distort. Walls lean or bulge noticeably, some loss of bearing in beams. Service pipes disrupted	15–25 mm but also depend on number of cracks	4

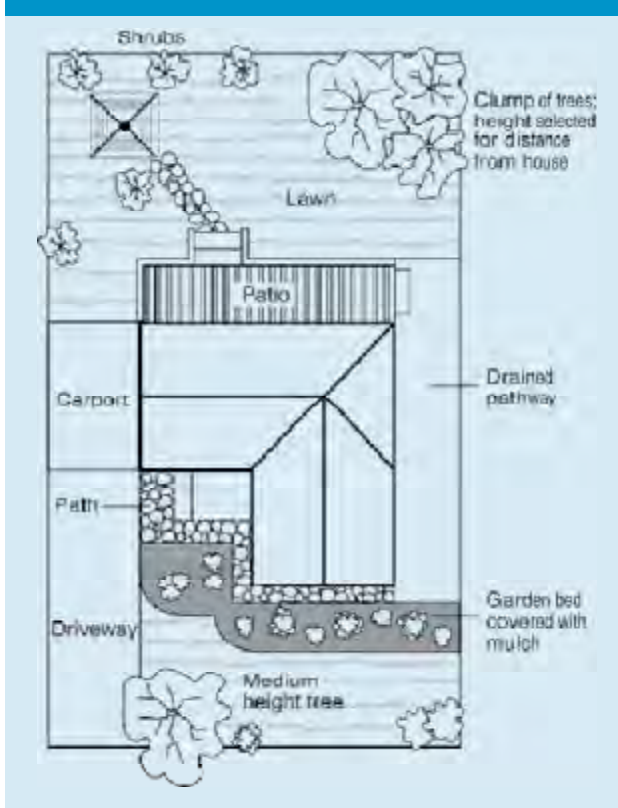Gardens for a reactive site



should extend outwards a minimum of 900 mm (more in highly reactive soil) and should have a minimum fall away from the building of 1:60. The finished paving should be no less than 100 mm below brick vent bases.

It is prudent to relocate drainage pipes away from this paving, if possible, to avoid complications from future leakage. If this is not practical, earthenware pipes should be replaced by PVC and backfilling should be of the same soil type as the surrounding soil and compacted to the same density.

Except in areas where freezing of water is an issue, it is wise to remove taps in the building area and relocate them well away from the building – preferably not uphill from it (see BTF 19).

It may be desirable to install a grated drain at the outside edge of the paving on the uphill side of the building. If subsoil drainage is needed this can be installed under the surface drain.

Condensation

In buildings with a subfloor void such as where bearers and joists support flooring, insufficient ventilation creates ideal conditions for condensation, particularly where there is little clearance between the floor and the ground. Condensation adds to the moisture already present in the subfloor and significantly slows the process of drying out. Installation of an adequate subfloor ventilation system, either natural or mechanical, is desirable.

Warning: Although this Building Technology File deals with cracking in buildings, it should be said that subfloor moisture can result in the development of other problems, notably:

- Water that is transmitted into masonry, metal or timber building elements causes damage and/or decay to those elements.
- High subfloor humidity and moisture content create an ideal environment for various pests, including termites and spiders.
- Where high moisture levels are transmitted to the flooring and walls, an increase in the dust mite count can ensue within the living areas. Dust mites, as well as dampness in general, can be a health hazard to inhabitants, particularly those who are abnormally susceptible to respiratory ailments.

The garden

The ideal vegetation layout is to have lawn or plants that require only light watering immediately adjacent to the drainage or paving edge, then more demanding plants, shrubs and trees spread out in that order.

Overwatering due to misuse of automatic watering systems is a common cause of saturation and water migration under footings. If it is necessary to use these systems, it is important to remove garden beds to a completely safe distance from buildings.

Existing trees

Where a tree is causing a problem of soil drying or there is the existence or threat of upheaval of footings, if the offending roots are subsidiary and their removal will not significantly damage the tree, they should be severed and a concrete or metal barrier placed vertically in the soil to prevent future root growth in the direction of the building. If it is not possible to remove the relevant roots without damage to the tree, an application to remove the tree should be made to the local authority. A prudent plan is to transplant likely offenders before they become a problem.

Information on trees, plants and shrubs

State departments overseeing agriculture can give information regarding root patterns, volume of water needed and safe distance from buildings of most species. Botanic gardens are also sources of information. For information on plant roots and drains, see Building Technology File 17.

Excavation

Excavation around footings must be properly engineered. Soil supporting footings can only be safely excavated at an angle that allows the soil under the footing to remain stable. This angle is called the angle of repose (or friction) and varies significantly between soil types and conditions. Removal of soil within the angle of repose will cause subsidence.

Remediation

Where erosion has occurred that has washed away soil adjacent to footings, soil of the same classification should be introduced and compacted to the same density. Where footings have been undermined, augmentation or other specialist work may be required. Remediation of footings and foundations is generally the realm of a specialist consultant.

Where isolated footings rise and fall because of swell/shrink effect, the homeowner may be tempted to alleviate floor bounce by filling the gap that has appeared between the bearer and the pier with blocking. The danger here is that when the next swell segment of the cycle occurs, the extra blocking will push the floor up into an accentuated dome and may also cause local shear failure in the soil. If it is necessary to use blocking, it should be by a pair of fine wedges and monitoring should be carried out fortnightly.

This BTF was prepared by John Lewer FAIB, MIAMA, Partner, Construction Diagnosis.

The information in this and other issues in the series was derived from various sources and was believed to be correct when published.

The information is advisory. It is provided in good faith and not claimed to be an exhaustive treatment of the relevant subject.

Further professional advice needs to be obtained before taking any action based on the information provided.

Distributed by

CSIRO PUBLISHING PO Box 1139, Collingwood 3066, Australia

Freecall 1800 645 051 Tel (03) 9662 7666 Fax (03) 9662 7555 www.publish.csiro.au

Email: publishing.sales@csiro.au

© CSIRO 2003. Unauthorised copying of this Building Technology file is prohibited

PRACTICE NOTE GUIDELINES FOR LANDSLIDE RISK MANAGEMENT 2007

APPENDIX C: – QUALITATIVE TERMINOLOGY FOR USE IN ASSESSING RISK TO PROPERTY (CONTINUED)

QUALITATIVE RISK ANALYSIS MATRIX – LEVEL OF RISK TO PROPERTY

LIKELIHOOD		CONSEQUENCES TO PROPERTY (With Indicative Approximate Cost of Damage)				
	Indicative Value of Approximate Annual Probability	1: CATASTROPHIC 200%	2: MAJOR 60%	3: MEDIUM 20%	4: MINOR 5%	5: INSIGNIFICANT 0.5%
A – ALMOST CERTAIN	10 ⁻¹	VH	VH	VH	H	M or L (5)
B - LIKELY	10 ⁻²	VH	VH	H	M	L
C - POSSIBLE	10 ⁻³	VH	H	M	M	VL
D - UNLIKELY	10 ⁻⁴	H	M	L	L	VL
E - RARE	10 ⁻⁵	M	L	L	VL	VL
F - BARELY CREDIBLE	10 ⁻⁶	L	VL	VL	VL	VL

Notes: (5) For Cell A5, may be subdivided such that a consequence of less than 0.1% is Low Risk.

(6) When considering a risk assessment it must be clearly stated whether it is for existing conditions or with risk control measures which may not be implemented at the current time.

RISK LEVEL IMPLICATIONS

Risk Level		Example Implications (7)
VH	VERY HIGH RISK	Unacceptable without treatment. Extensive detailed investigation and research, planning and implementation of treatment options essential to reduce risk to Low; may be too expensive and not practical. Work likely to cost more than value of the property.
H	HIGH RISK	Unacceptable without treatment. Detailed investigation, planning and implementation of treatment options required to reduce risk to Low. Work would cost a substantial sum in relation to the value of the property.
M	MODERATE RISK	May be tolerated in certain circumstances (subject to regulator's approval) but requires investigation, planning and implementation of treatment options to reduce the risk to Low. Treatment options to reduce to Low risk should be implemented as soon as practicable.
L	LOW RISK	Usually acceptable to regulators. Where treatment has been required to reduce the risk to this level, ongoing maintenance is required.
VL	VERY LOW RISK	Acceptable. Manage by normal slope maintenance procedures.

Note: (7) The implications for a particular situation are to be determined by all parties to the risk assessment and may depend on the nature of the property at risk; these are only given as a general guide.

PRACTICE NOTE GUIDELINES FOR LANDSLIDE RISK MANAGEMENT 2007
APPENDIX C: LANDSLIDE RISK ASSESSMENT
QUALITATIVE TERMINOLOGY FOR USE IN ASSESSING RISK TO PROPERTY

QUALITATIVE MEASURES OF LIKELIHOOD

Approximate Annual Probability		Implied Indicative Landslide Recurrence Interval		Description	Descriptor	Level
Indicative Value	Notional Boundary					
10 ⁻¹	5x10 ⁻²	10 years	20 years	The event is expected to occur over the design life.	ALMOST CERTAIN	A
10 ⁻²		100 years		The event will probably occur under adverse conditions over the design life.	LIKELY	B
10 ⁻³	5x10 ⁻³	1000 years	200 years	The event could occur under adverse conditions over the design life.	POSSIBLE	C
10 ⁻⁴	5x10 ⁻⁴	10,000 years	2000 years	The event might occur under very adverse circumstances over the design life.	UNLIKELY	D
10 ⁻⁵	5x10 ⁻⁵	100,000 years	20,000 years	The event is conceivable but only under exceptional circumstances over the design life.	RARE	E
10 ⁻⁶	5x10 ⁻⁶	1,000,000 years	200,000 years	The event is inconceivable or fanciful over the design life.	BARELY CREDIBLE	F

Note: (1) The table should be used from left to right; use Approximate Annual Probability or Description to assign Descriptor, not *vice versa*.

QUALITATIVE MEASURES OF CONSEQUENCES TO PROPERTY

Approximate Cost of Damage		Description	Descriptor	Level
Indicative Value	Notional Boundary			
200%	100%	Structure(s) completely destroyed and/or large scale damage requiring major engineering works for stabilisation. Could cause at least one adjacent property major consequence damage.	CATASTROPHIC	1
60%		Extensive damage to most of structure, and/or extending beyond site boundaries requiring significant stabilisation works. Could cause at least one adjacent property medium consequence damage.	MAJOR	2
20%	40%	Moderate damage to some of structure, and/or significant part of site requiring large stabilisation works. Could cause at least one adjacent property minor consequence damage.	MEDIUM	3
5%	10%	Limited damage to part of structure, and/or part of site requiring some reinstatement stabilisation works.	MINOR	4
0.5%	1%	Little damage. (Note for high probability event (Almost Certain), this category may be subdivided at a notional boundary of 0.1%. See Risk Matrix.)	INSIGNIFICANT	5

- Notes:** (2) The Approximate Cost of Damage is expressed as a percentage of market value, being the cost of the improved value of the unaffected property which includes the land plus the unaffected structures.
- (3) The Approximate Cost is to be an estimate of the direct cost of the damage, such as the cost of reinstatement of the damaged portion of the property (land plus structures), stabilisation works required to render the site to tolerable risk level for the landslide which has occurred and professional design fees, and consequential costs such as legal fees, temporary accommodation. It does not include additional stabilisation works to address other landslides which may affect the property.
- (4) The table should be used from left to right; use Approximate Cost of Damage or Description to assign Descriptor, not *vice versa*

PRACTICE NOTE GUIDELINES FOR LANDSLIDE RISK MANAGEMENT 2007

APPENDIX G - SOME GUIDELINES FOR HILLSIDE CONSTRUCTION

GOOD ENGINEERING PRACTICE

POOR ENGINEERING PRACTICE

ADVICE

GEOTECHNICAL ASSESSMENT	Obtain advice from a qualified, experienced geotechnical practitioner at early stage of planning and before site works.	Prepare detailed plan and start site works before geotechnical advice.
-------------------------	---	--

PLANNING

SITE PLANNING	Having obtained geotechnical advice, plan the development with the risk arising from the identified hazards and consequences in mind.	Plan development without regard for the Risk.
---------------	---	---

DESIGN AND CONSTRUCTION

HOUSE DESIGN	Use flexible structures which incorporate properly designed brickwork, timber or steel frames, timber or panel cladding. Consider use of split levels. Use decks for recreational areas where appropriate.	Floor plans which require extensive cutting and filling. Movement intolerant structures.
SITE CLEARING	Retain natural vegetation wherever practicable.	Indiscriminately clear the site.
ACCESS & DRIVEWAYS	Satisfy requirements below for cuts, fills, retaining walls and drainage. Council specifications for grades may need to be modified. Driveways and parking areas may need to be fully supported on piers.	Excavate and fill for site access before geotechnical advice.
EARTHWORKS	Retain natural contours wherever possible.	Indiscriminatory bulk earthworks.
CUTS	Minimise depth. Support with engineered retaining walls or batter to appropriate slope. Provide drainage measures and erosion control.	Large scale cuts and benching. Unsupported cuts. Ignore drainage requirements
FILLS	Minimise height. Strip vegetation and topsoil and key into natural slopes prior to filling. Use clean fill materials and compact to engineering standards. Batter to appropriate slope or support with engineered retaining wall. Provide surface drainage and appropriate subsurface drainage.	Loose or poorly compacted fill, which if it fails, may flow a considerable distance including onto property below. Block natural drainage lines. Fill over existing vegetation and topsoil. Include stumps, trees, vegetation, topsoil, boulders, building rubble etc in fill.
ROCK OUTCROPS & BOULDERS	Remove or stabilise boulders which may have unacceptable risk. Support rock faces where necessary.	Disturb or undercut detached blocks or boulders.
RETAINING WALLS	Engineer design to resist applied soil and water forces. Found on rock where practicable. Provide subsurface drainage within wall backfill and surface drainage on slope above. Construct wall as soon as possible after cut/fill operation.	Construct a structurally inadequate wall such as sandstone flagging, brick or unreinforced blockwork. Lack of subsurface drains and weepholes.
FOOTINGS	Found within rock where practicable. Use rows of piers or strip footings oriented up and down slope. Design for lateral creep pressures if necessary. Backfill footing excavations to exclude ingress of surface water.	Found on topsoil, loose fill, detached boulders or undercut cliffs.
SWIMMING POOLS	Engineer designed. Support on piers to rock where practicable. Provide with under-drainage and gravity drain outlet where practicable. Design for high soil pressures which may develop on uphill side whilst there may be little or no lateral support on downhill side.	
DRAINAGE		
SURFACE	Provide at tops of cut and fill slopes. Discharge to street drainage or natural water courses. Provide general falls to prevent blockage by siltation and incorporate silt traps. Line to minimise infiltration and make flexible where possible. Special structures to dissipate energy at changes of slope and/or direction.	Discharge at top of fills and cuts. Allow water to pond on bench areas.
SUBSURFACE	Provide filter around subsurface drain. Provide drain behind retaining walls. Use flexible pipelines with access for maintenance. Prevent inflow of surface water.	Discharge roof runoff into absorption trenches.
SEPTIC & SULLAGE	Usually requires pump-out or mains sewer systems; absorption trenches may be possible in some areas if risk is acceptable. Storage tanks should be water-tight and adequately founded.	Discharge sullage directly onto and into slopes. Use absorption trenches without consideration of landslide risk.
EROSION CONTROL & LANDSCAPING	Control erosion as this may lead to instability. Revegetate cleared area.	Failure to observe earthworks and drainage recommendations when landscaping.


DRAWINGS AND SITE VISITS DURING CONSTRUCTION

DRAWINGS	Building Application drawings should be viewed by geotechnical consultant	
SITE VISITS	Site Visits by consultant may be appropriate during construction/	

INSPECTION AND MAINTENANCE BY OWNER

OWNER'S RESPONSIBILITY	Clean drainage systems; repair broken joints in drains and leaks in supply pipes. Where structural distress is evident see advice. If seepage observed, determine causes or seek advice on consequences.	
------------------------	--	--

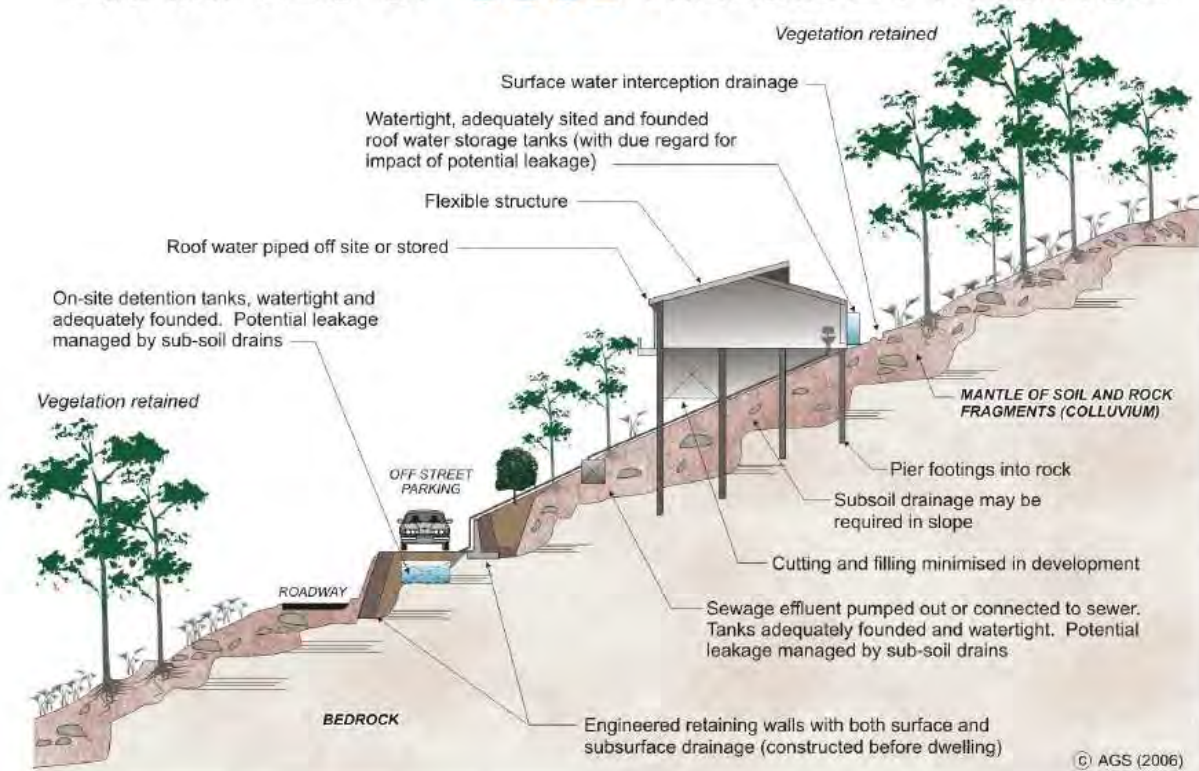EXAMPLES OF **GOOD** HILLSIDE PRACTICE



EXAMPLES OF **POOR** HILLSIDE PRACTICE

